

X67 system

User's manual 4.30 (April 2025) MAX67-ENG



Publishing information

B&R Industrial Automation GmbH B&R Strasse 1 5142 Eggelsberg Austria

Telephone: +43 7748 6586-0

Fax: +43 7748 6586-26

office@br-automation.com

Disclaimer

All information in this document is current as of its creation. The contents of this document are subject to change without notice. B&R Industrial Automation GmbH assumes unlimited liability in particular for technical or editorial errors in this document only (i) in the event of gross negligence or (ii) for culpably inflicted personal injury. Beyond that, liability is excluded to the extent permitted by law. Liability in cases in which the law stipulates mandatory unlimited liability (such as product liability) remains unaffected. Liability for indirect damage, consequential damage, business interruption, loss of profit or loss of information and data is excluded, in particular for damage that is directly or indirectly attributable to the delivery, performance and use of this material.

B&R Industrial Automation GmbH notes that the software and hardware designations and brand names of the respective companies used in this document are subject to general trademark, brand or patent protection.

Hardware and software from third-party suppliers referenced in this document is subject exclusively to the respective terms of use of these third-party providers. B&R Industrial Automation GmbH assumes no liability in this regard. Any recommendations made by B&R Industrial Automation GmbH are not contractual content, but merely non-binding information for which no liability is assumed. When using hardware and software from third-party suppliers, the relevant user documentation of these third-party suppliers must additionally be consulted and, in particular, the safety guidelines and technical specifications contained therein must be observed. The compatibility of the products from B&R Industrial Automation GmbH described in this document with hardware and software from third-party suppliers is not contractual content unless this has been separately agreed in individual cases; in this respect, warranty for such compatibility is excluded in any case, and it is the sole responsibility of the customer to verify this compatibility in advance.

1254257025045-4.30

1 General information	6
1.1 Manual history	
1.2 Definition of this term	
1.3 Abbreviations	
2 Safety notices	8
2.1 Intended use	
2.2 Safety products	
2.3 Protection against electrostatic discharge	
2.3.1 Packaging	
2.3.2 Regulations for proper ESD handling	
2.4 Transport and storage	
2.5 Mounting orientation	
2.6 Operation	11
2.6.1 Protection against touching electrical parts	11
2.7 Organization of safety notices	11
3 System characteristics	12
3.1 The X67 system	
3.2 General product features	
3.3 Flexibility	
3.4 EMC concept	16
3.5 Communication	17
3.6 System power supply	17
3.7 X2X Link	18
4 Module overviews	20
4.1 Standard modules	20
4.1.1 Module overview: Alphabetical	
4.1.2 Module overview: Grouped	23
4.2 Safety module	29
4.2.1 Safety module overview	29
5 Dimensioning	30
5.1 CAD support	30
5.2 Dimensions	31
6 Installation and wiring	32
6.1 Installation	
6.1.1 Installing on an aluminum frame	
6.1.2 Top-hat rail installation	33
6.1.3 Installation on a mounting plate or directly on the machine	34
6.2 Lightning and surge protection	35
6.2.1 USA/Canada	35
6.3 Shielding and grounding	35
6.4 Connectors	36
6.5 X67 system cabling	
6.5.1 X2X Link cabling	
6.5.2 X2X Link cabling on the bus controller	
6.5.3 X2X Link cabling on bus transmitter X20BT9400	
6.5.4 I/O power supply cabling	41
7 Mechanical and electrical configuration	
7.1 The power supply concept	
7.1.1 Failure of I/O supply (ModuleOK)	43
7.2 Safe cutoff of a potential group	44

Table of contents

7.2.1 Description of function	
7.2.2 Scope of application / Standards referenced	44
7.2.3 Intended use	45
7.2.4 System-specific information	49
7.2.5 Safety guidelines	
7.3 Combining X2X Link systems	
7.3.1 Connection overviews	55
7.3.2 Connection examples	
7.4 Calculating the power requirements	
7.4.1 Example 1	
7.4.2 Example 2	60
8 Accessories	
8.1 General overview	
8.1.1 X2X Link and I/O power supply	
8.1.2 Module connections	
8.1.3 Fieldbus systems	
8.2 Pre-assembled cables	
8.2.1 X2X Link cables	
8.2.2 I/O power supply cables	
8.2.3 M8 sensor cables	-
8.2.4 M12 sensor cables	
8.2.5 Multifunction cables	
8.2.6 CAN bus cables	
8.2.7 PROFIBUS DP cables	
8.2.8 X67 POWERLINK/Ethernet cables	
8.2.9 80CMxxx01.26-01- Motor cables with M12 connector	
8.2.10 80CMxxx03.26-01 - ABR incremental encoder cables with M12 connector	
8.3.1 I/O power supply	
8.3.2 Sensors/Actuators	
8.3.3 Special-purpose connectors	
8.3.4 CAN bus	
8.3.5 PROFIBUS DP / X2X Link	
8.3.6 POWERLINK/Ethernet	
8.4 Other accessories	
8.4.1 Terminating resistor	
8.4.2 Connectors	
8.4.3 Threaded caps	
8.4.4 Plain text tags	
8.4.5 Mounting plate	
8.4.6 Mounting plates for top-hat rails	
8.4.7 Installation tool	
9 International and national certifications	104
9.1 Overview of certifications	
9.2 EU directives and standards (CE)	
9.2.1 Overview of standards	
9.2.2 Requirements for immunity to disturbances	
9.2.3 Emission requirements	
9.2.4 Mechanical conditions	
9.2.5 Electrical safety	114
9.3 UL / CSA	115
9.4 Other certifications	116
10 Environmentally friendly disposal	117
10.1 Separation of materials	

11 Additional information	118
11.1 EMC information	118
11.1.1 Electromagnetic compatibility (EMC)	
11.1.2 Interference	
11.1.3 Types of couplings	119
11.1.4 Wiring basics	119
11.1.5 Application-specific measures	120
11.1.6 Shielded lines	120
11.1.7 X2X Link settings	121
11.1.8 Environmental characteristics	121
11.2 Using I/O modules on the bus controller	122
11.3 General data points	123
11.3.1 FirmwareVersion	123
11.3.2 HardwareVariant	123
11.3.3 ModuleID	123
11.3.4 SerialNumber	124
11.3.5 ModuleOK	124
11.3.6 StaleData	124
11.4 NetTime Technology	125
11.4.1 Time information	125
11.4.2 Timestamp functions	127
11.5 Flatstream communication	128
11.5.1 Introduction	
11.5.2 Message, segment, sequence, MTU	
11.5.3 The Flatstream principle	
11.5.4 Registers for Flatstream mode	131
11.5.5 Example of function "Forward" with X2X Link	148

1 General information

1.1 Manual history

Version	Date	Comment ¹⁾
4.30	March 2025	Section "General information"
		Removed "Other applicable documents".
		Section "Accessories"
		Added cables "80CMxxx03.26-01 and 80CMxxx01.26-01" to section "Pre-assembled cables".
		Added technical data under "Field-assembled connectors".
		Section "Additional information"
		Added new section "EMC information".
4.20	April 2024	Updated section "Module overviews".
		Added new modules.
		Section "Installation and wiring"
		Added new section "Top-hat rail installation".
		Section "Accessories"
		Added new accessory "Mounting plate".
		Revised "Technical data" for cables in "X67 POWERLINK/Ethernet cables".
4.10	May 2023	Section "Safety guidelines"
		Updated section "Safety guidelines".
		Updated section "Intended use".
		Updated section "Module overviews".
		Section "Installation and wiring"
		Changed section "Installation on a mounting plate or directly on the machine".
		Added new section "Lightning and overvoltage protection".
		Section "Mechanical and electrical configuration"
		Added information in section "Power supply concept".
		Section "Accessories"
		Revised "Technical data" for cables in "X67 POWERLINK/Ethernet cables".
		Section "International and national certifications"
		Added new certification "UKCA".
		Revised section "Requirements for immunity to disturbances".
4.00	March 2022	New edition
		Restructured general sections.
		Removed all module data sheets.
		Revised module overviews.
		Linked module names to downloads from the B&R website.
		Added safety modules to module overviews.
3.30	March 2019	Updated section "Mechanical and electrical configuration".
		Added missing fuses in figures.
		Updated section "Accessories".
		Updated section "International and national certifications". Updated section "Additional information".
		·
		 I/O modules on the bus controller NetTime Technology
		Updated data sheets.
		·
		 Corrected input/output circuit diagram for bus controllers. Updated technical data.
3.20	March 2018	Added new module.
3.20		• X67BC8780.L12
		Updated section "Accessories".
		Updated data sheets.
3.10	July 2017	Added new module.
		• X67HB8880.L12
		Corrected cable color error in data sheets.
		Updated data sheets.

Column "Comment" contains only the most important changes in this user's manual. Several updates, corrections and format variations are not included.

1.2 Definition of this term

Term	Description
SG4	System Generation 4 (SG4) - Controllers with Intel processors or ARM.
	 X20 system X20CPx48x(-1), X20(c)CP04xx(-1), X20(c)CP13xx(-RT), X20(c)CPx58x, X20CPx68x(X), X20EMx61x
	• Power Panels C30, C50, C70, C80
	Automation PCs APC910, APC2100, APC3100, MPC3100
	• Panel PCs PPC900, PPC2100, PPC3100
SG3	System Generation 3 (SG3) - Controllers with Motorola processors.
	Control systems System 2003 System 2005 System 2010
	Power Panels PP15, PP21, PP35, PP41
SGC	System Generation Compact (SGC) - Controllers with Motorola processors (embedded µP).
	X20 system X20CP02xx, X20XC02xx

1.3 Abbreviations

The following abbreviations appear throughout the user's manual, for example in data tables or descriptions of pinouts.

Abbreviation	Stands for	Description
NC	Normally closed	Normally closed relay contact.
	Not connected	Used in pinout descriptions if a terminal or pin is not connected to a module.
ND	Not defined	In data tables, this stands for a value that has not been defined. This may be because a cable manufacturer does not provide certain technical data, for example.
NO	Normally open	Normally open relay contact.
TBD	To be defined	Used in technical data tables when certain information is not yet available. The value will be provided later.

2 Safety notices

Programmable logic controllers, operating/monitoring devices (e.g. industrial PCs, Power Panels, Mobile Panels, etc.) as well as uninterruptible power supplies have all been designed, developed and manufactured by B&R for conventional use or for use with increased safety requirements (safety technology) in industry. They were not designed, developed and manufactured for any use involving serious risks or hazards that could lead to death, injury, serious physical damage or loss of any kind without the implementation of exceptionally stringent safety precautions. In particular, such risks and hazards include the use of these devices to monitor nuclear reactions in nuclear power plants, their use in flight control or flight safety systems as well as in the control of mass transportation systems, medical life support systems or weapons systems.

When using programmable logic controllers or operating/monitoring devices as control systems together with a Soft PLC (e.g. B&R Automation Runtime or comparable product) or Slot PLC (e.g. B&R LS251 comparable product), safety precautions relevant to industrial control systems (e.g. the provision of safety devices such as emergency stop circuits, etc.) must be observed in accordance with applicable national and international regulations. The same applies for all other devices connected to the system, e.g. drives.

All tasks such as the installation, commissioning and servicing of devices are only permitted to be carried out by qualified personnel. Qualified personnel are those familiar with the transport, mounting, installation, commissioning and operation of devices who also have the appropriate qualifications (e.g. IEC 60364-1). National accident prevention regulations must be observed.

The safety notices, connection descriptions (type plate and documentation) and limit values listed in the technical data are to be read carefully before installation and commissioning and must be observed.

The use of these products is restricted to the following persons:

- Qualified personnel* who are familiar with relevant safety concepts for automation technology as well as applicable standards and regulations.
- Qualified personnel* who plan, develop, install and commission safety equipment in machines and systems.

Qualified personnel* in the context of this manual's safety guidelines are those who, due to their training, experience and instruction combined with their knowledge of relevant standards, regulations, accident prevention guidelines and operating conditions, are qualified to carry out essential tasks and to recognize and avoid potentially dangerous situations. In this regard, sufficient language skills are also required in order to be able to properly understand this manual.

2.1 Intended use

In all cases, applicable national and international standards, regulations and safety measures must be taken into account and observed!

The B&R products described in this manual are intended for use in industry and industrial applications. Intended use includes controlling, operating, monitoring, driving and visualizing as part of automation processes in machines and systems.

The use of B&R products is only permitted in their original condition. Modifications and extensions are only permitted if they are described in this manual.

B&R Industrial Automation GmbH assumes no any liability for damages of any kind arising from the use of B&R products outside of their intended use.

B&R products were not designed, developed and manufactured for any use involving serious risks or hazards that could result in death, injury, serious physical impairment or loss of any kind without the implementation of exceptionally stringent safety precautions.

B&R products are explicitly not intended for use in the following applications:

- · Monitoring and controlling thermonuclear processes
- Controlling weapon systems
- · Flight and traffic management systems for passenger and freight transportation
- · Health monitoring and life support systems

2.2 Safety products



Information:

For safety products, the safety guidelines in section "Safety technology" in Automation Help must also be observed in addition to the information in this manual.

2.3 Protection against electrostatic discharge

Electrical assemblies that can be damaged by ElectroStatic Discharge (ESD) must be handled accordingly.

2.3.1 Packaging

- · Electrical assemblies with housing
 - ... Do not require special ESD packaging but must be handled properly (see "Electrical assemblies with housing" on page 10).
- · Electrical assemblies without housing
 - ... Are protected by ESD-suitable packaging.

2.3.2 Regulations for proper ESD handling

Electrical assemblies with housing

- Do not touch the male connector contacts on the device (bus data contacts).
- Do not touch the connector contacts of connected cables.
- Do not touch the contact tips on circuit boards

Electrical assemblies without housing

The following applies in addition to "Electrical assemblies with housing":

- All persons handling electrical assemblies and devices in which electrical assemblies are installed must be grounded.
- · Assemblies are only permitted to be touched on the narrow sides or front plate.
- Always place assemblies on suitable surfaces (ESD packaging, conductive foam, etc.).



Information:

Metallic surfaces are not suitable storage surfaces.

- Assemblies must not be subjected to electrostatic discharges (e.g. due to charged plastics).
- A minimum distance of 10 cm from monitors or television sets must be maintained.
- Measuring instruments and devices must be grounded.
- Test probes of floating potential measuring instruments must be discharged briefly on suitable grounded surfaces before measurement.

Individual components

- ESD protective measures for individual components are implemented throughout B&R (conductive floors, shoes, wrist straps, etc.).
- The increased ESD protective measures for individual components are not required for handling B&R products at customer locations.

2.4 Transport and storage

During transport and storage, devices must be protected against undue stress (mechanical loads, temperature, moisture, corrosive atmospheres, etc.).

Devices contain components sensitive to electrostatic charges that can be damaged by improper handling. It is therefore necessary to provide the required protective measures against electrostatic discharge when installing or removing these devices (see "Protection against electrostatic discharge" on page 9).

2.5 Mounting orientation

- Installation must be performed according to this documentation using suitable equipment and tools.
- Devices are only permitted to be installed by qualified personnel without voltage applied.
- · General safety guidelines and national accident prevention regulations must be observed.
- Electrical installation must be carried out in accordance with applicable guidelines (e.g. line cross sections, fuses, protective ground connections).
- Take the necessary steps to protect against electrostatic discharges (see "Protection against electrostatic discharge" on page 9).

2.6 Operation

2.6.1 Protection against touching electrical parts



Danger!

In order to operate programmable logic controllers, operating and monitoring devices and the uninterruptible power supply, it is necessary for certain components to carry dangerous voltages. Touching one of these components can result in a life-threatening electric shock. There is a risk of death, serious injury or damage to property.

Before switching on the programmable logic controllers, operating and monitoring devices and uninterruptible power supply, it must be ensured that the housing is properly connected to ground potential (PE rail). The ground connection must also be made if the operating and monitoring device and uninterruptible power supply are only connected for testing purposes or only operated for a short time!

Before switching on the device, all voltage-carrying components must be securely covered. During operation, all covers must remain closed.

2.7 Organization of safety notices

Safety notices in this manual are organized as follows:

Safety notice	Description
Danger!	Disregarding these safety guidelines and notices can be life-threatening.
Caution!	Disregarding these safety guidelines and notices can result in severe injury or substantial damage to property.
Warning!	Disregarding these safety guidelines and notices can result in injury or damage to property.
Information:	This information is important for preventing errors.

Table 1: Organization of safety notices

3 System characteristics

Decentralized machine concepts call for distributed I/O concepts. Ideally, these components are installed directly on-site on nearly any area of the machine. To accomplish this, however, the I/O modules must be rated IP67.

The remote X67 system meets these demands perfectly. This system also makes it possible to reduce costs in many areas, including cabling, the control cabinet, commissioning and service. With a completely distributed structure, the X67 system provides the highest level of flexibility.

To get the most out of a remote I/O system, performance is key. The X67 meets this prerequisite with update times under one millisecond for 1000 digital and 50 analog inputs and outputs!

A maximum of 253 modules can be operated on a single line, with a distance up to 100 m between 2 modules.

Traditional I/O systems are located centrally in the control cabinet, with extensive wiring required for sensors and actuators. In addition, modular machine designs often require intermediate connections with multi-pin connectors. Remote I/O modules can only reach their full potential, however, if additional distribution boxes can be eliminated completely. This is why the optimal solution has to include I/O modules with robust IP67 protection that can be placed directly in harsh industrial environments.



3.1 The X67 system

The X67 system consists of bus controller, I/O, function and system supply modules that can be wired using standard M8 and M12 connectors.

Bus controllers



Bus controllers are the components used to connect to fieldbus systems. Equipped with digital interfaces that can be configured as inputs or outputs, they are already full-fledged I/O modules.

The ability to connect additional modules makes bus controllers extremely flexible and efficient. Like a modular system, the fieldbus device can be expanded. From the point of view of the fieldbus, it still remains a single device. The integrated X2X Link connection makes it possible to effortlessly connect various X67 modules over long distances.

The X67 system is extremely effective in addition to inexpensive. If the fieldbus needs to be changed, only the bus controller changes. The rest stays the same – on the machine and throughout the documentation.

Digital modules



There are many different types of X67 digital modules available:
• 8-/16-channel input modules

- 8-channel output modules. Each channel can handle 2 amps. The maximum total load is 8 amps.
- 8-/16-channel mixed modules with individually configurable channels
- Valve control modules
- Motor module

This flexibility reduces the number of modules while simplifying logistics and stock management. The number of inputs and outputs can always be tailored exactly to requirements

Analog modules



The X67 system offers input and output modules, as well as mixed modules with 4 channels each for measuring current or voltage signals.

Modules for measuring temperature using a resistance temperature detector or thermocouple round out the product range. A special male M12 connector for temperature compensation of the measurement point is also available as an accessory for these modules.

One feature common to all analog modules is the complete shielding. The cable shield has seamless 360° contact with the shielding on the module.

Function modules



The X67 system offers special function modules:

- Multifunctional counter module for absolute and incremental encoder and more
- Communication module: Combining RS232 or RS485/RS422 and digital I/O is a compact solution for many types of applications. This makes it possible to connect barcode readers and the corresponding trigger sensor with just one module.

System power supply



The ability to perform diagnostic functions must remain in every operating mode. This is an extremely important aspect of operational safety for the entire machine. For this reason, the power supply for I/O is completely isolated from the power supply for communication on X67 systems. Even if the I/O power supply is interrupted, communication and diagnostic capabilities remain. Flexible system supply modules are used for this purpose. A system supply module can supply 2 lines. Any number of system supply modules can be used in an X67 installation, allowing maximum availability by implementing a redundant supply design.

3.2 General product features

X67 modules have a plastic housing for use in harsh industrial environments. The devices are fully sealed and therefore extremely resistant to mechanical stress. Integrated LEDs provide clear status indications on the machine, logically distributed on the individual channels, for the X2X Link status and the entire I/O section. Solutions such as central fastening using two screws allow easy installation, even when using wedge nuts in standard aluminum frames.





Open

X67 is an I/O solution for all standard fieldbus systems and for direct connections to B&R controllers. The fieldbus may change, but the I/O system always remains the same.



Adaptable

Digital channels that can be configured as inputs or outputs allow the solution to be tailored to the requirements and reduce the total number and variety of modules needed.



Compact

Optimal ergonomics and an extremely compact design allow the X67 system to fit anywhere on the machine.



Unmistakable

Visual status indicators on the modules and advanced status messages via the bus enable clear-cut diagnostics. Warning and error thresholds for I/O power supply, single-channel diagnostics and open-circuit detection are just a few examples.



Flexible

100 m module spacing without limitations offers sufficient reserves, regardless of whether modules sit close together or distances must be covered.



Robust

These completely sealed modules are the epitome of robustness, with features for maximizing electromagnetic immunity (EMC) hidden inside.



Fast

Cycle times well below one millisecond ensure the necessary reserves for your application. Synchronous I/O processing is a matter of course.



Plug-and-run

Pre-assembled standard cables and automatic module identification reduce installation and commissioning work to an absolute minimum.



Safe

Communication and I/Os are completely galvanically isolated. Disturbances or voltage drops on the I/O side have no influence on the functionality of the bus. Diagnostics is always possible.



Protected

Integrated reverse polarity protection, short-circuit protection, protection when switching inductances – the highest degree of protection for the electronics as well.



Powerful.

I/O power via 2 pairs of leads provides up to 8 amps for outputs or supplies additional modules



Well-supplied

Many sensors and actuators require a 24 VDC power supply. With X67 modules, this is integrated in all digital connections and also provides protection against short circuits.



Shielded

Seamless 360° shield grounding from the cable over the connector directly on the threading of the M12 connector, through to the metal backplane of the module and over the mounting screws straight to the machine provides a complete ground connection for all bus and analog signals.



Expandable

X67 systems can be expanded by 250 modules with up to 100 m between them.



Centered

The central position of the two mounting screws prevents misalignment of the housing in standard aluminum frames with wedge nut installations.



Multi-talented

Synchronous I/O processing, adjustable software filters, integrated counter functions, flexible standard functions and more – these are intelligent products perfect for the most versatile applications.

3.3 Flexibility

Reduced wiring

Instead of having to extensively wire each individual sensor or actuator to the control cabinet over long distances, the X67 system reduces the amount of work down to a single bus cable and a 24 VDC power supply. This applies to the entire machine.

One system for all machine designs

Whether a compact machine or a large plant, this I/O system can be adapted to the machine's architecture to meet every demand for every level of performance. The X67 system offers ultimate freedom.

Simple service

Easy error correction, as sensors and actuators can be replaced individually and quickly by means of plug-in connections. Extensive diagnostic options allow errors to be detected immediately.

Minimum control cabinet space

This system opens up the space normally needed for laying cables or placing terminals, I/O modules or additional distribution boxes.

Short commissioning time

Connection via the mechanical, pre-assembled standard cables make this possible. Wiring errors are a thing of the past. Preparation for operation starts with the construction of the machine. Lengthy inspection of the wiring is no longer necessary.


Unlimited expansion possibilities

The X67 system is extremely flexible, handling removable machine modules, optional expansions and even future upgrades to the machine architecture with ease.

Open communication


POWERLINK, CAN bus, CANopen, DeviceNet, PROFIBUS DP, etc. – regardless of the selected fieldbus, the I/O system remains X67.

System characteristics

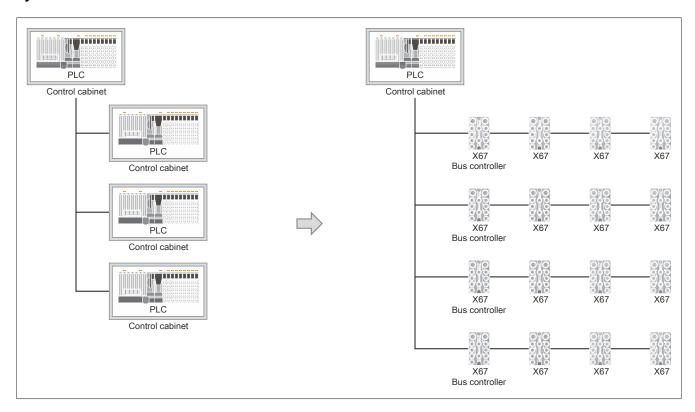

3.4 EMC concept

An important feature of the X67 construction is the sophisticated EMC concept. The cable shield is brought into the X67 module via the connector (complete 360° shielding). Inside the X67 housing, all components including the base plate make contact with the same ground. The final link in the chain is the connection between the base plate mounting screw and the machine which completes the ground contact from the cable to the machine. This is done for bus connections and analog connections using M12 connectors.

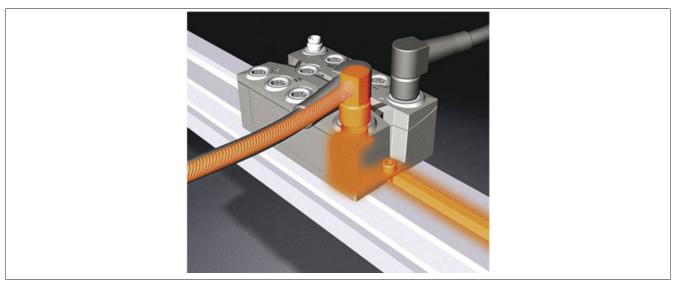


For details, see "EMC information" on page 118.

3.5 Communication

The goal of development was to detach individual modules from the backplane to achieve a real remote system. The X67 system uses a cable to replace the conventional backplane and connect the modules together. The name of this "decentralized backplane" is **"X2X Link"**.

The X67 system offers many connection options: X2X Link for direct connection of controllers or IPCs with aPCI modules or PCI cards. Indirect connections or connections to non-B&R controllers utilize the various fieldbus systems POWERLINK, CAN, CANopen, DeviceNet and PROFIBUS DP.

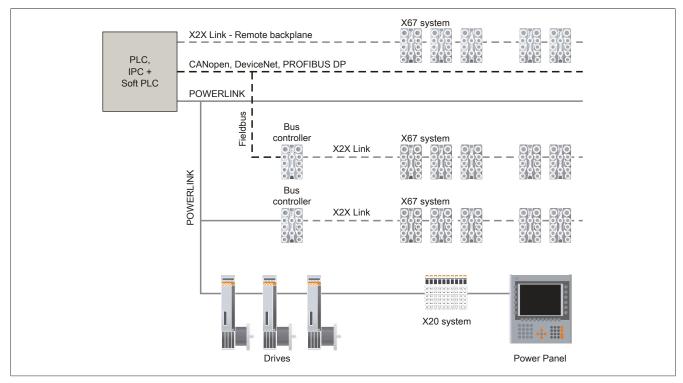


3.6 System power supply

The X67's decentralized structure allows modules to be placed in different power supply groups as needed. For example, this allows various modules to be connected to different voltage protection circuits or different emergency stop groups to be implemented.

The entire X2X Link network is operated totally independently of the I/O power supply. In addition to the communication lines, the connection cable contains 2 wires to supply power to the X2X Link electronics of each module. This is fully galvanically isolated from the I/O component. For this reason, power failures on the I/O side (e.g. due to short circuit, open circuit or emergency stop) only stop operation of the I/O section. The bus section continues to function with the corresponding status messages being sent to the controller. This feature is essential in allowing errors to be analyzed quickly and corrected.

The X2X Link power supply is guaranteed by system supply modules.

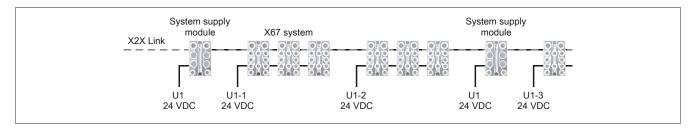

3.7 X2X Link

All connections are made using standard M8 or M12 connectors. The X2X Link connectors are keyed to prevent mix-ups with the M12 analog connectors.

X2X Link is based on shielded copper cables. Each module has one integrated male and female connector, one X2X Link input and one X2X Link output. An additional T-connector is not needed. Each module is operated synchronously. That means reading inputs or writing outputs takes place synchronous to the X2X Link cycle. In addition to cyclic communication, X2X Link also offers acyclic communication, e.g. to load parameters onto the module.

By default, it is not necessary to configure the node number switches on X67 modules. The modules are automatically identified by the system when started up using their X2X Link position.




Configurable X2X Link address

The remote X2X Link backplane, which connects the individual I/O modules with each other, is set up to be self-addressing. Because of this, it is not necessary to set the node numbers. The module address is assigned according to its position in the X2X Link line.

In certain cases, e.g. when configurations of modular machines change, it is necessary to define specific module groups at a fixed address, regardless of the preceding modules in the line.

For this purpose, there are modules in both the X20 system and the X67 system with node number switches that allow the X2X Link address to be set. All subsequent modules refer to this offset and use it automatically for addressing purposes.

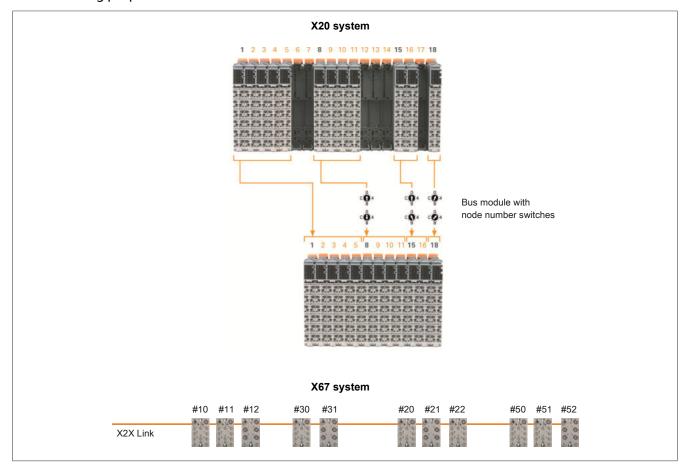

4 Module overviews

4.1 Standard modules

4.1.1 Module overview: Alphabetical

Order number	Module type	Description	Special functions
X67Al1223	Analog input module	• 4 inputs, ±10 V, 12-bit converter resolution	Configurable input filter Open-circuit detection
X67Al1233	Analog input module	• 4 inputs, ±10 V, 16-bit converter resolution	Configurable input filter Open-circuit detection
X67Al1323	Analog input module	4 inputs, 0 to 20 mA or 4 to 20 mA, 12-bit converter resolution	Configurable input filter
X67Al1333	Analog input module	4 inputs, 0 to 20 mA or 4 to 20 mA, 16-bit converter resolution	Configurable input filter
X67AI2744	Analog input module	2 full-bridge strain gauge inputs, 10 V, 24-bit converter resolution	
X67AI4850	Analog input module	4 potentiometer displacement gauges, 14-bit converter resolution	
X67AM1223	Analog mixed module	2 analog inputs 2 analog outputs, ±10 V, 12-bit converter resolution	Configurable input filter Open-circuit detection on the inputs
X67AM1323	Analog mixed module	2 analog inputs 2 analog outputs, 0 to 20 mA, 12-bit converter resolution	Configurable input filter
X67AO1223	Analog output module	4 outputs, ±10 V, 12-bit converter resolution	
X67AO1323	Analog output module	4 outputs, 0 to 20 mA, 12-bit converter resolution	
X67AT1311	Temperature input mod- ule	4 resistance measurement inputs, Pt100, resolution 0.01K	• 2- or 4-wire measurement
X67AT1322	Temperature input mod- ule	Resistance measurement inputs, Pt100, Pt1000, KTY10, KTY84, resolution 0.1 K	• 2- or 4-wire measurement
<u>X67AT1402</u>	Temperature input mod- ule	• 4 thermocouple inputs, type J, K, N, R, S, resolution 0.1 K	
X67BC4321-10	Bus controller	1 CANopen interface X2X Link power supply 3 W M8 connectors 8 digital inputs/outputs	Integrated digital mixed module X67DM1321 CAN bus galvanically isolated
X67BC4321.L08-10	Bus controller	1 CANopen interface X2X Link power supply 15 W M8 connectors 16 digital inputs/outputs	 Integrated digital mixed module X67D- M1321.L08 CAN bus galvanically isolated High-density module
X67BC4321.L12-10	Bus controller	1 CANopen interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs	 Integrated digital mixed module X67D- M1321.L12 CAN bus galvanically isolated High-density module
X67BC6321	Bus controller	1 PROFIBUS DP interface X2X Link power supply 3 W M8 connectors 8 digital inputs/outputs	Integrated digital mixed module X67DM1321
X67BC6321.L08	Bus controller	1 PROFIBUS DP interface X2X Link power supply 15 W M8 connectors 16 digital inputs/outputs	Integrated digital mixed module X67D- M1321.L08 High-density module
X67BC6321.L12	Bus controller	1 PROFIBUS DP interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs	Integrated digital mixed module X67D- M1321.L12 High-density module
X67BC7321-1	Bus controller	1 CAN I/O interface X2X Link power supply 3 W M8 connectors	Integrated digital mixed module X67DM1321 Extended CAN I/O functionality

Order number	Module type	Description	Special functions
X67BC81RT.L12	Bus controller	• 2 POWERLINK interface	• 2 digital inputs,
	reACTION Technology	X2X Link power supply 15 W	24 VDC, <1 μs,
	module	• M12 connectors	• 3 digital inputs/outputs,
			5 VDC, <1 μs • 2 digital inputs/outputs,
			24 VDC, 0.4 A, <1 μs
			• 2 analog inputs
			±10 V, 5 µs 200 kHz sampling frequency,
			13-bit converter resolution,
			configurable input filter
			• 1 analog output
			±10 V, 2.5 μs, 13-bit converter resolution
			High-density module
X67BC8321-1	Bus controller	• 1 POWERLINK interface	Integrated digital mixed module X67DM1321
XOI DCOSLI I	Bus controller	• X2X Link power supply 3 W	integrated digital mixed module xorbinises
		• M8 connectors	
		8 digital inputs/outputs	
X67BC8321.L12	Bus controller	• 1 POWERLINK interface	Integrated digital mixed module X67D-
		X2X Link power supply 15 W	M1321.L12
		• M12 connectors	High-density module
V.CZD C00001		• 16 digital inputs/outputs	
X67BC8331	Bus controller	• 1 POWERLINK interface • X2X Link power supply 3 W	• 8 digital inputs/outputs, 24 VDC, 2 A,
		M8 connectors	configurable input filter
X67BC8513.L12	Bus controller	POWERLINK interface	12 digital inputs/outputs,
	Das controller	• X2X Link power supply 15 W	24 VDC, 0.5 A,
		• M12 connectors	configurable input filter,
			1 event counter 50 kHz
			• 1 analog input,
			0 to 20 mA,
			12-bit converter resolution
V67B60512.112.1	D	1 DOMEDIAN interfere	High-density module Guide to be a second t
X67BC8513.L12-1	Bus controller	• 1 POWERLINK interface • X2X Link power supply 15 W	6 digital input channels 6 digital output channels,
		M12 connectors	24 VDC, 0.5 A,
		THE CONNECTOR'S	propagation delay measurement
			• 1 analog input,
			0 to 20 mA,
			12-bit converter resolution,
			configurable analog input filter
V678 60700 140		BOWER WILL C	High-density module
X67BC8780.L12	Bus controller	POWERLINK interface 1x CAN interface	CAN interface with active wiring aid for 8x con- postions (ctar wiring)
		• IX CAN Interrace • M12 connectors	nections (star wiring) • High-density module
X67BCD321.L12	Bus controller	• EtherNet/IP interface	Integrated digital mixed module X67D-
DODOLI.LIL	Das controller	• X2X Link power supply 15 W	M1321.L12
		• M12 connectors	High-density module
		• 16 digital inputs/outputs	
X67BCD321.L12-1	Bus controller	• 1 EtherNet/IP interface	Integrated digital mixed module X67D-
		X2X Link power supply 15 W	M1321.L12
		M12 connectors - pinning variant	High-density module
		• 16 digital inputs/outputs	
X67BCE321.L12	Bus controller	• 1 PROFINET interface	Integrated digital mixed module X67D-
		X2X Link power supply 15 W M12 connectors	M1321.L12 • High-density module
		• M12 connectors • 16 digital inputs/outputs	ringir-density inodule
X67BCG321.L12	Bus controller	• 1 EtherCAT interface	Integrated digital mixed module X67D-
	Das controller	• X2X Link power supply 15 W	M1321.L12
		• M12 connectors	High-density module
		• 16 digital inputs/outputs	
X67BCJ321.L12	Bus controller	• 1 Modbus TCP/UDP interface	Integrated digital mixed module X67D-
		X2X Link power supply 15 W	M1321.L12
		• M12 connectors	High-density module
		16 digital inputs/outputs	
X67DC1198	Digital counter module	• 2x 3 inputs 5 V for SSI 1 Mbit/s or ABR 250 kHz,	Local time measurement functions
		8 digital inputs/outputs 24 VDC, 0.1 A	
		Optionally configurable: Singuts (outputs)	
		- 8 inputs/outputs - 4 AB counters, 100 kHz	
		- 4 comparator outputs	
		- 2 PWM outputs	
X67DC2322	Resolver module	• 2x 14-bit resolver input BRX/BRT	
		• 2 digital inputs, 24 VDC, sink	
		• 2 digital outputs, 0.5 A, source	
X67DI1371	Digital input module	• 8 inputs, 24 VDC, sink	Input filter 1 ms
X67DI1371.L08	Digital input module	• 16 inputs, 24 VDC, sink	• Input filter 1 ms
		M8 connectors	High-density module
	Digital input module	• 16 inputs, 24 VDC, sink	Input filter 1 ms
X67DI1371.L12			To the total control of the control
X67DI1371.L12		• M12 connectors	High-density module
X67Dl1371.L12 X67Dl1372	Digital input module	8 inputs, 24 VDC, source	High-density module Input filter 1 ms
			-

Module overviews

Order number	Module type	Description	Special functions
X67DM1321.L08	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M8 connectors	Configurable input filter2 event counters, 50 kHzHigh-density module
X67DM1321.L12	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12-1	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors - pinning variant	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM9321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A X2X Link address switch	Configurable input filter 2 event counters, 50 kHz
X67DM9321.L12	Digital mixed module	 16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors, X2X Link address switch 	Configurable input filter2 event counters, 50 kHzHigh-density module
X67DM9331.L12	Digital mixed module	 8 digital inputs/outputs, 24 VDC, 2 A M12 connectors X2X Link address switch 	Configurable input filter Single-channel sensor/actuator power supply monitoring High-density module
X67DO1332	Digital output module	• 8 digital outputs, 24 VDC, 2 A	Readable output status
X67DO9332.L12	Digital output module	8 outputs, 24 VDC, 2 A M12 connectors X2X Link address switch	Single-channel actuator power supply monitor- ing High-density module
X67DS438A	Digital signal module	4x IO-Link master V1.1, also usable as digital inputs/outputs	3-wire connections NetTime function
X67DS838A.L12	Digital signal module	• 8x IO-Link master V1.1,	3-wire connections NetTime function
X67DS838B.L12	Digital signal module	also usable as digital inputs/outputs • 8x IO-Link master V1.1,	Net Time function 3-wire connections
AOTUSOSOB.LIZ	Digital Signal Module	also usable as digital inputs/outputs	NetTime function 6x class A, 2x class B with galvanically isolated power supply
X67DV1311.L08	Digital valve control mod- ule	16 digital outputs, 24 VDC, 0.1 A, 1 M16 connector 16 digital inputs, 24 VDC, sink M8 connectors	Configurable input filter High-density module
X67HB8880.L12	Hub module	8-port industrial hub (layer 2), 8 to 32 VDC M12 connectors	
X67IF1121-1	Interface module	1 RS232 interface 1 RS422/485 interface 2 digital inputs/outputs, 24 VDC, 0.5 A 2 digital inputs, 24 VDC, sink	Configurable input filter
X67MM2436	PWM motor module	 I/O power supply 24 to 38.5 VDC ±25% 2 PWM motor bridges, 3 A continuous current, 5 A peak current 2x 3 digital inputs 24 VDC, sink, configurable as incremental encoder 	
X67PS1300	System supply module	24 VDC X2X Link power supply 15 W	Reverse polarity protection, short-circuit proof, overload-proof, parallel connection possible, redundancy operation possible
X67SM2436	Stepper motor module	I/O power supply 24 to 38.5 VDC ±25% To motor connections, A continuous current, A peak current 2x 3 digital inputs 24 VDC, sink, configurable as incremental encoder	NetTime function
X67SM2446-1	Stepper motor module	Module power supply 24 to 48 VDC ±25% 2 motor connections, 4 A continuous current, 8 A peak current 6 digital inputs 24 VDC, sink, configurable as incremental encoder	Current reduction function NetTime function
X67SM4320	Stepper motor module	I/O power supply 24 VDC ±25% Motor connections, A continuous current, S A peak current	NetTime function
X67UM1352	Universal mixed module	 1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source 	

4.1.2 Module overview: Grouped

4.1.2.1 Analog outputs

Order number	Module type	Description	Special functions
X67AM1223	Analog mixed module	• 2 analog inputs	Configurable input filter
		• 2 analog outputs,	 Open-circuit detection on the inputs
		±10 V,	
		12-bit converter resolution	
X67AM1323	Analog mixed module	• 2 analog inputs	Configurable input filter
		• 2 analog outputs,	
		0 to 20 mA,	
		12-bit converter resolution	
X67AO1223	Analog output module	• 4 outputs,	
		±10 V,	
		12-bit converter resolution	
X67AO1323	Analog output module	• 4 outputs,	
		0 to 20 mA,	
		12-bit converter resolution	

4.1.2.2 Analog inputs

Order number	Module type	Description	Special functions
X67AI1223	Analog input module	• 4 inputs, ±10 V, 12-bit converter resolution	Configurable input filter Open-circuit detection
X67AI1233	Analog input module	• 4 inputs, ±10 V, 16-bit converter resolution	Configurable input filter Open-circuit detection
X67AI1323	Analog input module	4 inputs, 0 to 20 mA or 4 to 20 mA, 12-bit converter resolution	Configurable input filter
X67AI1333	Analog input module	4 inputs, 0 to 20 mA or 4 to 20 mA, 16-bit converter resolution	Configurable input filter
X67AI2744	Analog input module	2 full-bridge strain gauge inputs, 10 V, 24-bit converter resolution	
X67AI4850	Analog input module	4 potentiometer displacement gauges, 14-bit converter resolution	
X67AM1223	Analog mixed module	2 analog inputs 2 analog outputs, ±10 V, 12-bit converter resolution	Configurable input filter Open-circuit detection on the inputs
X67AM1323	Analog mixed module	2 analog inputs 2 analog outputs, 0 to 20 mA, 12-bit converter resolution	Configurable input filter
X67UM1352	Universal mixed module	 1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source 	

4.1.2.3 Analog mixed modules

Order number	Module type	Description	Special functions
X67AM1223	Analog mixed module	• 2 analog inputs	Configurable input filter
		• 2 analog outputs,	 Open-circuit detection on the inputs
		±10 V,	·
		12-bit converter resolution	
X67AM1323	Analog mixed module	• 2 analog inputs	Configurable input filter
		• 2 analog outputs,	
		0 to 20 mA,	
		12-bit converter resolution	

Module overviews

4.1.2.4 Bus controller

Order number	Module type	Description	Special functions
X67BC4321-10	Bus controller	1 CANopen interface X2X Link power supply 3 W M8 connectors 8 digital inputs/outputs	Integrated digital mixed module X67DM1321 CAN bus galvanically isolated
X67BC4321.L08-10	Bus controller	1 CANopen interface X2X Link power supply 15 W M8 connectors 16 digital inputs/outputs	Integrated digital mixed module X67D-M1321.L08 CAN bus galvanically isolated High-density module
X67BC4321.L12-10	Bus controller	1 CANopen interface X2X Link power supply 15 W M12 connectors	Integrated digital mixed module X67D- M1321.L12 CAN bus galvanically isolated
		• 16 digital inputs/outputs	High-density module
X67BC6321	Bus controller	 1 PROFIBUS DP interface X2X Link power supply 3 W M8 connectors 8 digital inputs/outputs 	Integrated digital mixed module X67DM1321
X67BC6321.L08	Bus controller	 1 PROFIBUS DP interface X2X Link power supply 15 W M8 connectors 16 digital inputs/outputs 	 Integrated digital mixed module X67D- M1321.L08 High-density module
X67BC6321.L12	Bus controller	1 PROFIBUS DP interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs	Integrated digital mixed module X67D- M1321.L12 High-density module
X67BC7321-1	Bus controller	1 CAN I/O interface X2X Link power supply 3 W M8 connectors	Integrated digital mixed module X67DM1321 Extended CAN I/O functionality
X67BC81RT.L12	Bus controller reACTION Technology module	2 POWERLINK interface X2X Link power supply 15 W M12 connectors	 2 digital inputs, 24 VDC, <1 μs, 3 digital inputs/outputs, 5 VDC, <1 μs 2 digital inputs/outputs, 24 VDC, 0.4 A, <1 μs 2 analog inputs ±10 V, 5 μs 200 kHz sampling frequency, 13-bit converter resolution, configurable input filter 1 analog output ±10 V, 2.5 μs, 13-bit converter resolution High-density module
X67BC8321-1	Bus controller	1 POWERLINK interface X2X Link power supply 3 W M8 connectors 8 digital inputs/outputs	Integrated digital mixed module X67DM1321
X67BC8321.L12	Bus controller	1 POWERLINK interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs	Integrated digital mixed module X67D-M1321.L12 High-density module
X67BC8331	Bus controller	1 POWERLINK interface X2X Link power supply 3 W M8 connectors	8 digital inputs/outputs, 24 VDC, 2 A, configurable input filter
X67BC8513.L12	Bus controller	POWERLINK interface X2X Link power supply 15 W M12 connectors	12 digital inputs/outputs, 24 VDC, 0.5 A, configurable input filter, 1 event counter 50 kHz 1 analog input, 0 to 20 mA, 12-bit converter resolution High-density module
X67BC8513.L12-1	Bus controller	1 POWERLINK interface X2X Link power supply 15 W M12 connectors	 6 digital input channels 6 digital output channels, 24 VDC, 0.5 A, propagation delay measurement 1 analog input, 0 to 20 mA, 12-bit converter resolution, configurable analog input filter High-density module
X67BC8780.L12	Bus controller	POWERLINK interface Ix CAN interface M12 connectors	CAN interface with active wiring aid for 8x connections (star wiring) High-density module
X67BCD321.L12	Bus controller	EtherNet/IP interface X2X Link power supply 15 W M12 connectors I6 digital inputs/outputs	Integrated digital mixed module X67D- M1321.L12 High-density module
X67BCD321.L12-1	Bus controller	1 EtherNet/IP interface X2X Link power supply 15 W M12 connectors - pinning variant 16 digital inputs/outputs	Integrated digital mixed module X67D- M1321.L12 High-density module

Order number	Module type	Description	Special functions
X67BCE321.L12	Bus controller	1 PROFINET interface X2X Link power supply 15 W	Integrated digital mixed module X67D- M1321.L12
		M12 connectors16 digital inputs/outputs	High-density module
X67BCG321.L12	Bus controller	 1 EtherCAT interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs 	Integrated digital mixed module X67D- M1321.L12 High-density module
X67BCJ321.L12	Bus controller	 1 Modbus TCP/UDP interface X2X Link power supply 15 W M12 connectors 16 digital inputs/outputs 	Integrated digital mixed module X67D- M1321.L12 High-density module
X67HB8880.L12	Hub module	8-port industrial hub (layer 2),8 to 32 VDCM12 connectors	

4.1.2.5 Digital outputs

Order number	Module type	Description	Special functions
X67DM1321	Digital mixed module	• 8 digital inputs/outputs, 24 VDC, 0.5 A	Configurable input filter 2 event counters, 50 kHz
X67DM1321.L08	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M8 connectors	 Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M12 connectors	Configurable input filter2 event counters, 50 kHzHigh-density module
X67DM1321,L12-1	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors - pinning variant	Configurable input filter2 event counters, 50 kHzHigh-density module
X67DM9321	Digital mixed module	• 8 digital inputs/outputs, 24 VDC, 0.5 A • X2X Link address switch	Configurable input filter2 event counters, 50 kHz
X67DM9321.L12	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors, X2X Link address switch	Configurable input filter2 event counters, 50 kHzHigh-density module
X67DM9331.L12	Digital mixed module	8 digital inputs/outputs, 24 VDC, 2 A M12 connectors X2X Link address switch	Configurable input filter Single-channel sensor/actuator power supply monitoring High-density module
X67DO1332	Digital output module	• 8 digital outputs, 24 VDC, 2 A	Readable output status
X67DO9332.L12	Digital output module	8 outputs, 24 VDC, 2 A M12 connectors X2X Link address switch	 Single-channel actuator power supply monitoring High-density module
X67DV1311.L08	Digital valve control mod- ule	16 digital outputs, 24 VDC, 0.1 A, 1 M16 connector 16 digital inputs, 24 VDC, sink M8 connectors	Configurable input filter High-density module
X67MM2436	PWM motor module	I/O power supply 24 to 38.5 VDC ±25% PWM motor bridges, A continuous current, A peak current X 3 digital inputs 24 VDC, sink, configurable as incremental encoder	
X67SM2436	Stepper motor module	I/O power supply 24 to 38.5 VDC ±25% 2 motor connections, 3 A continuous current, 5 A peak current 2x 3 digital inputs 24 VDC, sink, configurable as incremental encoder	NetTime function
X67SM2446-1	Stepper motor module	Module power supply 24 to 48 VDC ±25% 2 motor connections, 4 A continuous current, 8 A peak current 6 digital inputs 24 VDC, sink, configurable as incremental encoder	Current reduction function NetTime function
X67SM4320	Stepper motor module	I/O power supply 24 VDC ±25% I A continuous current, S A peak current	NetTime function
X67UM1352	Universal mixed module	1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source	

4.1.2.6 Digital inputs

Order number	Module type	Description	Special functions
X67DI1371	Digital input module	• 8 inputs, 24 VDC, sink	Input filter 1 ms
X67DI1371.L08	Digital input module	• 16 inputs, 24 VDC, sink • M8 connectors	Input filter 1 ms High-density module
X67DI1371.L12	Digital input module	• 16 inputs, 24 VDC, sink • M12 connectors	Input filter 1 ms High-density module
X67DI1372	Digital input module	• 8 inputs, 24 VDC, source	• Input filter 1 ms
X67DM1321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A	Configurable input filter 2 event counters, 50 kHz
X67DM1321.L08	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M8 connectors	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M12 connectors	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12-1	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors - pinning variant	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM9321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A X2X Link address switch	Configurable input filter 2 event counters, 50 kHz
X67DM9321.L12	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors, X2X Link address switch	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM9331.L12	Digital mixed module	8 digital inputs/outputs, 24 VDC, 2 A M12 connectors X2X Link address switch	Configurable input filter Single-channel sensor/actuator power supply monitoring High-density module
X67UM1352	Universal mixed module	 1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source 	

4.1.2.7 Digital mixed modules

Order number	Module type	Description	Special functions
X67DM1321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A	Configurable input filter 2 event counters, 50 kHz
X67DM1321.L08	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M8 connectors	 Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M12 connectors	 Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12-1	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors - pinning variant	 Configurable input filter 2 event counters, 50 kHz High-density module
X67DM9321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A X2X Link address switch	Configurable input filter 2 event counters, 50 kHz
X67DM9321.L12	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors, X2X Link address switch	 Configurable input filter 2 event counters, 50 kHz High-density module
X67DM9331.L12	Digital mixed module	8 digital inputs/outputs, 24 VDC, 2 A M12 connectors X2X Link address switch	Configurable input filter Single-channel sensor/actuator power supply monitoring High-density module
X67UM1352	Universal mixed module	 1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source 	

4.1.2.8 Digital valve control

Order number	Module type	Description	Special functions
X67DV1311.L08	Digital valve control mod-	• 16 digital outputs,	Configurable input filter
	ule	24 VDC, 0.1 A,	High-density module
		1 M16 connector	
		• 16 digital inputs, 24 VDC, sink	
		M8 connectors	

4.1.2.9 Hub system

Order number	Module type	Description	Special functions
X67HB8880.L12	Hub module	8-port industrial hub (layer 2),	
		8 to 32 VDC	
		M12 connectors	

4.1.2.10 Communication modules

Order number	Module type	Description	Special functions
X67IF1121-1	Interface module	 1 RS232 interface 1 RS422/485 interface 2 digital inputs/outputs, 24 VDC, 0.5 A 2 digital inputs, 24 VDC, sink 	Configurable input filter

4.1.2.11 Motor modules

Order number	Module type	Description	Special functions
X67MM2436	PWM motor module	I/O power supply 24 to 38.5 VDC ±25% 2 PWM motor bridges, 3 A continuous current, 5 A peak current 2x 3 digital inputs 24 VDC, sink, configurable as incremental encoder	
X67SM2436	Stepper motor module	I/O power supply 24 to 38.5 VDC ±25% 2 motor connections, 3 A continuous current, 5 A peak current 2x 3 digital inputs 24 VDC, sink, configurable as incremental encoder	NetTime function
X67SM2446-1	Stepper motor module	 Module power supply 24 to 48 VDC ±25% 2 motor connections, 4 A continuous current, 8 A peak current 6 digital inputs 24 VDC, sink, configurable as incremental encoder 	Current reduction function NetTime function
X67SM4320	Stepper motor module	I/O power supply 24 VDC ±25% 4 motor connections, 1 A continuous current, 1.5 A peak current	NetTime function

4.1.2.12 Multifunction

Order number	Module type	Description	Special functions
X67DC1198	Digital counter module	• 2x 3 inputs 5 V for SSI 1 Mbit/s or ABR 250 kHz,	Local time measurement functions
		• 8 digital inputs/outputs 24 VDC, 0.1 A	
		Optionally configurable:	
		- 8 inputs/outputs	
		- 4 AB counters, 100 kHz	
		- 4 comparator outputs	
		- 2 PWM outputs	
X67DC2322	Resolver module	2x 14-bit resolver input BRX/BRT	
		• 2 digital inputs, 24 VDC, sink	
		• 2 digital outputs, 0.5 A, source	

4.1.2.13 reACTION I/O modules

Order number	Module type	Description	Special functions
X67BC81RT.L12	Bus controller reACTION Technology module	POWERLINK interface X2X Link power supply 15 W M12 connectors	 2 digital inputs, 24 VDC, <1 μs, 3 digital inputs/outputs, 5 VDC, <1 μs 2 digital inputs/outputs, 24 VDC, 0.4 A, <1 μs 2 analog inputs
			±10 V, 5 µs 200 kHz sampling frequency, 13-bit converter resolution, configurable input filter • 1 analog output ±10 V, 2.5 µs, 13-bit converter resolution • High-density module

4.1.2.14 Other functions

Order number	Module type	Description	Special functions
X67DS438A	Digital signal module	4x IO-Link master V1.1, also usable as digital inputs/outputs	3-wire connections NetTime function
X67DS838A.L12	Digital signal module	8x IO-Link master V1.1, also usable as digital inputs/outputs	3-wire connections NetTime function
X67DS838B.L12	Digital signal module	8x IO-Link master V1.1, also usable as digital inputs/outputs	3-wire connections NetTime function 6x class A, 2x class B with galvanically isolated power supply
X67UM1352	Universal mixed module	 1 input for evaluation of full-bridge strain gauge, 24-bit converter resolution 4 digital inputs 24 VDC, sink 1 digital output, 0.5 A, source 1 digital output, 1 A, source 	

4.1.2.15 System power supply

Order number	Module type	Description	Special functions
X67PS1300	System supply module	24 VDC X2X Link power supply 15 W	Reverse polarity protection, short-circuit proof, overload-proof, parallel connection possible,
			redundancy operation possible

4.1.2.16 Temperature measurement

Order number	Module type	Description	Special functions
X67AT1311	Temperature input mod- ule	• 4 resistance measurement inputs, Pt100, resolution 0.01K	• 2- or 4-wire measurement
X67AT1322	Temperature input mod- ule	Resistance measurement inputs, Pt100, Pt1000, KTY10, KTY84, resolution 0.1 K	• 2- or 4-wire measurement
<u>X67AT1402</u>	Temperature input mod- ule	• 4 thermocouple inputs, type J, K, N, R, S, resolution 0.1 K	

4.1.2.17 Counter functions

Order number	Module type	Description	Special functions
X67DC1198	Digital counter module	 2x 3 inputs 5 V for SSI 1 Mbit/s or ABR 250 kHz, 8 digital inputs/outputs 24 VDC, 0.1 A Optionally configurable: 8 inputs/outputs 4 AB counters, 100 kHz 4 comparator outputs 2 PWM outputs 	Local time measurement functions
X67DC2322	Resolver module	 2x 14-bit resolver input BRX/BRT 2 digital inputs, 24 VDC, sink 2 digital outputs, 0.5 A, source 	
X67DM1321	Digital mixed module	• 8 digital inputs/outputs, 24 VDC, 0.5 A	Configurable input filter 2 event counters, 50 kHz
X67DM1321.L08	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M8 connectors	Configurable input filter 2 event counters, 50 kHz High-density module
X67DM1321.L12	Digital mixed module	• 16 digital inputs/outputs, 24 VDC, 0.5 A • M12 connectors	Configurable input filter event counters, 50 kHz High-density module
X67DM1321.L12-1	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 A M12 connectors - pinning variant	Configurable input filter event counters, 50 kHz High-density module
X67DM9321	Digital mixed module	8 digital inputs/outputs, 24 VDC, 0.5 A X2X Link address switch	Configurable input filter 2 event counters, 50 kHz
X67DM9321.L12	Digital mixed module	16 digital inputs/outputs, 24 VDC, 0.5 AM12 connectors,X2X Link address switch	Configurable input filter 2 event counters, 50 kHz High-density module

4.2 Safety module

4.2.1 Safety module overview

Order number	Module type	Description	Special functions
X67SC4122.L12	Safe digital mixed module	 8 safe type A digital inputs, configurable input filter 8 pulse outputs, 24 VDC 4 safe type B1 digital outputs, 24 VDC, 2 A, OSSD <500 μs M12 connectors 	High-density module
X67SI8103	Safe digital input module	 2x M12 interface with 2 safe type A digital inputs each, configurable input filter and 2 pulse outputs, 24 VDC, 2x standardized 8-pin M12 device interface each with 1 digital input without safety function and 2 safe type A digital input, configurable input filter and 2 pulse outputs, 24 VDC and 1 digital output without safety function, 24 VDC, 0.6 A and 1 device power supply, 24 VDC, 2 A 	

5 Dimensioning


5.1 CAD support

To ensure CAD support, the dimensions are included in the ECAD macros in 2D. STEP data is available to allow 3D viewing.


The STEP data can be downloaded from the B&R website (<u>www.br-automation.com</u>) in the Downloads section for the respective module.

5.2 Dimensions

X67 modules

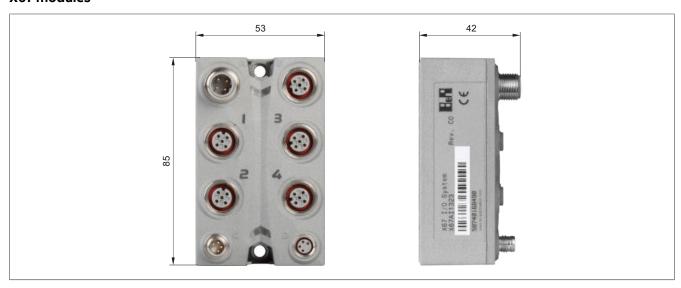

X67 high-density modules

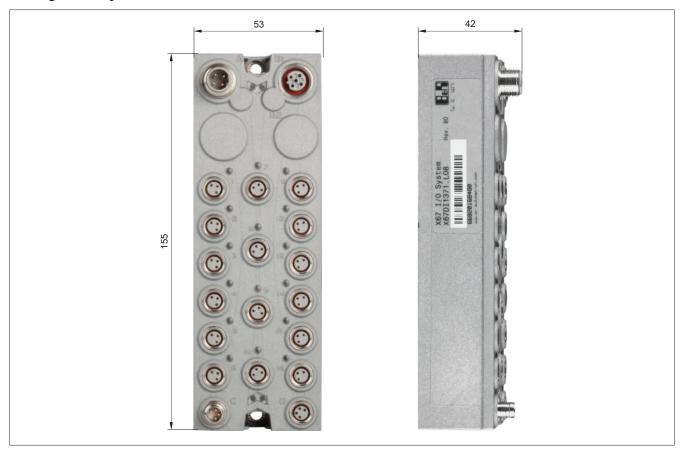

6 Installation and wiring

6.1 Installation

X67 modules can be installed in several different ways:

- "Installing on an aluminum frame" on page 33
- "Top-hat rail installation" on page 33
- "Installation on a mounting plate or directly on the machine" on page 34



Notice!

Since electromagnetic disturbances are deflected via the base plate on the back, it is important to ensure that the mounting location has good conductivity!

The mounting location must also be connected with ground potential with good conductivity.



Information:

The following must be taken into consideration to ensure IP67 protection:

- The union nuts on female/male connectors must be tightly secured with the specified tightening torque. The tightening torque value can be found in the module data sheet or the section "Connectors" on page 36.
- Female/Male connectors that are not being used must be closed with threaded caps!
 - Threaded caps M8, 50 pcs.: X67AC0M08
 - Threaded caps M12, 50 pcs.: X67AC0M12



Information:

Shock and vibration resistance values (see "International and national certifications" on page 104) apply only if cables are installed securely.

Attaching an X67 module

The thickness of the base plate (1.5 mm) should be taken into consideration when defining the screw length.

The grooved imprint in the base plate ensures that the screws do not become loose, even without an additional retaining ring.

The recommended tightening torque for the M4 screw is 0.6 Nm.


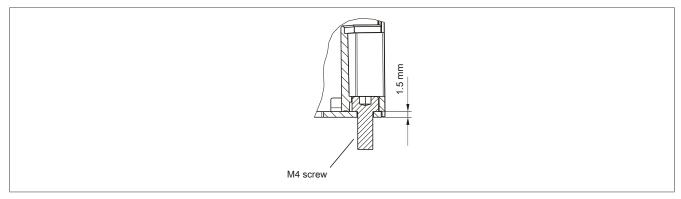


Figure 1: X67 system - Fastening an X67 module

6.1.1 Installing on an aluminum frame

Installation on an aluminum frame is done using 2 wedge nuts and M4 screws. Mounting plate X67ACM-P01/X67ACMPL1 must be used for installation outside the control cabinet. The mounting plate is placed between the module and aluminum frame and screwed to the aluminum frame together with the module.



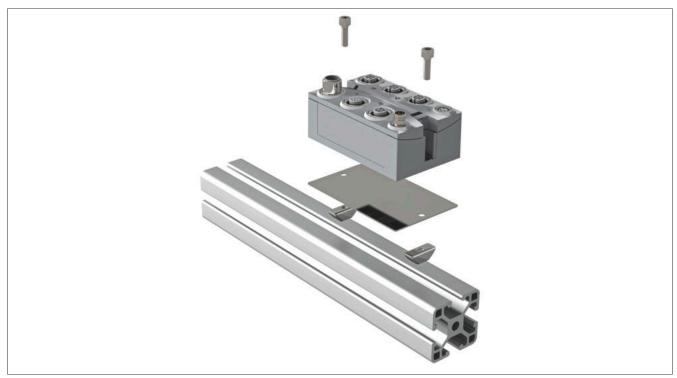


Notice!

For coated or anodized surfaces, the insulating coating or anodized layer in the area of the mounting plate of the X67 modules must be removed.

6.1.2 Top-hat rail installation

Top-hat rail mounting plate X67ACTS35 can be used to install an X67 module on a top-hat rail. Mounting plate X67ACMP01 must be used for installation outside the control cabinet. The mounting plate is placed between the module and top-hat rail mounting plate and screwed to the top-hat rail mounting plate together with the module.

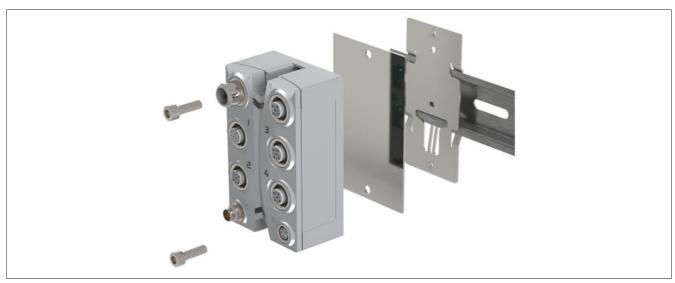

6.1.3 Installation on a mounting plate or directly on the machine


X67 modules can also be mounted on a mounting plate or directly on the machine. However, it must be ensured that the minimum bend radius of the connecting cables being used is not undershot when the modules are installed close together.

Example of invalid bend radius for tight installation



6.1.3.1 Drilling template for X67 modules

The modules are mounted using M4 screws.

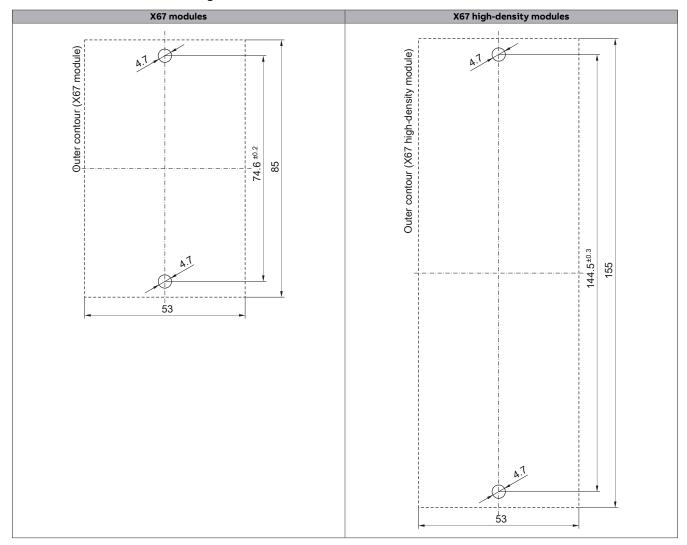

6.2 Lightning and surge protection



Information:

Lines at risk of lightning strikes must be fitted with suitable overvoltage protection.

The circuits must be limited to overvoltage category II per IEC 60664-1 or according to other information in the module data sheet.

For the design of your electrical system, see ABB documentation "Global guide to surge protection".

6.2.1 USA/Canada

Electrical installations must comply with the relevant requirements of the National Electrical Code® (ANSI/NFPA-70 (NEC®) and, where applicable, Canadian Electrical Code (CEC), CE Code, or CSA C22.1. This applies specifically to electrical communication lines that are routed outside of a building and are considered to be at risk of lightning strike (see ANSI/NFPA-70 (NEC®) 2020 Edition - Part III Protection 805.90 Protective Devices).

6.3 Shielding and grounding

When using standard cables available from B&R, the cable shield is brought into the X67 module via the connector (complete 360° shielding). Inside the X67 housing, all components including the base plate make contact with the same ground. The final link in the chain is the mounting screw, which connects the base plate and the machine part / mounting plate and completes the seamless ground contact from the cable to the machine part / mounting plate. A contact with good conductivity between the X67 module base plate and the machine part / mounting plate is absolutely required.

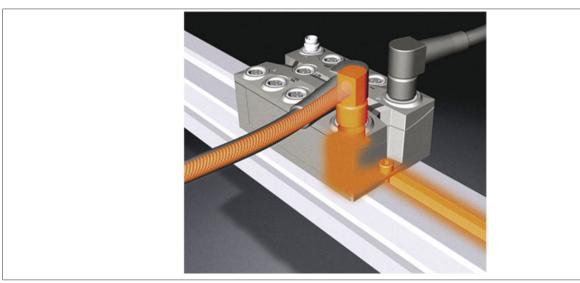


Figure 2: X67 system - Shielding and grounding



Notice!

The shielding at both ends of the cable must be professionally grounded on field-assembled cables!

6.4 Connectors

The connectors for the X67 system are designed as circular connectors. In addition to field-assembled male connectors, B&R also offers pre-assembled cables for X2X Link, fieldbus and I/O functions.

The following connectors are used with the X67 system:

Screw thread	Tightening torque
M8	0.4 Nm
M12	0.6 Nm
M16	1.0 Nm



Information:

When using third-party connectors, we strongly recommend ensuring that the contacts are gold (Au) coated.

B&R connectors are designed for use with X67 components (see "General overview" on page 61).

6.5 X67 system cabling

Due to the high degree of flexibility offered by the X67 system, a few things must be taken into consideration when wiring:

- Maximum number of X67 modules in one X2X line (253)
- · Maximum distance between X67 modules
- Distance between the system supply modules
- · Station number assignment
- Permissible current consumption
- · Corresponding bus termination
- Suitable connectors must be used for the X67 system (see section "Connectors" on page 36).

Possibilities for cabling the X67 system:

- X2X Link power supply with X67 system supply, X67 bus controller or X20 bus transmitter
- Isolated X2X Link and I/O power supply
- · Creating electrical potential groups

6.5.1 X2X Link cabling

X2X Link connections:

- X67 module: M12, B-keyed connections (A \rightarrow Input, B \rightarrow Output)
- Interface module / master system: 4-pin terminal block

The maximum distance between 2 X67 stations is 100 meters.



Information:


System supply module X67PS1300 cannot be used to bridge distances since it does not regenerate the signal.

Station numbers are automatically assigned according to the order of X67 modules (cable sequence).



Information:

All subsequent station numbers are shifted when an X67 station is connected/removed. The system supply module is not included in this calculation, however, and does not receive its own station number!

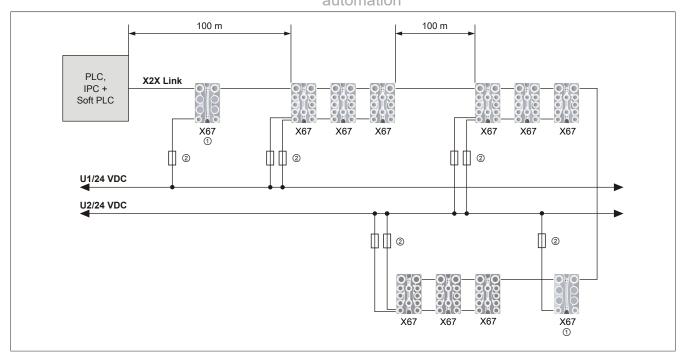

Legend

- 1 System supply module
- 2 Fuse, 4 A slow-blow

The supply voltage for the X2X Link is reduced by line resistance (line length).



Information:


Be aware of voltage drops in the line!

Depending on the power consumption and type of modules being used, 15 or more X67 modules can be supplied by system supply module X67PS1300. However, this does not mean that 100 m distance between each station is possible (i.e. a total length of n \times 100 m).



Information:


Regardless of the number of stations, the supply voltage is affected at total lengths over 100 m. Therefore, additional system supply modules must be added when necessary.

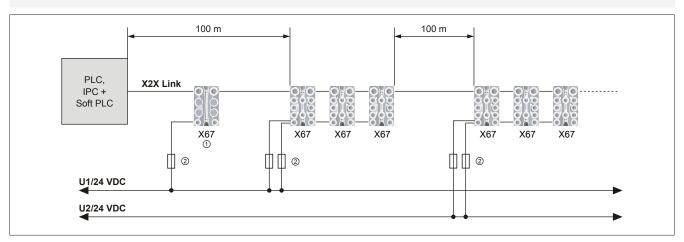

- 1 System supply module
- ② Fuse, 4 A slow-blow

Installation and wiring

All system supply modules integrated in an X67 system must be distributed accordingly along the length of the line to avoid excessive voltage drops caused by the line length!

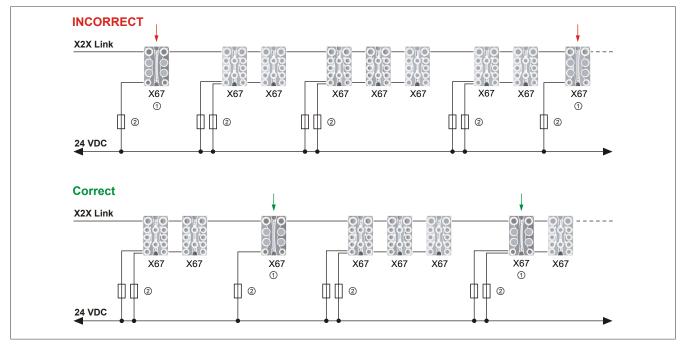

Legend

- ① System supply module
- ② Fuse, 4 A slow-blow



Information:

All system supply modules must be distributed evenly throughout the system!

6.5.2 X2X Link cabling on the bus controller

X2X Link connections:

- X67 module: M12, B-keyed connections (A \rightarrow Input, B \rightarrow Output)
- Bus controller: M12, B-keyed connection (B → Output)

Additional X67 stations can be connected without system supply module X67PS1300 depending on the power output of the bus controller.

The I/O image is made according to the order (cable sequence) of the X67 modules.



Information:

All subsequent I/O slots are shifted when an X67 station is connected/removed.

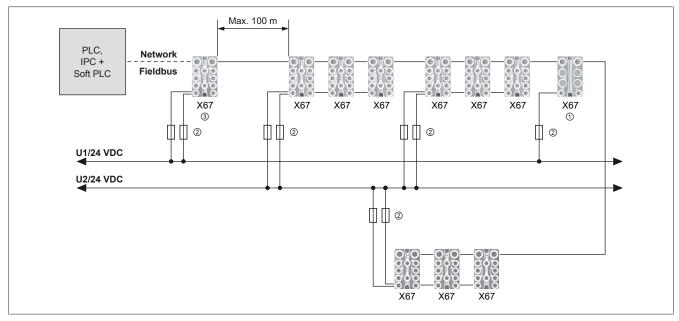


Figure 3: X2X Link cabling - Supply via bus controller

- ① System supply module
- ② Fuse, 4 A slow-blow
- 3 Bus controller

6.5.3 X2X Link cabling on bus transmitter X20BT9400

X2X Link connections:

- X67 module: M12, B-keyed connections (A → Input, B → Output)
- X20BT9400: X20 terminal block

Depending on the mounting orientation of the X20 system, 8 (horizontal installation) or 6 (vertical installation) X67 stations can be connected without system supply module X67PS1300.



Information:

All subsequent station numbers are shifted when an X67 station is connected/removed.

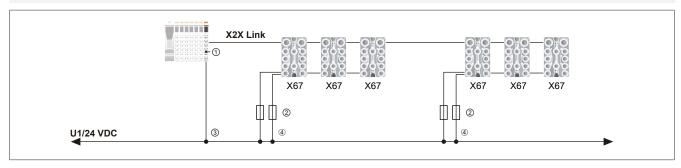


Figure 4: X2X Link cabling - Supply via bus transmitter X20BT9400

Legend

- ① X20 bus transmitter X20BT9400
- ② Fuse, 4 A slow-blow
- 3 X2X Link power supply
- 4 I/O power supply

If more than 8 or 6 X67 stations are connected to bus transmitter X20BT9400, then only the X67PS1300 system supply modules being used can be included when calculating the power requirements.

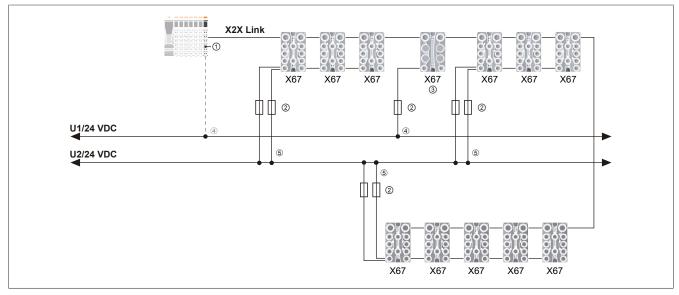


Figure 5: X2X Link cabling - Supply via X20 bus transmitter and X67 system supply

- ① X20 bus transmitter X20BT9400
- ② Fuse, 4 A slow-blow
- 3 System supply module
- **4** X2X Link power supply

6.5.4 I/O power supply cabling

X67 module power supply connectors1):

- I/O modules, system supply:
 Connections C (input) and D (routing) are equal (pins connected).
- Bus controller:
 Connection C: 1 pair for I/O power supply, 1 pair for X2X Link supply
 Connector D: Routing of I/O power supply

Permissible 1) current consumption

- I/O modules: 8 A (without temperature derating)
- Bus controller: 4 A (without temperature derating)

Without the I/O power supply, the application has no access to the data points (see section "Failure of I/O supply (ModuleOK)" on page 43)! Only the node number is secured by an intact X2X Link power supply. The must account for this accordingly if the I/O power supply is integrated in the emergency stop design (see section "The power supply concept" on page 42).

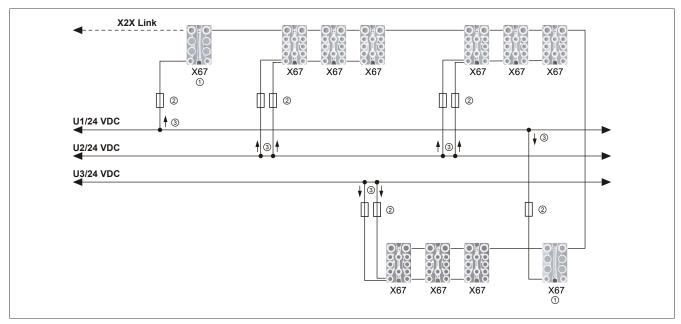


Figure 6: I/O power supply cabling - Isolated X2X Link and I/O power supply

- ① System supply module
- ② Fuse, 4 A slow-blow
- 3 Maximum 4 A

¹⁾ For exact or possibly deviating technical data, please refer to the documentation for the corresponding X67 module.

7 Mechanical and electrical configuration

7.1 The power supply concept



Danger!

Excessive electrical voltages irreparably damage the safety structures within the module.

In order to ensure a defined power supply, a SELV or PELV power supply unit per IEC 61010-2-201 must be used for the bus, SafelO and SafeLogic power supply. This also applies to all digital signal sources that are connected to the modules.

If the power supply is grounded (PELV system), then only a GND connection is permitted for grounding. Grounding types that have ground connected to +24 VDC are not permitted.

The external circuits to be connected to the SELV / PELV part of the device must be galvanically isolated from the power grid or dangerous voltage by reinforced or double insulation and must meet the requirements of the SELV / PELV circuit.



Notice!

Primary circuits from which the connected secondary voltages are generated must be limited to overvoltage category II and are permitted to have a maximum system voltage of 300 V.

All connected circuits must meet the requirements for SELV/PELV circuits (Class III) per UL/CSA/IEC 61010-1, 61010-2-201.

The X67's decentralized structure allows modules to be placed in different power supply groups as needed. This allows various modules to be connected to different voltage protection circuits or different emergency stop groups to be implemented.

The X2X Link network is operated totally independently of the I/O power supply. In addition to the communication lines, the connection cable contains 2 wires to supply power to the X2X Link electronics of each module. This is fully galvanically isolated from the I/O component. For this reason, power failures on the I/O side (e.g. due to short circuit, open circuit or emergency stop) only stop operation of the I/O section. The X2X Link network continues to work, and the corresponding status messages are sent to the controller. This allows fault events to be guickly analyzed and corrected.

The X2X Link power supply is guaranteed by system supply modules.

A potential group involves multiple X67 modules that are supplied via a shared supply feed.

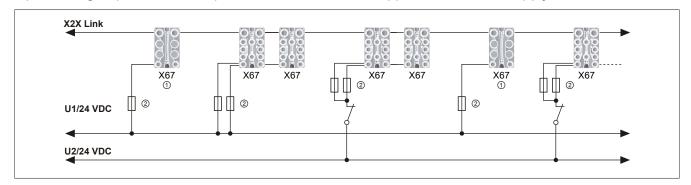


Figure 7: Power supply design with the help of 2 different potential groups

- System supply module
- ② Fuse, 4 A slow-blow

X67 I/O modules are power consumers on the X2X Link. System supply modules feed in the power. System supply modules should be planned according to the calculated power requirements. Since they supply voltage in both directions, they can be arranged either at the beginning or between the consumers. Redundant configurations are also possible by adding more system supply modules.

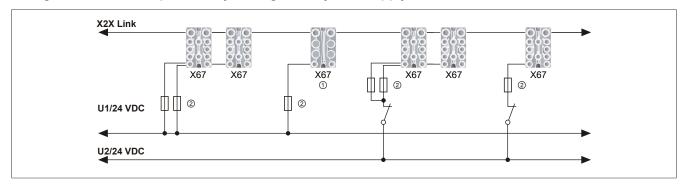


Figure 8: X2X Link power supply through flexible application of system supply modules

Legend

- ① System supply module
- ② Fuse, 4 A slow-blow

The bus controllers can supply several modules on the X2X Link without an additional system supply module.

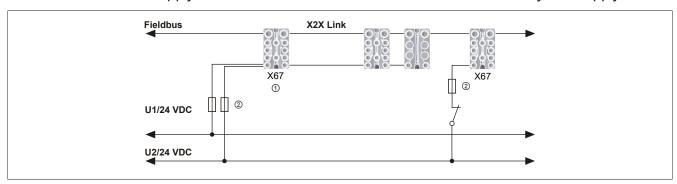


Figure 9: X2X Link power supply via bus controllers

Legend

- ① System supply module
- ② Fuse, 4 A slow-blow

7.1.1 Failure of I/O supply (ModuleOK)

Status "ModuleOK" consists of different module parameters and is available for monitoring the X67 modules. When the I/O supply voltage is lost, data point "ModuleOK" provides the value 0 (false).

7.2 Safe cutoff of a potential group



Information:

B&R keeps user's manuals as current as possible. From a safety standpoint however, the current certified version of the document must be used.

The current certified document is available for download under <u>Website > Downloads > Certificates > Safety technology > X20, X67 > Safe cutoff of potential groups.</u>

7.2.1 Description of function

The operating principle "Safe cutoff of a potential group" enables the user to execute safety-related functions within a B&R system in combination with an external safety relay.

The safety function is limited to cutting off or interrupting the power to connected actuators.

Functionality

An external safety relay is connected to the I/O power supply for the potential group or an X20SP1130 power supply module is used. When the functional safe state is requested or state "Failsafe" occurs, then this feed cuts off the I/O power supply of the potential group. The power is then also cut off for all actuators connected to this potential group. However, module-internal energy storage devices (e.g. capacitors) remain charged and must be taken into account in the assessment of the safety function.

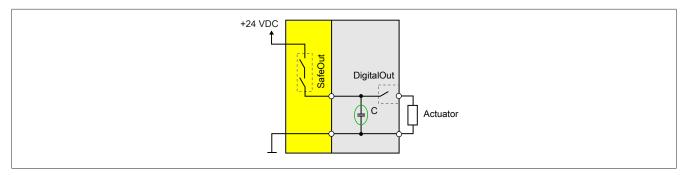


Figure 10: Functionality with internal energy storage

7.2.2 Scope of application / Standards referenced

The operating principle is confined to machine manufacturing applications and therefore implicitly to the following standards:

• ISO 13849-1:2023 or EN ISO 13849-2:2012

Requirements of other standards are not taken into consideration.

7.2.3 Intended use



Danger!

Danger from incorrect use of safety-related products/functions

Proper functionality is only ensured if the products/functions are used in accordance with their intended use by qualified personnel and the provided safety information is taken into account. The aforementioned conditions must be observed or covered by supplementary measures on your own responsibility in order to ensure the specified protective functions.

7.2.3.1 Qualified personnel

Use of safety-related products is restricted to the following persons:

- Qualified personnel who are familiar with relevant safety concepts for automation technology as well as applicable standards and regulations
- Qualified personnel who plan, develop, install and commission safety equipment in machines and systems

Qualified personnel in the context of this manual's safety guidelines are those who, because of their training, experience and instruction combined with their knowledge of relevant standards, regulations, accident prevention guidelines and operating conditions, are qualified to carry out essential tasks and recognize and avoid potentially dangerous situations.

In this regard, sufficient language skills are also required in order to be able to properly understand this manual.

7.2.3.2 Area of application

The safety-related B&R control components described in this manual were designed, developed and manufactured for special applications for machine and personnel protection. They are not suitable for any use involving serious risks or hazards that could result in the injury or death of several people or serious environmental impact without the implementation of exceptionally stringent safety precautions. In particular, this includes the use of these devices to monitor nuclear reactions in nuclear power plants, flight control systems, air traffic control, the control of mass transport vehicles, medical life support systems and the control of weapon systems.

When using safety-oriented control components, the safety precautions applying to industrial control systems (e.g. the provision of safety devices such as emergency stop circuits, etc.) must be observed in accordance with applicable national and international regulations. The same applies for all other devices connected to the system, e.g. drives or light curtains.

The safety guidelines, information about connection conditions (nameplate and documentation) and limit values specified in the technical data must be read carefully before installation and commissioning and must be strictly observed.

7.2.3.3 Cybersecurity disclaimer for products

B&R products communicate via a network interface and were developed for secure connection with internal and, if necessary, other networks such as the Internet.



Information:

In the following, B&R products are referred to as "product" and all types of networks (e.g. internal networks and the Internet) are referred to as "network".

It is the sole responsibility of the customer to establish and continuously ensure a secure connection between the product and the network. In addition, appropriate security measures must be implemented and maintained to protect the product and entire network from any security breaches, unauthorized access, interference, digital intrusion, data leakage and/or theft of data or information.

B&R Industrial Automation GmbH and its subsidiaries are not liable for damages and/or losses in connection with security breaches, unauthorized access, interference, digital intrusion, data leakage and/or theft of data or information.

The aforementioned appropriate security measures include, for example:

- Segmentation of the network (e.g. separation of the IT network from the control network¹⁾)
- · Use of firewalls
- Use of authentication mechanisms
- Encryption of data
- Use of anti-malware software

Before B&R Industrial Automation GmbH releases products or updates, they are subjected to appropriate functional testing. Independently of this, we recommend that our customers develop their own test processes in order to be able to check the effects of changes in advance. Such changes include, for example:

- · Installation of product updates
- · Significant system modifications such as configuration changes
- Deployment of updates or patches for third-party software (non-B&R software)
- Hardware replacement

These tests should ensure that implemented security measures remain effective and that systems in the customer's environment behave as expected.

¹⁾ The term "control network" refers to computer networks used to connect control systems. The control network can be divided into zones, and there can be several separate control networks within a company or site. The term "control systems" refers to all types of B&R products such as controllers (e.g. X20), HMI systems (e.g. Power Panel T30), process control systems (e.g. APROL) and supporting systems such as engineering workstations with Automation Studio.

7.2.3.4 Safety technology disclaimer

The proper use of all B&R products must be guaranteed by the customer through the implementation of suitable training, instruction and documentation measures. The guidelines set forth in system user's manuals must be taken into consideration here as well. B&R has no obligation to provide verification or warnings with regard to the customer's purpose of using the delivered product.

Changes to the devices are not permitted when using safety-related components. Only certified products are permitted to be used. Currently valid product versions in each case are listed in the corresponding certificates. Current certificates are available on the B&R website (www.br-automation.com) in the Downloads section for the respective product. The use of non-certified products or product versions is not permitted.

All relevant information regarding these safety products must be read in the latest version of the related data sheet and the corresponding safety notices observed before the safety products are permitted to be operated. Certified data sheets are available on the B&R website (www.br-automation.com) in the Downloads section for the respective product.

B&R and its employees are not liable for any damages or loss resulting from the incorrect use of these products. The same applies to misuse that may result from specifications or statements made by B&R in connection with sales, support or application activities. It is the sole responsibility of the user to check all specifications and statements made by B&R for proper application as it pertains to safety-related applications. In addition, the user assumes sole responsibility for the proper design of the safety function as it pertains to safety-related applications.

7.2.3.5 Installation notes for X67 safety modules



Danger!

The following points must be taken into account to ensure IP67 protection:

- The union nuts on female/male connectors must be tightly secured with the specified tightening torque. For the tightening torque, see the X67 system user's manual.
- Female/Male connectors that are not being used must be closed with threaded caps!
 - Threaded caps M8, 50 pcs.: X67AC0M08
 - Threaded caps M12, 50 pcs.: X67AC0M12



Danger!

The shock and vibration resistance values (see chapter "International and national certifications" in the X67 system user's manual) apply if cables are laid solidly.



Danger!

Excessive electrical voltages irreparably damage the safety structures within the module.

In order to ensure a defined power supply, a SELV or PELV power supply unit per IEC 61010-2-201 must be used for the bus, SafeIO and SafeLogic power supply. This also applies to all digital signal sources that are connected to the modules.

If the power supply is grounded (PELV system), then only a GND connection is permitted for grounding. Grounding types that have ground connected to +24 VDC are not permitted.

The external circuits to be connected to the SELV / PELV part of the device must be galvanically isolated from the power grid or dangerous voltage by reinforced or double insulation and must meet the requirements of the SELV / PELV circuit.

The power supply of X67 potential groups must generally be protected using a fuse with a maximum of 10 A. For additional information, see chapter "Mechanical and electrical configuration" in the X20 or X67 user's manual.

Module functionality is no longer guaranteed at voltages outside the range of the supply voltage or I/O voltage specified in the technical data.

Up to a voltage of 60 VDC (SELV power supply unit), it is ensured that no dangerous error occurs.



Danger!

Unused female connectors must be covered with threaded caps (X67AC0M08 or X67AC0M12 accessory). Otherwise, hazardous conditions may arise if the module fails to function properly.

7.2.3.6 Safe state

If an error is detected by the module (internal or wiring error), the modules enable the safe state. The safe state is structurally designed as a low state or cutoff and cannot be modified.

Applications in which the safe state must actively switch on an actuator cannot be implemented with this module. In these cases, other measures must be taken to meet this safety-related requirement (e.g. mechanical brakes for hanging load that engage on power failure).

The following limitations exist when using SafeMOTION modules:

- A SafeMOTION module basically corresponds to a safe node.²⁾ Additionally, each drive module equates to **one POWERLINK node**.
- The safe state is implemented in B&R safety modules by cutting off the output. This is a design feature of the modules and cannot be changed.
 - This is particularly important for SafeMOTION modules since the safe state cuts off the torque on the motor!



Danger!

After the safe state (STO) is enabled or in state FAIL SAFE, the drive is not supplied with power; the motor therefore no longer exerts torque or force.

If the motor was moving before STO is activated, it is only stopped by a safe motor holding brake (if available) or by the friction of the complete system!



Danger!

Situations involving external forces (e.g. suspended loads) can result in dangerous movements!

If this poses a safety risk, then the user must implement the necessary equipment to eliminate the risk (e.g. mechanical brakes)! This equipment must correspond to the required safety level!



Danger!

The safety response time must be taken into consideration since this has a substantial effect on the residual distances and remaining times to be considered!

In order to calculate the total safety response time, the user must validate the rundown time of the complete system! \cdot

7.2.4 System-specific information

The operating principle applies to a potential group.

All potential groups are generally only permitted to be supplied by 1 power supply module. The possible further processing of the power supply on the module is not permitted to result in multiple supply instances.

In the X20 system, only modules of type X20BM01, X20BM23 and X20BM26 that ensure the interruption of the internal I/O power supply to the left are permitted to be used as bus modules for power supply modules. On modules X20PS9400 and X20PS3300, only the I/O power supply (+24 V I/O) is permitted to be switched with the safety relay. The bus power supply (+24 V BC/X2X L.) must be isolated.

When using module X67PS1300 to supply power to the X67 potential group, only the I/O power supply (+24 V I/O) is permitted to be switched with the safety relay. The bus power supply (+24 V BC/X2X L.) must be isolated.

The operating principle is limited to the modules listed in the following certificate.



Certificate

Website > Downloads > Certificates > Safety technology > X20, X67 > Safe cutoff of potential groups

²⁾ ACOPOSmulti SafeMOTION inverter modules: A SafeMOTION module is integrated into a single-axis inverter module, i.e. **one safe node**. A 2-axis inverter module has two integrated SafeMOTION modules, i.e. **two safe nodes**.

7.2.5 Safety guidelines

This section provides a summary of safety notices for the user.



Danger!

Failure of the safety function due to misuse

Observe the following safety guidelines. Failure to observe any of the following notices can result in the failure of the safety function and may result in serious injury.

- When using the operating principle, it is the user's responsibility to adhere to the relevant standards and safety directives. In addition, the guidelines for proper use must be observed.
- For all potentials supplying the modules, SELV/PELV power supplies must be used.
- The potential groups for which the operating principle is applied are only permitted to contain modules listed from certificate "Safe cutoff of potential groups".
- Uncoated X20 modules in which the operating principle is used are not permitted to be operated in condensing air humidity or at temperatures below 0°C.
- It is not permitted to mix modules from different systems (X20, X67, 7XV) within a potential group.
- It is not permitted to install multiple power supplies in a potential group (particularly with regard to power supply modules that also supply the bus supply).
- Ensure that the upstream safety relay is wired properly.
- Ensure that ALL sensors and actuators connected to the potential group are wired properly.
- Note possible impairments of the safety function due to the internal energy storage devices. If this is sufficient to enable a connected actuator and subsequently results in a dangerous state, the protection objective is not given and alternatives or supplementary measures must be installed.
- The switch-off time must be verified by a control measurement!
- For modules with isolated I/O potential for sensors and actuators, the upstream safety relay must shut off the supply for both the sensors and actuators.
- The ground connections should be used as functional ground and not as protective ground and must not be connected to the 24 V supply voltage (GND is permitted). In addition, no protective components are permitted to be used between the ground and the 24 V supply voltage.

7.2.5.1 Capacitances within the potential group

The module-internal capacitances remain charged at the time of shutdown. The total capacitance of the potential group results from the sum of the capacitances of the individual modules, upstream external safety relay and actuator.

$$C_{total} = \sum_{i=1}^{n} C_i$$

The capacitances of the corresponding B&R modules are listed in the certificate.



Certificate

Website > Downloads > Certificates > Safety technology > X20, X67 > Safe cutoff of potential groups

At the time a safety function is requested, it is not ensured that the standard outputs are enabled. If an output is disabled at the time of the request, the affected module-internal capacitances remain permanently charged. If the output is enabled by the standard application, an unexpected voltage peak occurs on the output.

In connection with the supply voltage, the total capacitance present in the system results in a charge that must be taken into account during cutoff. In the worst case scenario, it can be assumed that the total capacitance present in the system buffers each output present in the potential group. This behavior is not permitted to result in a safety-critical state due to actuators in the potential group; alternatives or supplementary corrective measures must be installed.

7.2.5.2 Potential group structure

The potential group is only permitted to be made up of modules listed in the following certificate. Modules not listed in this certificate endanger the "absence of feedback" of the external cutoff and therefore the safety function.



Certificate

Website > Downloads > Certificates > Safety technology > X20, X67 > Safe cutoff of potential groups

To ensure clarity and that the external cutoff is triggered when a fault occurs, installing multiple power supply sources in a potential group is not permitted.

SELV/PELV power supplies must be used for both the bus supply (X2X) and the I/O power supply; otherwise, safety-related malfunctions can occur due to overvoltages.

For modules with isolated I/O potential for sensors and actuators, the upstream safety relay must shut off the supply for both the sensors and actuators; otherwise, feedback cannot be excluded.

7.2.5.3 Circuit examples

Single-channel without feedback

The following example shows a load being cutoff using the emergency stop safety function. Only safe actuators such as motors or input "Enable" of an ACOPOS/ACOPOSmulti drive are permitted to be used as the load in this case.

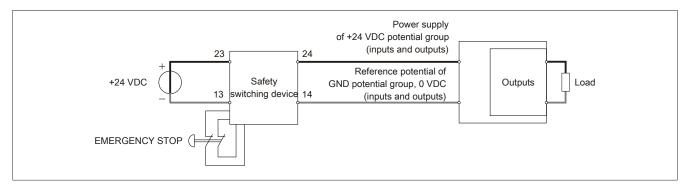


Figure 11: Circuit example: 1-channel without feedback

Provided that the external components being used (emergency stop switch, safety relay, load) satisfy the respective requirements, this example can achieve PL e (performance level as specified in EN ISO 13849-1:2015).

Dual-channel with feedback

The following example shows a load being cutoff using the emergency stop safety function. Feedback allows errors in the actuator to also be detected, and a cutoff is also possible if a fault event occurs due to the full dual-channel design. Whether or not 2 fully isolated potential groups – as shown in the example – are necessary depends on the application and how the safety solution is designed.

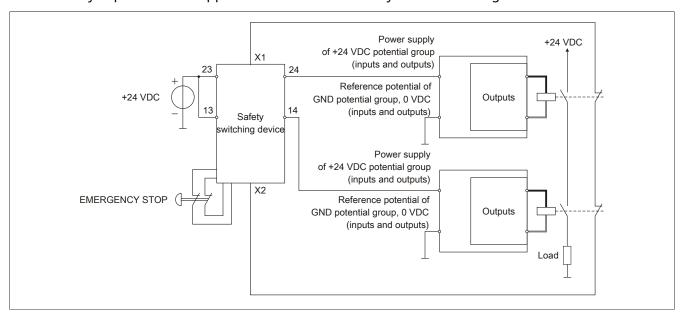


Figure 12: Circuit example: 2-channel with feedback

Provided that the external components being used (emergency stop switch, safety relay, load) satisfy the respective requirements, this example can achieve PL e.

Example with power supply module X20SP1130

The following examples show a load being cut off using safe power supply module X20SP1130 along with safe input module X20SI4100 and the "emergency stop" safety function.

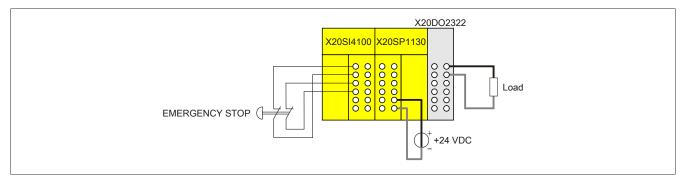


Figure 13: Circuit example with power supply module X20SP1130

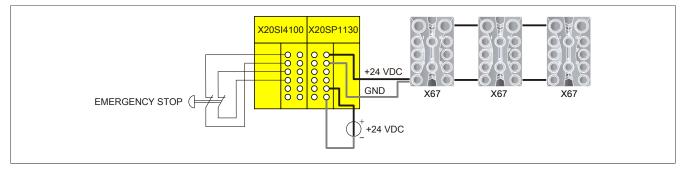


Figure 14: Circuit example with power supply module X20SP1130 and X67

Provided that the external components being used (emergency stop switch, load) satisfy the respective requirements, these examples can achieve PL e.

Mechanical and electrical configuration

7.2.5.4 Wiring information

The operating principle "Safe cutoff of a potential group" only applies to the B&R modules being used. All other parts of the safety chain such as the application, upstream sensors or downstream actuators are NOT included in this principle.

For this reason, it is important to take the following points into account:

- Ensure proper wiring of the safety relays with the I/O supply. A short circuit between the output of the safety relay and an external 24 V voltage source can cause an unintended supply of 24 V to the internal supply voltage of the potential group. As a result, the safety function can no longer be ensured, i.e. **ALL** channels of the potential group can no longer be switched off by the upstream safety relay.
- Ensure proper wiring of **ALL** input and output channels of the potential group and the connected sensors or actuators. A short circuit between an input or output of the potential group and an external 24 V voltage source can cause the unintended feedback of 24 V to the internal supply voltage of the potential group. As a result, the safety function can no longer be ensured, i.e. **ALL** output channels of the potential group can no longer be switched off by the upstream safety relay.
- In accordance with EN ISO 13849-2:2012, appendix D.2, table D.4, a short circuit between any 2 conductors can be excluded, provided that:
 - They are permanently installed and protected against external damage (e.g. using a cable duct or armored conduit)
 - ° OR they are in separate plastic-sheathed cables
 - OR they are installed within an electrical enclosure. This requires that the lines as well as the area for electrical equipment meet the respective requirements [see EN 60204-1]
 - ° OR they are individually shielded with a ground connection.


7.3 Combining X2X Link systems

The X2X Link provides a complete remote backplane, which is used for communicating between bus modules and over the X2X Link cable. Systems based on X2X Link can be combined with one another as needed.


7.3.1 Connection overviews

The following connection overviews illustrate combinations of different systems that are based on X2X Link. The model numbers indicate which standard cables available from B&R can be used to connect with one another.

Combining X20, X67 and compact I/O system

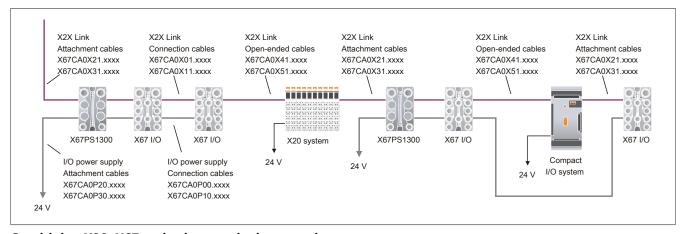


Combining X20, X67 and valve terminal connections

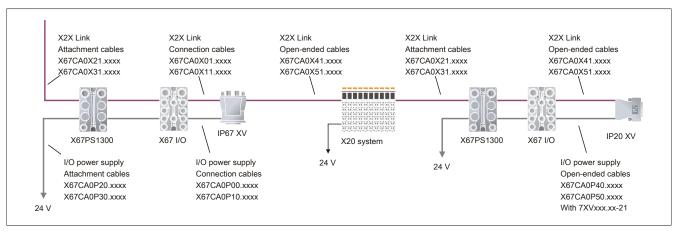

7.3.2 Connection examples


7.3.2.1 X20 system

Connection example with bus receiver X20BR9300

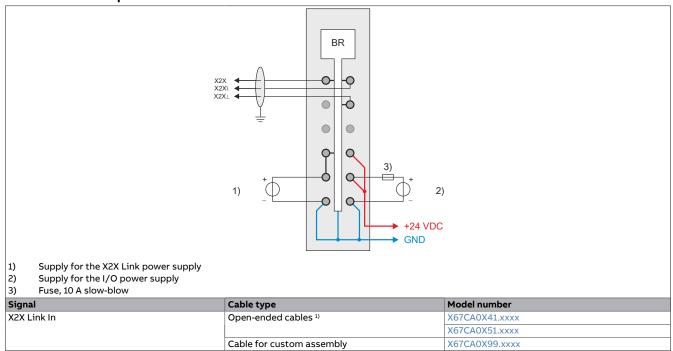


1) In connection with X67 modules.

Connection example with bus transmitter X20BT9100

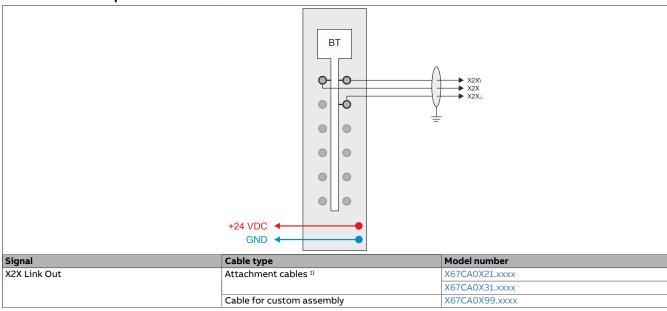


1) In connection with X67 modules.

Connection example with bus transmitter X20BT9400

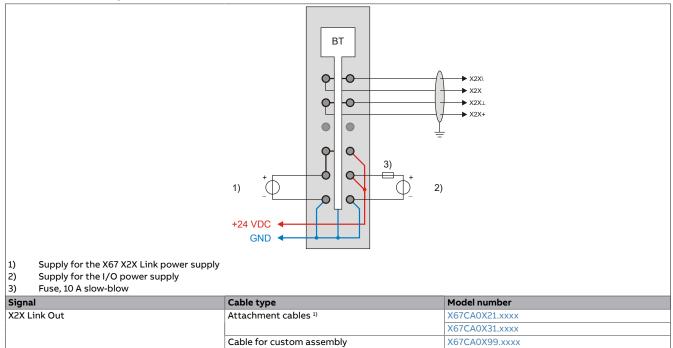

1) In connection with X67 modules.


7.3.2.2 Compact I/O system

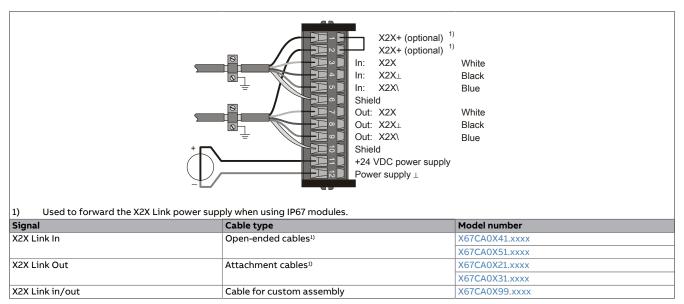


¹⁾ Bridge for X2X+ in connection with X67 modules.

7.3.2.3 Valve connection

Connection example with 7XVxxx.xx-11/-12

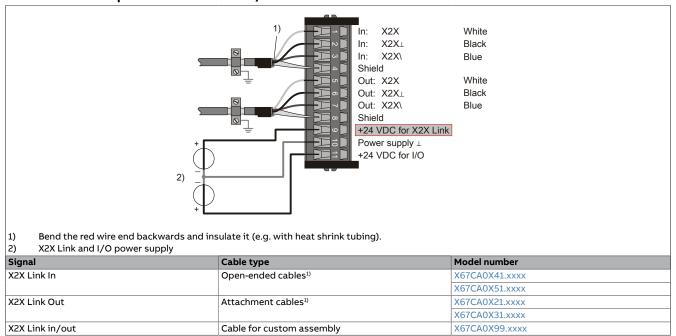


¹⁾ In connection with X67 modules.

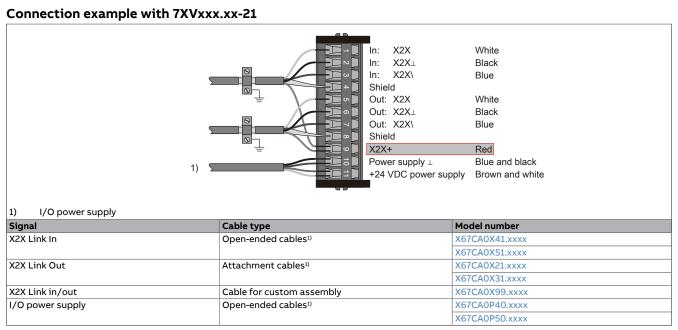

¹⁾ In connection with X67 modules.

Connection example with 7XVxxx.xx-51/-62

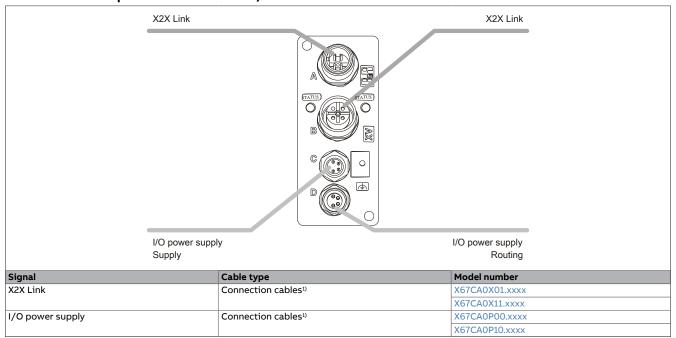

1) In connection with X67 modules.

7.3.2.4 Connection of X2X Link interfaces with internal power supply




Information:

Power is supplied to the X2X Link network via the red wire. Power is supplied to the X2X Link network internally on the IF789 or LS189. An external power supply is therefore not needed.

In order to prevent short circuits on the housing, braided shield or cable shield, the red wire end must be insulated, e.g. using a heat shrink tubing.

To improve EMC immunity, the cable shield must be grounded on both sides. The supply line to the IF789 and LS189 should be grounded over a wide area close to the shield. The grounding on the X67 side is done via the connector on pre-assembled cables.

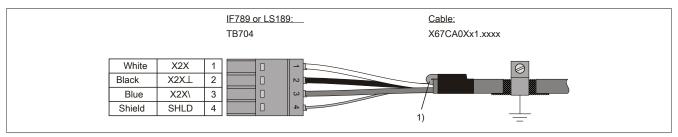

1) Bend the red wire end backwards and insulate it, e.g. with heat shrink tubing.



Information:


If the cable shield is not grounded, transmission errors may occur when strong electromagnetic interference occurs.

7.4 Calculating the power requirements

The power provided by the bus controllers and system supply modules is shown with a "+" sign. The power required by modules is shown with a "-" sign. To calculate the power requirements, the positive and negative power values must be added together. The sum is not permitted to be less than zero.

7.4.1 Example 1


Calculation of the X2X Link power requirements and the module power required internally on the basis of the given hardware configuration. The X2X Link power requirements are balanced. X67PS1300 is not necessary. The internal module power consumption and the sensor/actuator power supply must come from the external power supply.



Module	X2X Link performance [W]	Internal module power [W]
X67BC7321-1	+3.00	10.30
X67DM1321	-0.75	2.50
X67DM1321	-0.75	2.50
X67DI1371	-0.75	1.00
Total	+0.75	+16.30

7.4.2 Example 2

Calculation of the X2X Link power requirements and the module power required internally on the basis of the given hardware configuration. The X2X Link power requirements calculation produces a surplus of +11,25 W. Therefore, one X67PS1300 is sufficient. The internal module power consumption and the sensor/actuator power supply must come from the external power supply.



Module	X2X Link performance [W]	Internal module power [W]
X67AM1223	-0.75	3.00
X67AM1223	-0.75	3.00
X67PS1300	+15.00	3.00 +
		15.00
X67DM1321	-0.75	2.50
X67DO1332	-0.75	2.00
X67AT1322	-0.75	1.50
Total	+11.25	+30.00

8 Accessories

8.1 General overview

B&R offers pre-assembled cables, connectors and other accessories for the various connections on X67 modules.




Information:

The color of the wires used in field-assembled cables may deviate from the standard. Make sure to check the proper pinout.


Additional information about the various cables can be found in the respective documentation (see "Pre-assembled cables" on page 64) or the pinouts in the respective data sheets.

The following overview shows all available accessories for each connector or fieldbus.

8.1.1 X2X Link and I/O power supply

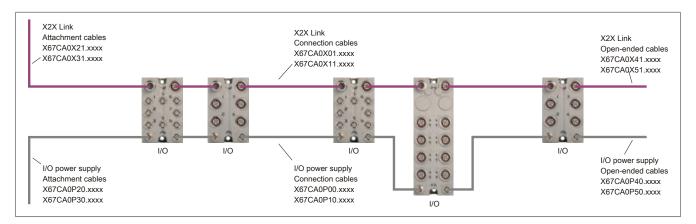


X2X Link

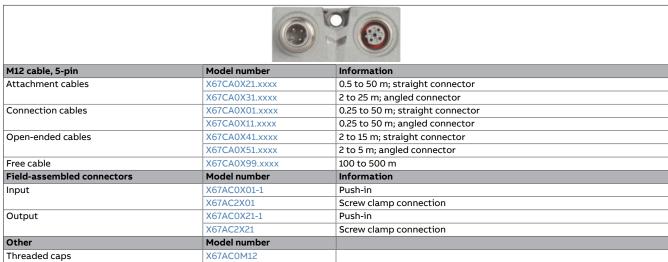

Accessories

I/O power supply

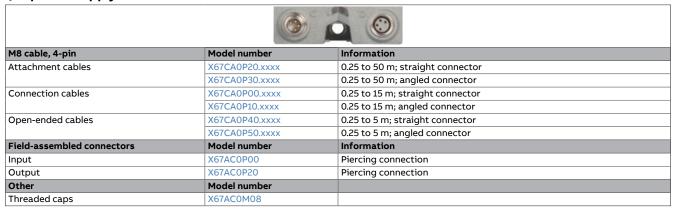


8.1.2 Module connections


M8. 3-pin: Digital inputs/outputs

M8 cable, 3-pin	cable, 3-pin Model number Information					
Attachment cables	X67CA0D40.xxxx	2 to 20 m; straight connector				
	X67CA0D50.xxxx	2 to 20 m; angled connector				
Male connector	Model number	Information				
Input	X67AC0D00	Piercing connection				
Other	Model number					
Threaded caps	X67AC0M08					

M12, 5-pin; Analog and digital inputs and outputs, motor, communication

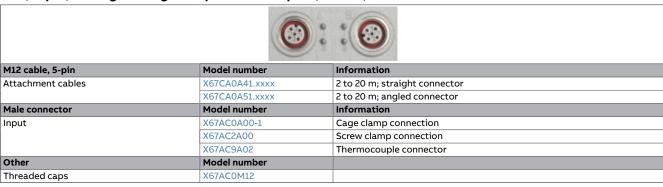


M12, 12-pin; counter, encoder

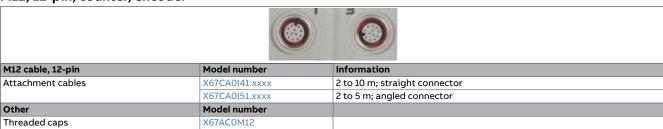


8.1.3 Fieldbus systems

CAN bus / DeviceNet

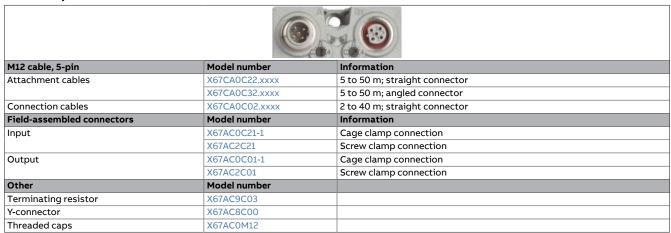

PROFIBUS DP

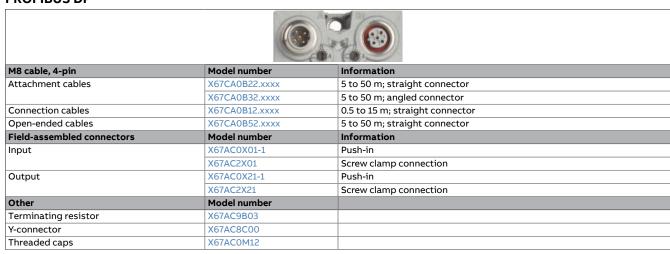

POWERLINK



8.2 Pre-assembled cables

8.2.1 X2X Link cables

	Short description, model number							
Length 0.25 m	X2X Link con	nection cable	X2X Link atta	chment cable	X2X Link open-ended cables			
	X67CA0X01.0002	X67CA0X11.0002						
0.3 m	X67CA0X01.0003							
0.5 m	X67CA0X01.0005	X67CA0X11.0005	X67CA0X21.0005					
1 m	X67CA0X01.0010	X67CA0X11.0010	X67CA0X21.0010		X67CA0X41.0010			
2 m	X67CA0X01.0020	X67CA0X11.0020		X67CA0X31.0020	X67CA0X41.0020	X67CA0X51.0020		
5 m	X67CA0X01.0050	X67CA0X11.0050	X67CA0X21.0050	X67CA0X31.0050	X67CA0X41.0050	X67CA0X51.0050		
10 m	X67CA0X01.0100	X67CA0X11.0100		X67CA0X31.0100	X67CA0X41.0100			
15 m	X67CA0X01.0150	X67CA0X11.0150	X67CA0X21.0150	X67CA0X31.0150				
20 m			X67CA0X21.0200					
25 m	X67CA0X01.0250	X67CA0X11.0250						
50 m	X67CA0X01.0500	X67CA0X11.0500	X67CA0X21.0500	X67CA0X31.0500				
	and the same of th							

1) Standard length = 0.2 m.

Length	Tolerances for cable lengths
0 to <1 m	+2 cm
1 m to <10 m	+5 cm
10 m to xx m	+10 cm

	Short description, model number	
Length	X2X Link cable for custom assembly	
100 m	X67CA0X99.1000	
500 m	X67CA0X99.5000	


8.2.1.1 Technical data

Product ID	X67CA0X01	X67CA0X11	X67CA0X21	X67CA0X31	X67CA0X41	X67CA0X51	X67CA0X99.1000	
General information								
Note				Halogen-free				
Durability	Flame-retardant							
Connection	M12, 4-pin, straight	M12, 4- pin, angled	M12, 4-pin, straight	M12, 4- pin, angled	M12, 4-pin, straight	M12, 4- pin, angled	-	
Туре		ion cable						
Cable cross section								
Data lines								
AWG				2x 24 AWG				
mm²		2x 0.25 mm²						
Power supply lines								
AWG				2x 22 AWG				
mm²				2x 0.34 mm²				
Cable construction								
Signal line							_	
Shield			Pair shi	elding with alum	inum foil			
Stranding				Twisted-pair wire				
Cable stranding				nm² (22 AWG) wit			_	
Cable shield				per braiding, cov				
Outer jacket				,	9			
Material			Thermor	olastic polyureth	ane (TPII)			
Color			memor	Violet	ane (11 0)			
Wires				Violet				
Type			т	inned copper ET	R1			
Турс				e stranded wire				
				ne stranded wire				
Wire colors								
Data lines				Blue, white				
Power supply lines				Red, black				
Wire insulation				· · · · · · · · · · · · · · · · · · ·				
Data lines			Ce	ell polyethylene (I	PE)			
Power supply lines			ı	Polypropylene (PI	P)			
Electrical properties								
Rated voltage				250 V				
Nominal current			Max	4 A / Contact at	40°C			
Operating voltage				Max. 250 V				
Degree of insulation			Cate	gory II per IEC 61	.076-2			
Conductor resistance			D	ata line: ≤78 Ω/k	m			
			Su	ipply line: ≤55 Ω/	km			
Insulation resistance				≥100 MΩ				
Operating conditions								
Degree of protection per EN 60529								
Connector/Coupling			IP67	only when screw	ved in			
Ambient conditions								
Temperature								
Transport				-40 to 80°C				
Fixed installation				-40 to 80°C				
Flexible installation ¹⁾				-25 to 60°C				
Mechanical properties								
Dimensions								
Length	Various							
Diameter				6.9 mm ±0.3 mm	1			
Bend radius								
Fixed installation			2	5x outer diamet	er			
Flexible installation			≥	15x outer diamet	er			
Drag chain data								
Acceleration				Max. 4 m/s ²				
Flex cycles				Min. 2 million				
Velocity				Max. 3 m/s				
Weight		-		0.063 kg/m				
								

Table 2: X67CA0Xxx - Technical data


1) In cable drag chain operation

8.2.1.2 X67CA0X01.xxxx

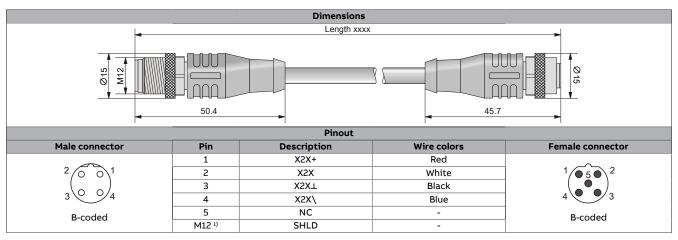


1) Shielding 360° around M12 knurled-head screw.

8.2.1.3 X67CA0X11.xxxx

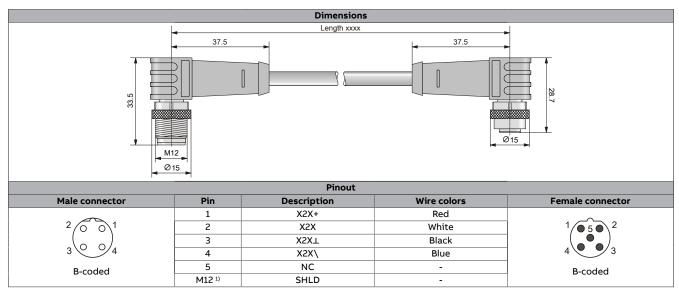

1) Shielding 360° around M12 knurled-head screw.

8.2.1.4 X67CA0X21.xxxx

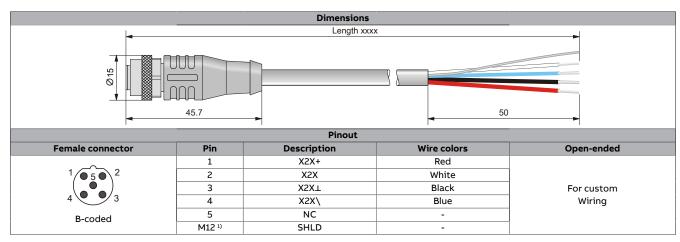


1) Shielding 360° around M12 knurled-head screw.



Information:

See note in section "Connection of X2X Link interfaces with internal power supply" on page 59.

8.2.1.5 X67CA0X31.xxxx

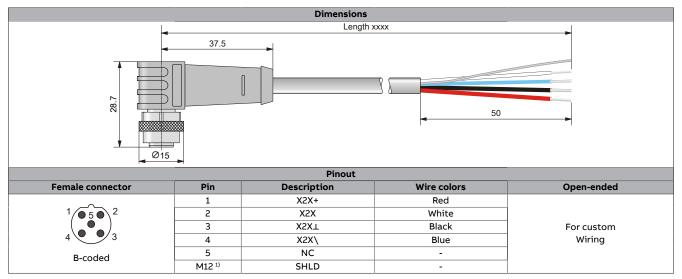


1) Shielding 360° around M12 knurled-head screw.



Information:

See note in section "Connection of X2X Link interfaces with internal power supply" on page 59.

8.2.1.6 X67CA0X41.xxxx

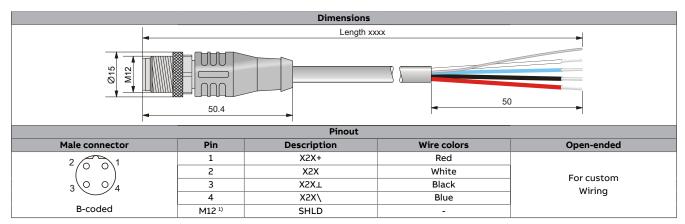


1) Shielding 360° around M12 knurled-head screw.



Information:

See note in section "Connection of X2X Link interfaces with internal power supply" on page 59.

8.2.1.7 X67CA0X51.xxxx

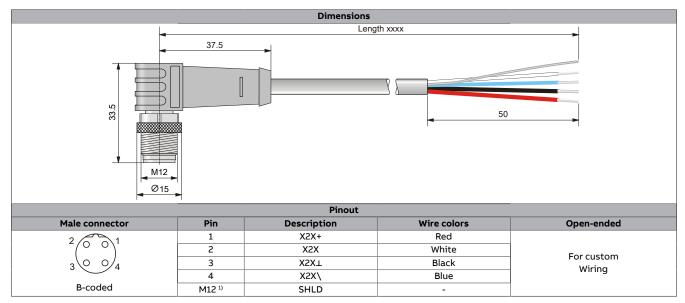


1) Shielding 360° around M12 knurled-head screw.



Information:

See note in section "Connection of X2X Link interfaces with internal power supply" on page 59.

8.2.1.8 X67CA0X99.xxxx

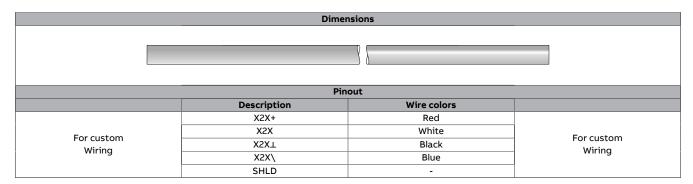

8.2.2 I/O power supply cables

		Short description, order number							
Length	Power conn	ection cable	Power attac	hment cable	Power open	-ended cable			
0.25 m ¹	X67CA0P00.0002	X67CA0P10.0002	X67CA0P20.0002	X67CA0P30.0002	X67CA0P40.0002	X67CA0P50.0002			
0.5 m	X67CA0P00.0005	X67CA0P10.0005							
1 m	X67CA0P00.0010	X67CA0P10.0010	X67CA0P20.0010						
1.5 m	X67CA0P00.0015								
2 m	X67CA0P00.0020	X67CA0P10.0020		X67CA0P30.0020	X67CA0P40.0020	X67CA0P50.0020			
5 m	X67CA0P00.0050	X67CA0P10.0050	X67CA0P20.0050	X67CA0P30.0050	X67CA0P40.0050	X67CA0P50.0050			
10 m	X67CA0P00.0100	X67CA0P10.0100	X67CA0P20.0100	X67CA0P30.0100					
15 m	X67CA0P00.0150	X67CA0P10.0150	X67CA0P20.0150	X67CA0P30.0150					
20 m	X67CA0P00.0200		X67CA0P20.0200	X67CA0P30.0200					
25 m			X67CA0P20.0250						
30 m	X67CA0P00.0300								
50 m			X67CA0P20.0500	X67CA0P30.0500					

1 Standard length = 0.2 m.

Length	Tolerances for cable lengths
0 to <1 m	+2 cm
1 m to <10 m	+5 cm
10 m to xx m	+10 cm

Accessories


8.2.2.1 Technical data

Product ID	X67CA0P00	X67CA0P10	X67CA0P20	X67CA0P30	X67CA0P40	X67CA0P50		
General information								
Note	PVC- and silicone-free							
	LABS- (PWIS-) and halogen-free							
Durability	Good chemical and oil resistance							
	Flame resistant							
	140 4 1	Good UV and ozone resistance						
Connection	M8, 4-pin, straight	M8, 4-pin, angled	M8, 4-pin, straight	M8, 4-pin, angled	M8, 4-pin, straight	M8, 4-pin, angled		
Туре		ion cables		lent cables		ded cables		
Cable cross section	Connect	Connection cables Attachment cables Open-ended cable						
AWG		4x 20 AWG						
mm²				5 mm²				
Cable construction			+7 0.	3 111111				
Complete shielding			Not s	hielded				
Outer sheathing			14003	melaca				
Material			Polyuret	hane (PUR)				
Color				lack				
Lines				iuck				
Wire insulation			Polypropy	lene (PP) 9Y				
Wire colors				ck, blue, white				
Type				copper ETP1				
Туре		Fine str		1 mm / 42x 38 AWG)	. class 6			
Stranding				tranded	,	_		
Electrical characteristics								
Nominal current		Max.	4 A in accordance	with EN / contact at	: 40°C	_		
				nce with UL / contac				
Operating voltage		_	Max	c. 60 V				
Degree of insulation		Ca	ategory II in accord	dance with IEC 61076	5-2			
Conductor resistance		_	≤57	Ω/km				
Insulation resistance			≥10	0 ΜΩ				
Operating conditions								
EN 60529 protection								
Connector/Coupling			IP67, only wh	nen screwed in				
Environmental conditions								
Temperature								
Transport			-40 t	o 90°C				
Fixed installation			-30 t	o 90°C				
Flexible installation ¹⁾	-25 to 60°C							
Mechanical characteristics								
Dimensions								
Length				rious				
Diameter				±0.2 mm				
Bend radius			≥10x out	er diameter				
Drag chain data								
Acceleration				5 m/s ²				
Flex cycles	5 million							
Velocity		Max. 3.3 m/s						


Table 3: X67CA0Pxx - Technical data

1) In cable drag chain operation.


8.2.2.2 X67CA0P00.xxxx

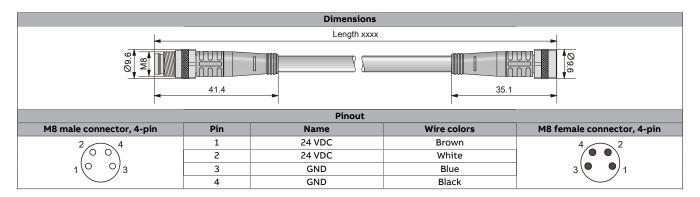

8.2.2.3 X67CA0P10.xxxx

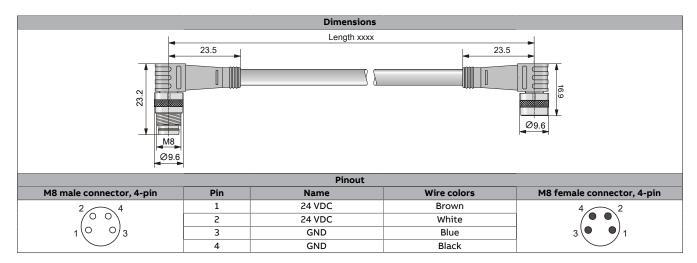

8.2.2.4 X67CA0P20.xxxx

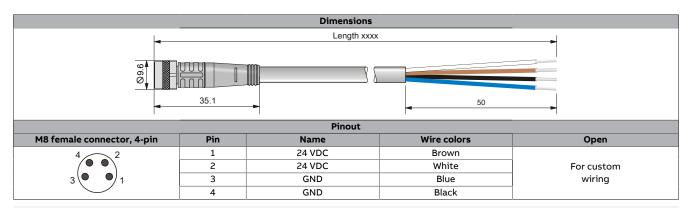




Information:

Both wires must be used since the current load is split.

8.2.2.5 X67CA0P30.xxxx

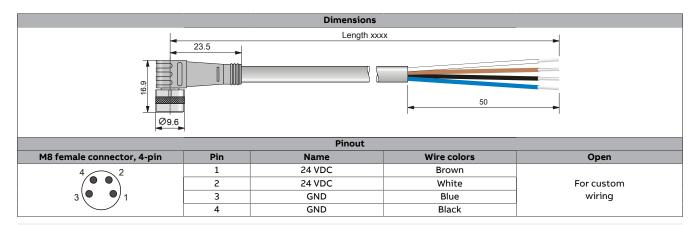




Information:

Both wires must be used since the current load is split.

8.2.2.6 X67CA0P40.xxxx

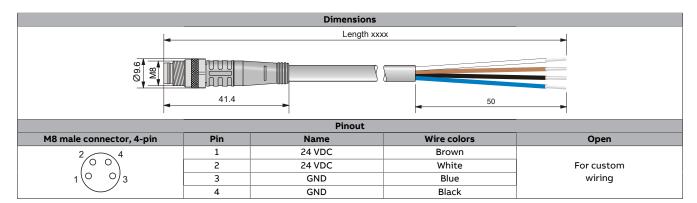




Information:

Both wires must be used since the current load is split.

8.2.2.7 X67CA0P50.xxxx

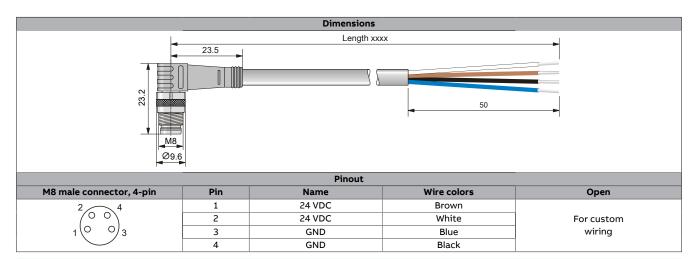



Information:

Both wires must be used since the current load is split.

8.2.3 M8 sensor cables

	Short	description
Length	M8 se	nsor cables
2 m	X67CA0D40.0020	X67CA0D50.0020
5 m	X67CA0D40.0050	X67CA0D50.0050
10 m	X67CA0D40.0100	X67CA0D50.0100
15 m	X67CA0D40.0150	X67CA0D50.0150
20 m	X67CA0D40.0200	X67CA0D50.0200

Length	Tolerances for cable lengths
0 to <1 m	+2 cm
1 m to <10 m	+5 cm
10 m to xx m	+10 cm

Accessories


8.2.3.1 Technical data

Product ID	X67CA0D40	X67CA0D50
General information		_
Note	PVC- ar	nd silicone-free
	PWIS- and halogen-free	
Durability		cal and oil resistance
		ne-retardant
		nd ozone resistance
Connection	M8, 3-pin, straight	M8, 3-pin, angled
Type	Attac	chment cable
Cable cross section		22 1140
AWG		x 22 AWG
mm²	3x	3 0.34 mm²
Cable construction	N	
Cable shield	NC	ot shielded
Outer jacket Material	Dohau	rethane (PUR)
Color	Polyui	
Wires		Gray
Wire insulation	Dolume	opylene (PP) 9Y
Wire colors		n, black, blue
Type		ed copper ETP1
Туре		x 0.1 mm / 42x 38 AWG), class 5
Stranding	3 wires, stranded	
Electrical properties		
Nominal current	Max. 4 A / Contact at 40°C	
Operating voltage	Max. 60 V	
Degree of insulation	Category II per IEC 61076-2	
Conductor resistance	≤	:57 Ω/km
Insulation resistance	2	≥100 MΩ
Operating conditions		
Degree of protection per EN 60529		
Connector/Coupling	IP67, only	when screwed in
Ambient conditions		
Temperature		
Transport		10 to 90°C
Fixed installation		30 to 90°C
Flexible installation ¹⁾	-2	25 to 60°C
Mechanical properties		
Dimensions		
Length	Various	
Diameter	4.3 mm ±0.2 mm	
Bend radius	≥10x o	outer diameter
Drag chain data		
Acceleration	Max. 5 m/s²	
Flex cycles	5 million	
Velocity	Max. 3.3 m/s	


Table 4: X67CA0Dxx - Technical data

1) In cable drag chain operation

8.2.3.2 X67CA0D40.xxxx

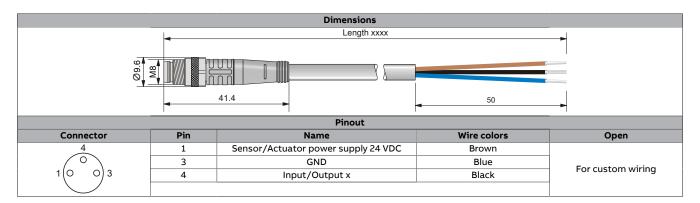

8.2.3.3 X67CA0D50.xxxx

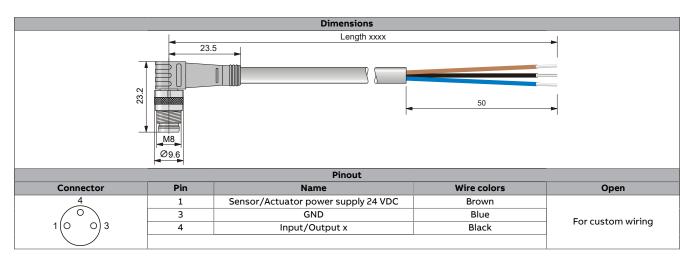

8.2.4 M12 sensor cables

	Short description		
Length	M12 sens	sor cables	
2 m	X67CA0A41.0020	X67CA0A51.0020	
5 m	X67CA0A41.0050	X67CA0A51.0050	
10 m	X67CA0A41.0100	X67CA0A51.0100	
15 m	X67CA0A41.0150	X67CA0A51.0150	
20 m	X67CA0A41.0200	X67CA0A51.0200	

Length	Tolerances for cable lengths	
0 to <1 m	+2 cm	
1 m to <10 m	+5 cm	
10 m to xx m	+10 cm	


8.2.4.1 Technical data

Product ID	X67CA0A41	X67CA0A51
General information		
Note PVC- and silicone-free		
	PWIS- and halogen-free	
Durability	Good chemical a	and oil resistance
		etardant
		zone resistance
Connection	M12, 5-pin, straight	M12, 5-pin, angled
Туре	Attachm	ent cable
Cable cross section		
AWG		2 AWG
mm²	5x 0.3	4 mm²
Cable construction		
Cable shield	Tinned copper braiding, cove	rage 84%, 0.25 mm² with filler
Outer jacket		
Material	Polyuretha	ne (PUR) UL
Color	Gi	ray
Wires		
Wire insulation	7	ene (PP) 9Y
Wire colors		blue, white, gray
Туре		opper ETP1 L mm / 42x 38 AWG), class 5
Stranding	5 wires stranded using filler	
Electrical properties		
Nominal current	Max. 4 A / Contact at 40°C	
Operating voltage	Max. 60 V	
Degree of insulation	Category II per IEC 61076-2	
Conductor resistance	≤57 Ω	Ω/km
Insulation resistance	≥100	ΜΩ
Operating conditions		
Degree of protection per EN 60529		
Connector/Coupling	IP67, only wh	en screwed in
Ambient conditions		
Temperature		
Transport	-40 to	90°C
Fixed installation	-30 to 90°C	
Flexible installation ¹⁾	-25 to 60°C	
Mechanical properties		
Dimensions		
Length	Var	ious
Diameter	5.6 mm ±0.2 mm	
Bend radius	≥12x outer diameter	
Drag chain data		
Acceleration	Max. 5 m/s²	
Flex cycles	2 million	
Velocity	Max. 1.6 m/s	

Table 5: X67CA0Axx - Technical data

1) In cable drag chain operation


8.2.4.2 X67CA0A41.xxxx

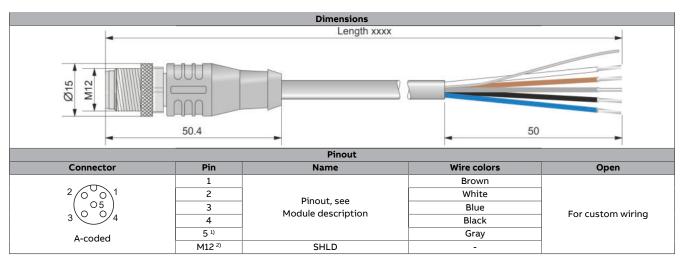

¹⁾ Do not use the gray connecting cable in connection with X67 modules for which pin 5 is used as a shield connection. The cable shield for this cable is connected using a union nut.

²⁾ Shield on M12 knurled-head screw in 360° design.


8.2.4.3 X67CA0A51.xxxx

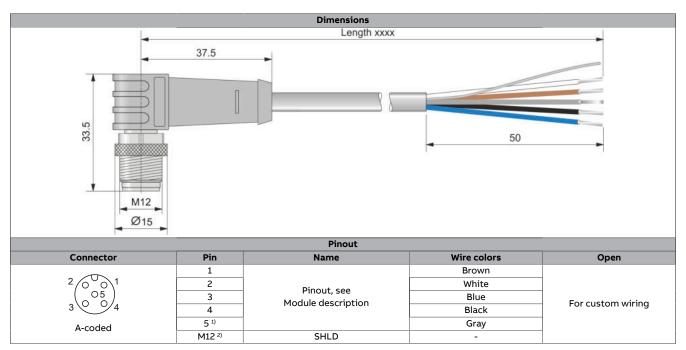

¹⁾ Do not use the gray connecting cable in connection with X67 modules for which pin 5 is used as a shield connection. The cable shield for this cable is connected using a union nut.

²⁾ Shield on M12 knurled-head screw in 360° design.

8.2.5 Multifunction cables

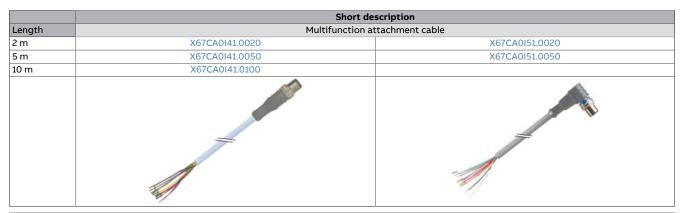


Length	Tolerances for cable lengths	
0 to <1 m	+2 cm	
1 m to <10 m	+5 cm	
10 m to xx m	+10 cm	

8.2.5.1 Technical data


Product ID	X67CA0I41	X67CA0I51		
General information				
Note		Halogen-free		
		Free of CFCs and cadmium		
Durability		dance with VDE 0472, Part 803		
		dance with VDE 0472, Part 804 / B vater resistant		
Connection				
Type	M12, 12-pin, straight	M12, 12-pin, angled		
Cable cross section	Attac	Liment Cables		
AWG		2x 28 AWG		
mm²				
******	12	2x 0.14 mm²		
Cable construction				
Complete shielding	Copper brai	ding, coverage >84%		
Outer sheathing		1 (212)		
Material	Polyether	polyurethane (PUR)		
Color		Gray		
Lines				
Wire insulation		opylene (PP) 9Y		
Wire colors		n, pink, yellow, red, violet, gray/pink, red/blue		
Type		r bare conductors		
- "		Fine stranded wire (72x 0.05 mm / 72x 44 AWG)		
Stranding	12-wi	re twisted pair		
Electrical characteristics				
Nominal current	1.5 A / Contact in a	accordance with IEC 60512-3		
Operating voltage		30 V		
Insulation resistance	>10°Ω in accor	dance with IEC 60512-2		
Operating conditions				
EN 60529 protection				
Connector/Coupling	IP67, only when screwed	in, in accordance with IEC 60529		
Environmental conditions				
Temperature				
Transport		-40 to 90°C		
Fixed installation	-40 to 90°C			
Flexible installation		0 to 90°C		
Mechanical characteristics				
Dimensions				
Length		Various		
Diameter	6.2 r	6.2 mm ±0.15 mm		
Bend radius	≥10x (≥10x outer diameter		

Table 6: X67CA0Ixx - Technical data

8.2.5.2 X67CA0I41.xxxx

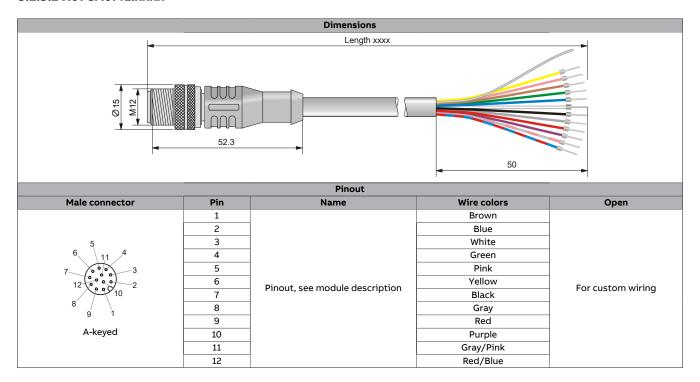

8.2.5.3 X67CA0I51.xxxx

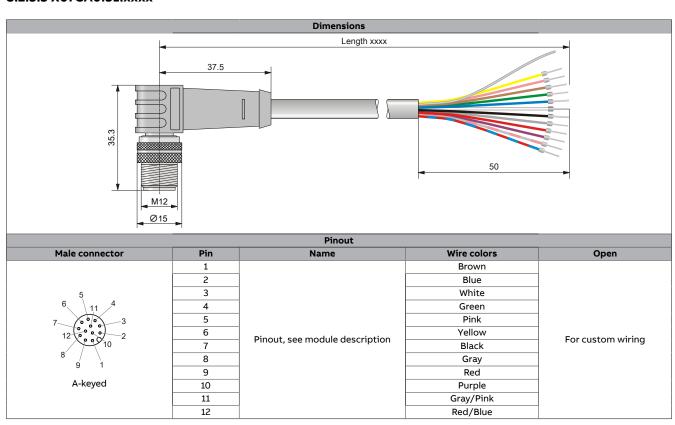

8.2.6 CAN bus cables

	Short description, model number			
Length	Connection cables	Attachment cables		
2 m	X67CA0C02.0020			
5 m	X67CA0C02.0050	X67CA0C22.0050	X67CA0C32.0050	
10 m	X67CA0C02.0100			
15 m	X67CA0C02.0150	X67CA0C22.0150	X67CA0C32.0150	
20 m	X67CA0C02.0200		X67CA0C32.0200	
35 m	X67CA0C02.0350			
40 m	X67CA0C02.0400			
50 m		X67CA0C22.0500	X67CA0C32.0500	

Length	Tolerances for cable lengths	
0 to <1 m	+2 cm	
1 m to <10 m	+5 cm	
10 m to xx m	+10 cm	

Accessories


8.2.6.1 Technical data

Product ID	X67CA0C02	X67CA0C22	X67CA0C32	
General information	<u> </u>			
Note		Halogen-free		
Durability	Flame resistant			
Connection	M12, 4-pin, straight	M12, 4-pin, straight	M12, 4-pin, angled	
Туре	Connection cables	Attachme		
Cable cross section				
Data lines				
AWG		2x 24 AWG		
mm²		2x 0.25 mm²		
Power supply lines		EX 0.25 IIIII		
AWG		2x 22 AWG		
mm²		2x 0.34 mm²		
Cable construction		2X 0.34 IIIIII		
Signal lines		Datus dishipli si dahi ali sasi assas fati		
Shield		Paired shield with aluminum foil		
Stranding		Twisted pair wires		
Cable stranding		0.35 mm² (22 AWG) with filler		
Complete shielding	Tir	nned copper braiding, coverage >8	5%	
Outer sheathing				
Material		Thermoplastic polyurethane (TPU)		
Color		Violet		
Lines				
Type Tinned copper ETB1				
	Dat	a line: fine stranded wire (19x 0.13	mm)	
	Supp	ly line: Fine stranded wire (19x 0.15	mm)	
Wire colors				
Data lines		Blue, white		
Power supply lines	Red, black			
Wire insulation				
Data lines		Cell polyethylene (PE)		
Power supply lines	Polyethylene (PE)			
Electrical characteristics				
Nominal current		Max. 4 A / contact at 40°C		
Operating voltage		Max. 250 V		
Degree of insulation	Cat	egory II in accordance with IEC 610	76-2	
Conductor resistance		Data line: ≤78 Ω/km		
		Supply line: ≤55 Ω/km		
Insulation resistance		≥100 MΩ		
Operating conditions				
EN 60529 protection				
Connector/Coupling		IP67, only when screwed in		
Environmental conditions				
Temperature				
Transport		-40 to 80°C		
Fixed installation		-40 to 80°C		
Flexible installation ¹⁾		-25 to 60°C		
Mechanical characteristics		23 13 60 C		
Dimensions				
		Various		
Length		Various		
Diameter		6.9 mm ±0.2 mm		
Bend radius		TBD		
Drag chain data				
Acceleration		Max. 4 m/s²		
Flex cycles		2 million		
		Max. 3 m/s		
Velocity		0.063 kg/m		


Table 7: X67CA0Cxx - Technical data

1) In cable drag chain operation.


8.2.6.2 X67CA0C02.xxxx

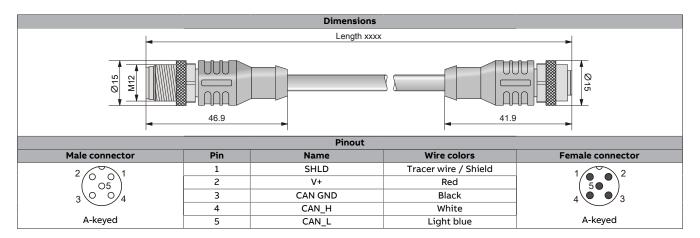

8.2.6.3 X67CA0C22.xxxx

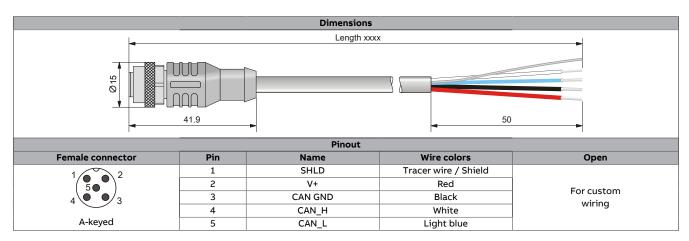

8.2.6.4 X67CA0C32.xxxx

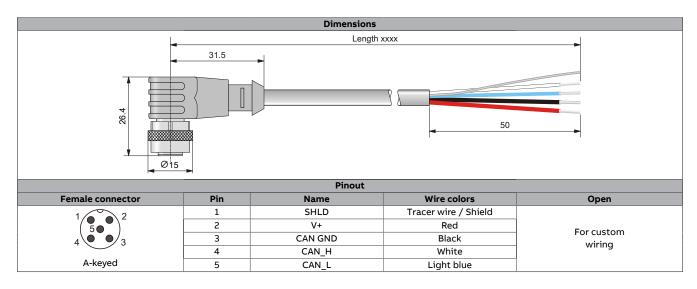

8.2.7 PROFIBUS DP cables

	Short description, model number			
Length	Connection cables	Attachment cables		Open-ended cables
0.5 m	X67CA0B12.0005			
2 m	X67CA0B12.0020			
5 m	X67CA0B12.0050	X67CA0B22.0050	X67CA0B32.0050	X67CA0B52.0050
10 m	X67CA0B12.0100			
15 m	X67CA0B12.0150	X67CA0B22.0150	X67CA0B32.0150	X67CA0B52.0150
50 m		X67CA0B22.0500	X67CA0B32.0500	X67CA0B52.0500

Length	Tolerances for cable lengths
0 to <1 m	+2 cm
1 m to <10 m	+5 cm
10 m to xx m	+10 cm


8.2.7.1 Technical data

Product ID	X67CA0B12	X67CA0B22	X67CA0B32	X67CA0B52
General information				
Note		PVC- and s	ilicone-free	
		LABS- (PWIS-) and halogen-free		
Durability		Good chemical a	and oil resistance	
		Flame r	esistant	
Connection	M12, 4-pin, angled	M12, 4-pin, straight	M12, 4-pin, angled	M12, 4-pin, angled
Туре	Connection cables	Attachme	ent cables	Open-ended cables
Cable cross section		_		
AWG		2x 22	? AWG	
mm²		2x 0.3	4 mm²	
Cable construction				
Complete shielding		Tinned copper braid	ding, coverage >85%	
Outer sheathing				
Material		Polyureth	ane (PUR)	
Color			olet	
Lines				
Wire insulation		Foam polyethylene	(PE) with skin layer	
Wire colors		Red,	green	
Type		Uncoated o	copper ETB1	
		Fine stranded wire (19x 0.15 mm), class 5	
Stranding		2-wire tw	risted pair	
Electrical characteristics				
Nominal current		Max. 4 A / co	ntact at 40°C	
Operating voltage		Max	. 60 V	
Degree of insulation		Category II in accord	ance with IEC 61076-2	
Conductor resistance		≤55 9	Ω/km	
Insulation resistance		≥100	Ο ΜΩ	_
Operating conditions				
EN 60529 protection				
Connector/Coupling		IP67, only wh	en screwed in	
Environmental conditions				
Temperature				
Transport		-40 to	90°C	
Fixed installation		-25 to	80°C	
Flexible installation ¹⁾		-25 to 60°C		
Mechanical characteristics				
Dimensions				
Length		Var	ious	
Diameter	7.6 mm ±0.3 mm			
Bend radius		≥10x oute	r diameter	
Drag chain data				
Acceleration		Max.	5m/s²	
Flex cycles		Min. 1	million	
Velocity		Max.	3.3 m	

Table 8: X67CA0Bxx - Technical data


1) In cable drag chain operation.

8.2.7.2 X67CA0B12.xxxx

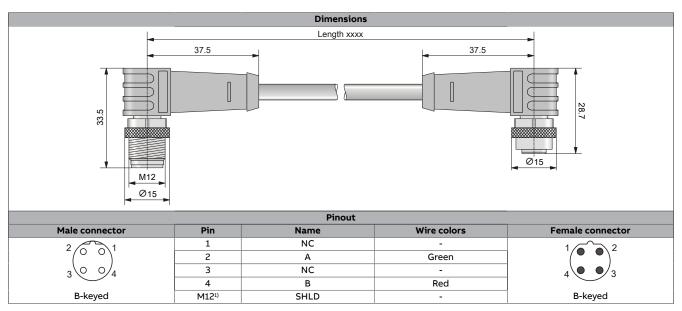


Shield on M12 knurled-head screw in 360° design

8.2.7.3 X67CA0B22.xxxx

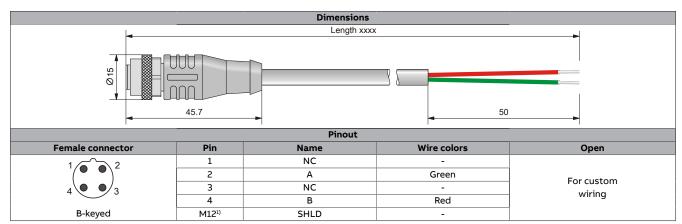


1) Shield on M12 knurled-head screw in 360° design

8.2.7.4 X67CA0B32.xxxx

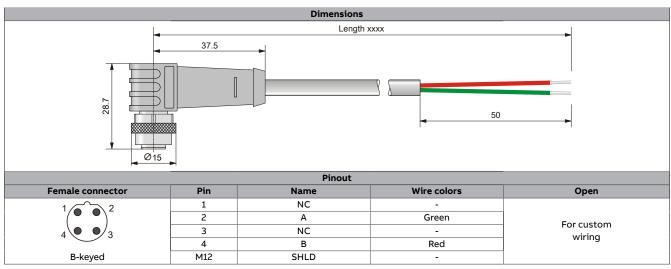

1) Shield on M12 knurled-head screw in 360° design

8.2.7.5 X67CA0B52.xxxx

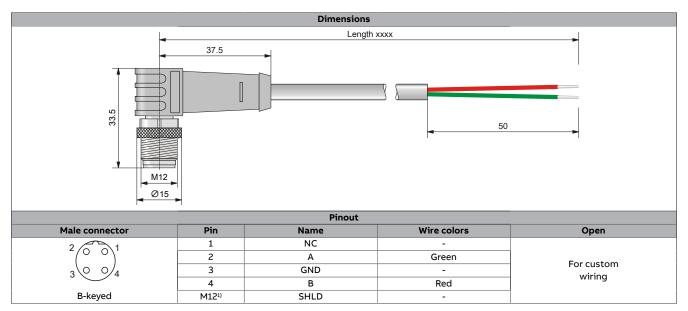

¹⁾ Shield on M12 knurled-head screw in 360° design

8.2.8 X67 POWERLINK/Ethernet cables

	Short description, order number	
Length	Attachment cables - RJ45 to M12	Connection cables - M12 to M12
1 m	X67CA0E41.0010	X67CA0E61.0010
2 m	X67CA0E41.0020	X67CA0E61.0020
3 m	X67CA0E41.0030	
5 m	X67CA0E41.0050	X67CA0E61.0050
10 m		X67CA0E61.0100
15 m	X67CA0E41.0150	X67CA0E61.0150
20 m		X67CA0E61.0200
50 m	X67CA0E41.0500	

Length	Tolerances for cable lengths
0 to <10 m	+10 cm
10 m to <50 m	+2% of the length

AbN automation


8.2.8.1 Technical data

Product ID	X67CA0E41.xxxx	X67CA0E61.xxxx		
General information				
Note	PWIS- and halogen-free ¹⁾			
Durability		Flame-retardant, RoHS-compliant		
-	Acid, alkali and oil resistant			
		er resistant		
		one resistant ²⁾		
Connection	RJ45 to M12, 4-pin, straight	M12, 4-pin, straight		
Туре	Connec	ction cable		
Cable cross section		20 4146		
AWG		22 AWG		
mm²	4x 0.	.34 mm²		
Cable construction				
Cable shield	Overlapping aluminum-clad foil, to	inned copper braiding, 85% coverage		
Outer jacket	Delement	the area (DUD)		
Material	-	thane (PUR)		
Color	G	ireen		
Wires				
Wire insulation	•	rdant Non-Corrosive)		
Wire colors	-	w, blue, orange		
Туре		er stranded wire 7x 0.25 mm / 7x 30 AWG)		
Stranding	·	te stranding the star quad		
Electrical properties				
Operating voltage	Max. 60	O V for PoE		
Test voltage				
Wire - Wire	20	000 V		
Wire - Shield	20	000 V		
Conductor resistance	≤120 Ω/	≤120 Ω/km at 20°C		
Transfer properties	Category 5 / Class D up to 100 MHz per ISO/IEC 11801 (EN 50173-1), ISO/IEC 24702 (EN 50173-3)			
Transfer rate	10/10	10/100 Mbit/s		
Insulation resistance	≥500 MΩ	1/km at 20°C		
Operating conditions				
Degree of protection per EN 60529				
Cables	I	IP67		
Male M12 connector	IP67, only w	hen screwed in		
RJ45 connector	IP20, only when	properly connected		
Ambient conditions				
Temperature				
Transport	-50 t	to 75°C³)		
Fixed installation	-40 t	to 75°C ⁴⁾		
Flexible installation	-30 t	:o 70°C ⁵⁾		
Mechanical properties				
Dimensions				
Length		arious		
Diameter	6.5 mn	n ±0.2 mm		
Bend radius				
Fixed installation		≥4x outer diameter ⁶⁾		
Flexible installation	≥8x outer diameter ⁷⁾			
Drag chain data ⁸⁾				
Acceleration		m/s²		
Flex cycles		3 million		
Speed		m/s		
Bend radius		0 mm		
Weight	0.06	i4 kg/m		


Table 9: X67CA0E41.xxxx, X67CA0E61.xxxx - Technical data

- Up to version <D0: Halogen-free
- Up to version <D0: Flame-retardant per IEC 60332-1-2; RoHS 2011/65/EU
- Up to version <D0: -50 to 70°C
- Up to version <D0: -40 to 70°C
- 3) 4) 5) Up to version <D0: -20 to 60°C
- **Up to version <D0:** ≥3x outer diameter
- Up to version <D0: ≥7x outer diameter
- **Up to version <D0:** Cables cannot be used in cable drag chains.

8.2.8.2 X67CA0E41.xxxx

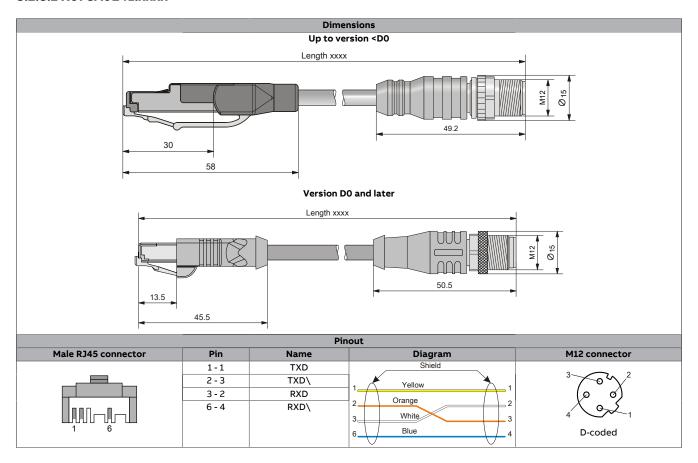


8.2.8.3 X67CA0E61.xxxx

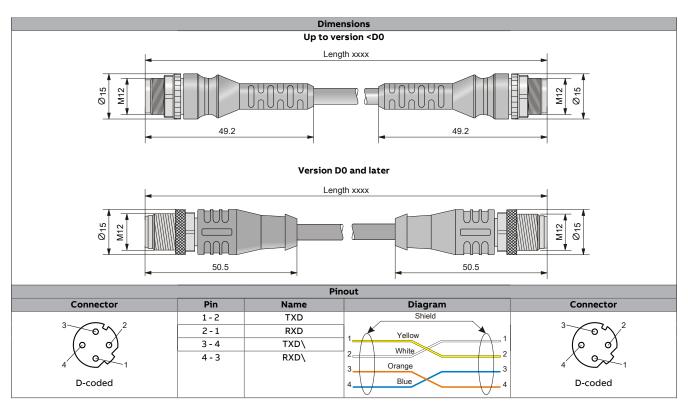

8.2.9 80CMxxx01.26-01- Motor cables with M12 connector

Pinout

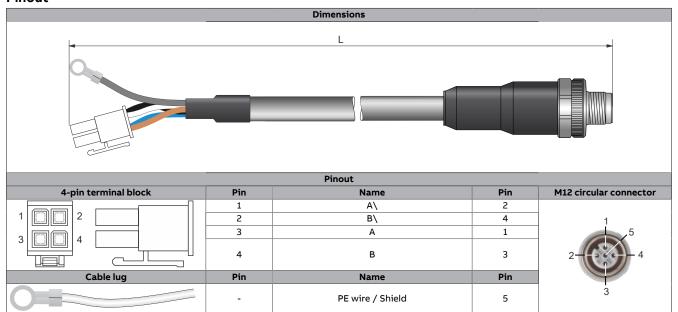


Cable lengths (L)	
Order number	Length [m]
80CM 003 01.26-01	0.3
80CM 005 01.26-01	0.5
80CM 007 01.26-01	0.7
80CM 008 01.26-01	0.8
80CM 010 01.26-01	1.0
80CM 011 01.26-01	1.1

Cable lengths (L)		
Order number	Length [m]	
80CM 013 01.26-01	1.3	
80CM 014 01.26-01	1.4	
80CM 015 01.26-01	1.5	
80CM 017 01.26-01	1.7	
80CM 020 01.26-01	2.0	
80CM 025 01.26-01	2.5	

Cable lengths (L)		
Order number	Length [m]	
80CM 026 01.26-01	2.6	
80CM 029 01.26-01	2.9	
80CM 040 01.26-01	4.0	
80CM 050 01.26-01	5.0	
80CM 054 01.26-01	5.4	
80CM 100 01.26-01	10.0	

Cable diagram

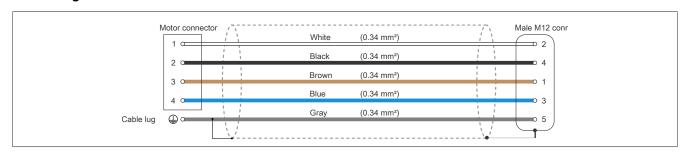

Accessories

8.2.9.1 Technical data

Order number	80CMxx001.26-01
General information	
Cable cross section	5x 0.34 mm²
Cable construction	
Power lines	
Quantity	5
Wire insulation	PVC
Wire colors	Black, brown, blue, gray, white
Cross section	0.34 mm²
Shield	Yes
Stranding	Yes
Cable stranding	With filler elements and foil banding
Cable shield	Tinned copper braiding, optical coverage >85% and wrapped in isolating film
Outer jacket	
Material	PUR/PVC
Electrical properties	
Nominal current	Max. 4 A / contact
Connection voltage	Max. 60 V AC/DC
Ambient conditions	
Temperature	
Moving	-10 to 70°C
Static	-20 to 90°C
Mechanical properties	
Dimensions	
Diameter	6.4 mm ±0.2 mm
Bend radius	≥10x outer diameter
Drag chain data	
Acceleration	5 m/s²
Flex cycles	Max. 2.5 million
Velocity	2 m/s
Torque for connections	
M12	0.6 Nm


When using motors with IP65 protection, an adapted gasket is required that can be ordered in an accessory set.

Accessory set for motors with IP65 option	Model number
Gaskets for IP65 stepper motors for use with 80CMxxxxx.26-01 cables	80XMPXAC1.00-10
Cable grommets 5.6 to 6.6 / 5.6 to 6.6 mm	(10 pcs. per package)



8.2.10 80CMxxx03.26-01 - ABR incremental encoder cables with M12 connector

Pinout

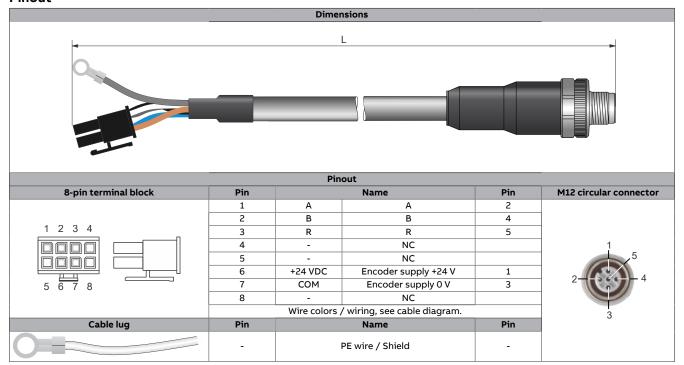


Cable lengths (L)	
Order number	Length [m]
80CM 003 03.26-01	0.3
80CM 005 03.26-01	0.5
80CM 007 03.26-01	0.7
80CM 008 03.26-01	0.8
80CM 010 03.26-01	1.0
80CM 011 03.26-01	1.1

Cable lengths (L)	
Order number	Length [m]
80CM 013 03.26-01	1.3
80CM 014 03.26-01	1.4
80CM 015 03.26-01	1.5
80CM 017 03.26-01	1.7
80CM 020 03.26-01	2.0
80CM 025 03.26-01	2.5

Cable lengths (L)		
Order number	Length [m]	
80CM 026 03.26-01	2.6	
80CM 029 03.26-01	2.9	
80CM 040 03.26-01	4.0	
80CM 050 03.26-01	5.4	
80CM 054 03.26-01	5.4	
80CM 100 03.26-01	10.0	

Accessory for M12 connector	
Model number	Description
80XMPXAC1.00-10	10x gasket for cable with M12 connector

Cable diagram

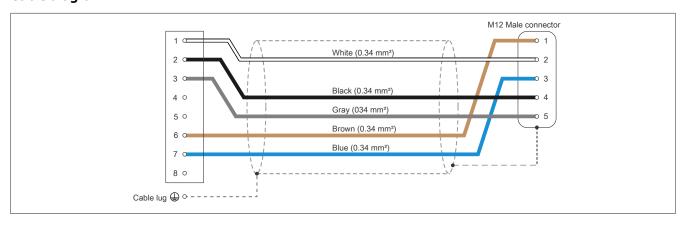

Accessories

8.2.10.1 Technical data

Order number	80CMxx003.26-01
General information	
Cable cross section	5x 0.34 mm²
Cable construction	
Power lines	
Quantity	5
Wire insulation	PVC
Wire colors	Black, brown, blue, gray, white
Cross section	0.34 mm²
Shield	Yes
Stranding	Yes
Cable stranding	With filler elements and foil banding
Cable shield	Tinned copper braiding, optical coverage >85% and wrapped in isolating film
Outer jacket	
Material	PUR/PVC
Electrical properties	
Nominal current	Max. 4 A / contact
Connection voltage	Max. 60 V AC/DC
Ambient conditions	
Temperature	
Moving	-10 to 70°C
Static	-20 to 90°C
Mechanical properties	
Dimensions	
Diameter	6.4 mm ±0.2 mm
Bend radius	≥10x outer diameter
Drag chain data	
Acceleration	Max. 5.0 m/s ²
Flex cycles	>2.5 million
Velocity	Max. 2.0 m/s
Torque for connections	
M12	0.6 Nm

8.3 Field-assembled connectors

8.3.1 I/O power supply

Order number	Short description	Figure
	I/O supply	
X67AC0P00	X67 M8 connector, 4-pin, piercing connection	

Table 12: X67AC0P00 - Order data

Order number	Short description	Figure
	I/O supply	
X67AC0P20	X67 female M8 connector, 4-pin, piercing connection	

Table 13: X67AC0P20 - Order data

Product ID	X67AC0P00	X67AC0P20
Connection	Male M8 connector	Female M8 connector
Coding		-
Type of terminal block	Piercing c	onnection
Number of poles/wires	•	4
Torque	0.5 / 0.8	/ 0.2 Nm ¹⁾
External diameter of cable	3 to !	5 mm
Contact	Cu	ıZn
Contact surface	Ni,	/Au
Flexible connection cross section	0.14 to 0	0.38 mm²
	26 to 2	22 AWG

¹⁾ Pressure nut with connector housing / Connector insert with connector housing / Knurl

8.3.2 Sensors/Actuators

Order number	Short description	Figure
	Sensors / actuators	
X67AC0D00	X67 M8 connector, 3-pin, piercing connection	

Table 14: X67AC0D00 - Order data

Order number	Short description	Figure
	Sensors / actuators	
X67AC0A00-1	X67 male M12 connector, 5-pin, A-coded, cage clamp connection	

Table 15: X67AC0A00-1 - Order data

Order number	Short description	Figure
	Sensors / actuators	
X67AC2A00	X67 M12 connector, 5-pin, A-coded, screw clamp connection	

Table 16: X67AC2A00 - Order data

Product ID	X67AC0D00	X67AC0A00-1	X67AC2A00
Connection	Male M8 connector	Male M12 o	connector
Coding	-	A-co	ded
Type of terminal block	Piercing connection	Cage clamp connection	Screw terminal
Number of poles/wires	3	5	5
Torque	0.5 / 0.8 / 0.2 Nm ¹⁾	0.4 / 1.5 Nm ²⁾	0.4 / 0.2 / 0.8 Nm ³⁾
External diameter of cable	3 to 5 mm	4 to 8 mm	4 to 6 mm
Contact	CuZn	CuSn	CuZn
Contact surface	Ni/Au	Ni/Au	CuSnZn
Flexible connection cross section	0.14 to 0.38 mm ² 26 to 22 AWG	Without wire end sleeve 0.14 to 0.75 mm² 26 to 18 AWG With wire end sleeve 0.08 to 0.5 mm² 28 to 20 AWG	Without wire end sleeve 0.25 to 0.75 mm² 24 to 18 AWG With wire end sleeve 0.14 to 0.75 mm² 26 to 20 AWG

- 1) Pressure nut with connector housing / Connector insert with connector housing / Knurl
- 2) Knurl and connector insert with connector housing / pressure nut with connector housing
- 3) Knurl / screw clamp terminal block / pressure screw

8.3.3 Special-purpose connectors

Order number	Short description	Figure
	Special plugs	
X67AC9A02	X67 thermocouple connector M12, for measuring point temperature compensation, screw terminal	

Table 17: X67AC9A02 - Order data

Product ID	X67AC0D00	
Connection	Male M12 connector	
Coding	A-coded	
Type of terminal block	Screw terminal	
Number of poles/wires	5	
Torque	0.4 / 0.2 / 0.8 Nm ¹⁾	
External diameter of cable	4 to 6 mm	
Contact	CuZn	
Contact surface	CuSnZn	
Flexible connection cross section	Without wire end sleeve 0.25 to 0.75 mm² 24 to 18 AWG With wire end sleeve 0.14 to 0.75 mm² 26 to 20 AWG	

¹⁾ Knurl / screw clamp terminal block / pressure screw

8.3.4 CAN bus

Order number	Short description	Figure
	CAN bus / DeviceNet	
X67AC0C01-1	X67 male M12 connector, 5-pin, A-coded, shielded, cage clamp connection	

Table 18: X67AC0C01-1 - Order data

Order number	Short description	Figure
	CAN bus / DeviceNet	
X67AC0C21-1	X67 female connector, M12, 5-pin, A-coded, shielded, cage clamp connection	

Table 19: X67AC0C21-1 - Order data

Order number	Short description	Figure
	CAN bus / DeviceNet	
X67AC2C01	X67 male M12 connector, 5-pin, A-coded, shielded, screw clamp connection	

Table 20: X67AC2C01 - Order data

Order number	Short description	Figure
	CAN bus / DeviceNet	
X67AC2C21	X67 female M12 connector, 5-pin, A-coded, shielded, screw terminal	

Table 21: X67AC2C21 - Order data

Product ID	X67AC0C01-1	X67AC0C21-1	X67AC2C01	X67AC2C21	
Connection	Male M12 connector	Female M12 connector	Male M12 connector	Female M12 connector	
Coding	A-co	oded	A-c	oded	
Type of terminal block	Cage clamp	connection	Screw	terminal	
Number of poles/wires		5		5	
Torque	0.4 / 0.8	3 / 3 Nm ¹⁾	0.4 / 0.2 / 0.8 Nm ²⁾		
External diameter of cable	4 to	4 to 8 mm		6 to 8 mm	
Contact	Cu	CuSn		uZn	
Contact surface	Ni/Au		,	Au	
Flexible connection cross section	Without wi	Without wire end sleeve		re end sleeve	
	0.14 to 0.75 mm ² 0.25 to 0.75 mm ²		0.75 mm²		
	26 to 18 AWG 24 to		18 AWG		
	With wire	With wire end sleeve		end sleeve	
	0.08 to	0.08 to 0.5 mm ²		0.5 mm ²	
	28 to 2	20 AWG	26 to	20 AWG	

- 1) Knurl and connector insert with connector housing / pressure nut with connector housing
- 2) Knurl / screw clamp terminal block / pressure nut with connector housing

8.3.5 PROFIBUS DP / X2X Link

Order number	Short description	Figure
	PROFIBUS DP / X2X Link	
X67AC0X01-1	X67 male M12 connector, 5-pin, B-coded, shielded, push-in	

Table 22: X67AC0X01-1 - Order data

Order number	Short description	Figure
	PROFIBUS DP / X2X Link	
X67AC0X21-1	X67 female M12 connector, 5-pin, B-coded, shielded, push-in	

Table 23: X67AC0X21-1 - Order data

Order number	Short description	Figure
	PROFIBUS DP / X2X Link	
X67AC2X01	X67 M12 connector, 5-pin, B-coded, shielded, screw terminal	

Table 24: X67AC2X01 - Order data

Order number	Short description	Figure
	PROFIBUS DP / X2X Link	
X67AC2X21	X67 female M12 connector, 5-pin, B-coded, shielded, screw terminal	

Table 25: X67AC2X21 - Order data

Product ID	X67AC0X01-1	X67AC0X21-1	X67AC2X01	X67AC2X21	
Connection	Male M12 connector	Female M12 connector	Male M12 connector	Female M12 connector	
Coding	B-c	oded	B-coded		
Type of terminal block	Pu	sh-in	Screw terminal		
Number of poles/wires		5		5	
Torque	0.4 / 0.8	0.4 / 0.8 / 3 Nm ¹⁾		0.4 / 0.2 Nm²) 0.8 to 1 / 1 to 1.4 Nm³)	
External diameter of cable	4 to	4 to 8 mm		6.5 to 8.5 mm	
Contact	С	CuSn		ıZn	
Contact surface	Ni	Ni/Au		\u	
Flexible connection cross section	0.14 to 26 to With wire 0.08 to	Without wire end sleeve 0.14 to 0.75 mm² 26 to 18 AWG With wire end sleeve 0.08 to 0.5 mm²		re end sleeve D.75 mm² L8 AWG end sleeve D.75 mm²	
	28 to	20 AWG	26 to 2	20 AWG	

- Knurl and connector insert with connector housing / pressure nut with connector housing
- 2) 3) Knurl / screw clamp terminal block
- Pressure nut for outer diameter: 4 to 8 mm or 8 to 12 mm

8.3.6 POWERLINK/Ethernet

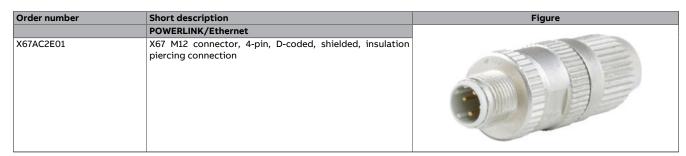


Table 26: X67AC2E01 - Order data

Product ID	X67AC0C01-1	
Connection	Male M12 connector	
Coding	D-coded	
Type of terminal block	Insulation piercing connection	
Number of poles/wires	4	
Torque	0.6 Nm	
External diameter of cable	4.5 - 8.8 mm	
Contact	CuSn	
Contact surface	Ni/Au	
Flexible connection cross section	0.14 to 0.34 mm²	
	26 to 22 AWG	

8.4 Other accessories

8.4.1 Terminating resistor

Order number	Short description	Figure
	Terminating resistor	
X67AC9C03	X67 CAN M12 terminating resistor	1400 to 100 to 1

Table 27: X67AC9C03 - Order data

Order number	Short description	Figure
	Terminating resistor	
X67AC9B03	X67 PROFIBUS DP M12 terminating resistor	

Table 28: X67AC9B03 - Order data

8.4.2 Connectors

Order number	Short description	Figure
	Connectors	
X67AC8C00	X67 CAN Y-connector	

Table 29: X67AC8C00 - Order data

Order number	Short description	Figure
	Connectors	
X67AC8B01	X67 PROFIBUS DP Y-connector	

Table 30: X67AC8B01 - Order data

8.4.3 Threaded caps

Table 31: X67AC0M08, X67AC0M12 - Order data

8.4.4 Plain text tags

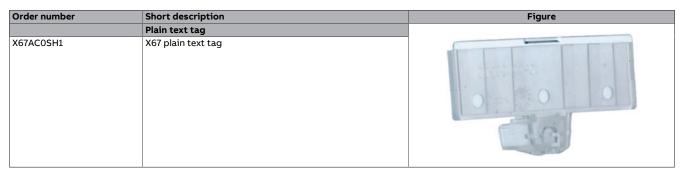


Table 32: X67AC0SH1 - Order data

8.4.5 Mounting plate

A mounting plate must be used for installing X67 modules on non-enclosed mounting surfaces outside the control cabinet. The mounting plate is placed between the module and mounting surface and screwed to the mounting surface together with the module.

One packaging unit contains 10 mounting plates.

Order number	Short description	Figure
	Mounting plate	
X67ACMP01.0010	X67 accessory for installing X67 modules with a height of 85 mm on non-enclosed mounting surfaces outside the control cabinet, 10 pieces	•
X67ACMPL1.0010	X67 accessory for installing X67 modules with a height of 155 mm on non-enclosed mounting surfaces outside the control cabinet, 10 pieces	

Table 33: X67ACMP01.0010, X67ACMPL1.0010 - Order data

8.4.6 Mounting plates for top-hat rails

Order number	Short description	Figure
	Mounting plates for DIN rails	
X67ACTS35	X67 top-hat rail mounting plate	8
X67ACTS35.0010	X67 top-hat rail mounting plate, 10 pcs.	

Table 34: X67ACTS35, X67ACTS35.0010 - Order data

8.4.7 Installation tool

The connectors and couplings of pre-assembled X67 cables have additional width across flats on the knurled-head screw that can be used for an installation tool. A torque wrench set with M8 or M12 insert is available as an accessory for optimal assembly. It can be used to ensure the absolute safety of the connection to the X67 module.

Order number	Short description	Figure
	Mounting tools	
X67ACTQMX	X67 torque wrench set, for X67 M8 and M12 connectors, for hex-head connectors	1/11

Table 35: X67ACTQMX - Order data

9 International and national certifications

Products and services from B&R comply with applicable regulations, directives and standards. These are national, European and international regulations, mainly from organizations such as ISO, IEC and CENELEC. We are committed to ensuring the reliability of our products in industrial environments.



Information:

Certifications that apply to a particular module are available at the following places:

- B&R website (<u>www.br-automation.com</u>) > Product page > Technical data > General information > Certifications
 - (The product page is found by searching for the order number.)
- On the side of the module housing

Changes and new certifications are available promptly in electronic form on the B&R website (www.br-automation.com).

9.1 Overview of certifications

Mark	Explanation	Certificate authority	Region
ϵ	CE marking	Notified bodies	Europe (EU)
UK	UK Conformity Assessed (UKCA)	Notified bodies	United King- dom (UK)
SAFETY certified product	Functional safety (CE)	Notified bodies	Europe (EU)
$\langle Ex \rangle$	Explosion protection (CE)	Notified bodies	Europe (EU)
C UL US	Underwriters Laboratories Inc. (UL) (certification for US and Canada)	UL	Canada USA
C US Hazardous Locations	Canadian Standards Association (CSA) (certification for US and Canada)	CSA	Canada USA
	Korean Conformity (KC)	Radio Research Agency (RRA)	Korea
	Regulatory Compliance Mark (RCM)	ACMA	Australia Oceania

9.2 EU directives and standards (CE)

CE marking



Europe (EU)

The respective product complies with all applicable EU directives and relevant harmonized standards.

Certification of these products is performed in cooperation with accredited testing laboratories.

EMC directive 2014/30/EU

All devices meet the protection requirements of the "Electromagnetic Compatibility" directive and are designed for typical industrial use.

Applicable standards from this directive:

EN 61131-2 Programmable controllers

- Part 2: Equipment requirements and tests

EN 61000-6-2 Electromagnetic compatibility (EMC)

- Part 6-2: Generic standards - Immunity standard for industrial environments

EN 61000-6-4 Electromagnetic compatibility (EMC)

- Part 6-4: Generic standards - Emission standard for industrial environments

Low voltage directive 2014/35/EU

The low voltage directive applies to electrical equipment with a nominal voltage from 50 to 1000 VAC and from 75 to 1500 VDC.

All devices within the area of application of this directive satisfy the its protection requirements.

Applicable standard from this directive:

EN 61131-2 Programmable controllers

- Part 2: Equipment requirements and tests

The corresponding declaration of conformity is available for download on the B&R website. The editions of the applied standards are located in the respective declaration of conformity.



CE declaration of conformity

Website > Downloads > Certificates > Declarations of conformity > EU > X67 system > Declaration of conformity PLC X67

UK Conformity Assessed (UKCA)

The corresponding declaration of conformity is available for download on the B&R website. The editions of the applied standards are located in the respective declaration of conformity.



All directives applicable to the respective product and their relevant standards are met.

Products with this marking are permitted to be imported into Great Britain (England, Wales, Scotland).

UKCA declaration of conformity

PDF Website > Down

Website > Downloads > Certificates > Declarations of conformity > EU > X67 system > UK declaration PLC X67

Machinery directive 2006/42/EC

Functional safety



In accordance with the machinery directive, safety technology products are designed, developed, tested and labeled for special applications providing protection to machinery and personnel.

Europe (EU)

Certification of these products is performed exclusively in cooperation with EU-authorized bodies (Notified Bodies).

Applicable standards from this directive:

SIL 3:

IEC 61508-3

IEC 61508-1 Functional safety of electrical / electronic / programmable electronic safety-related systems

- Part 1: General requirements

IEC 61508-2 Functional safety of electrical / electronic / programmable electronic safety-related systems

- Part 2: Requirements for electrical/electronic/programmable electronic safety-related systems Functional safety of electrical / electronic / programmable electronic safety-related systems

- Part 3: Software requirements

IEC 61508-4 Functional safety of electrical/electronic/programmable electronic safety-related systems - Part 4: Definitions

and abbreviations

 ${\sf EN\,62061} \qquad \qquad {\sf Safety\,of\,machinery\,-Functional\,safety\,of\,safety-related\,electrical,\,electronic\,and\,programmable\,electronic\,control}$

systems

IEC 61511-1 Functional safety - Safety instrumented systems for the process industry sector

- Part 1: Framework, definitions, system, hardware and software requirements

PL e, Cat. 4:

EN ISO 13849-1 Safety of machinery - Safety-related parts of control systems

- Part 1: General principles for design

EN 61131-2 Programmable logic controllers

- Part 2: Equipment requirements and tests

Declarations of conformity, certificates and any other safety-related documentation can be downloaded from the B&R website. For information about the versions of applicable standards, see the declaration of conformity.



Declaration of conformity

Website > Downloads > Certificates > Declarations of conformity > X67 system > EU declaration of conformity FS PLC X67



Certificates

FS EN 50156 certificate - SafeLOGIC, SafelO FS certificate - SafeDESIGNER, SafeLOGIC, SafelO Safe cutoff of potential groups



User's manual

Website > Downloads > Safety technology > Integrated safety technology user's manual

ATEX directive 2014/34/EU

ATEX / Zone 2



II 3G Ex nA nC IIA T5 Gc

Europe (EU)

Products with this mark are suitable for use in potentially explosive atmospheres.

The X67 system is certified for use in environments with explosive gases with a normal level of safety (Zone 2).

Certification of these products is performed exclusively in cooperation with EU-authorized bodies (Notified Bodies).

Each module is also accompanied by an information sheet providing detailed installation and safety guidelines.

Applicable standards from this directive:

EN 60079-0 Explosive atmospheres

Part 0: Equipment - General requirements

EN 60079-15 Explosive atmospheres

- Part 15: Equipment protection by type of protection "n"

The declaration of conformity and certificate can be downloaded from the B&R website. For information about the versions of applicable standards, see the declaration of conformity.



Declaration of conformity

Website > Downloads > Certificates > Declarations of conformity > X67 system > EU declaration of conformity ATEX X67



Certificate

Website > Downloads > Certificates > ATEX > X67 > TÜV 05 ATEX 7201 X

9.2.1 Overview of standards

Standard	Description	
EN ISO 13849-1	Safety of machinery - Safety-related parts of control systems - Part 1: General principles for design	
EN 55011 (CISPR 11)	Industrial, scientific and medical equipment - Radio frequency disturbance characteristics - Limits and methods of me surement	
EN 55016-2-1 (CISPR 16-2-1)	Specification for radio disturbance and immunity measuring apparatus and methods - Part 2-1: Methods of measurement of disturbances and immunity - Conducted disturbance measurements	
EN 55016-2-3 (CISPR 16-2-3)	Specification for radio disturbance and immunity measuring apparatus and methods - Part 2-3: Methods of measurement of disturbances and immunity - Radiated disturbance measurements	
EN 55032 (CISPR 32)	Electromagnetic compatibility of multimedia equipment - Emission requirements	
EN 60068-2-6	Environmental testing - Part 2-6: Procedures - Test Fc: Vibration (sinusoidal)	
EN 60068-2-27	Environmental testing - Part 2-27: Test procedure - Test Ea and guidance: Shock	
EN 60068-2-31 ¹⁾	Environmental testing - Part 2-31: Test procedure - Test Ec: Rough handling shocks, mainly for devices	
EN 60079-0	Explosive atmospheres Part 0: Equipment - General requirements	
EN 60079-15	Explosive atmospheres - Part 15: Equipment protection by type of protection "n"	
EN 60529	Degrees of protection provided by enclosures (IP code)	
EN 60664-1	Insulation coordination for equipment within low-voltage systems - Part 1: Principles, requirements and tests	
EN 60721-3-2	Classification of environmental conditions - Part 3: Classification of groups of environmental parameters and their severities - Section 2: Transport and handli	
EN 60721-3-5	Classification of environmental conditions - Part 3: Classification of groups of environmental parameters and their severities - Section 5: Usage on and in land veh	
EN 61000-4-2	Electromagnetic compatibility (EMC) - Part 4-2: Testing and measurement techniques - Electrostatic discharge immunity test	
EN 61000-4-3	Electromagnetic compatibility (EMC) - Part 4-3: Testing and measurement techniques - Radiated, radio-frequency, electromagnetic field immunity test	
EN 61000-4-4	Electromagnetic compatibility (EMC) - Part 4-4: Testing and measurement techniques - Electrical fast transient/burst immunity test	
EN 61000-4-5	Electromagnetic compatibility (EMC) - Part 4-5: Testing and measuring techniques - Surge immunity test	
EN 61000-4-6	Electromagnetic compatibility (EMC) - Part 4-6: Testing and measurement techniques - Immunity to conducted disturbances, induced by radio-frequency f	
EN 61000-4-8	Electromagnetic compatibility (EMC) - Part 4-8: Testing and measuring techniques - Power frequency magnetic field immunity test	
EN 61000-4-11	Electromagnetic compatibility (EMC) - Part 4-11: Testing and measuring techniques - Voltage dips, short interruptions and voltage variations	
EN 61000-4-29	Electromagnetic compatibility (EMC) - Part 4-29: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations on d.c.	
EN 61000-6-2	power port immunity tests Electromagnetic compatibility (EMC) - Part 6-2: Generic standards - Immunity standard for industrial environments	
EN 61000-6-4	Electromagnetic compatibility (EMC) - Part 6-4: Generic standards - Emission standard for industrial environments	
EN 61131-2	Programmable logic controllers - Part 2: Guidance for inspection and routine testing	
IEC 61508-1	- Part 2: Guidance for inspection and routine testing Functional safety of electrical / electronic / programmable electronic safety-related systems - Part 1: General requirements	
IEC 61508-2	Functional safety of electrical / electronic / programmable electronic safety-related systems - Part 2: Requirements for electrical/electronic/programmable electronic safety-related systems	
IEC 61508-3	Functional safety of electrical / electronic / programmable electronic safety-related systems - Part 3: Software requirements	
IEC 61508-4	Functional safety of electrical / electronic / programmable electronic safety-related systems - Part 4: Definitions and abbreviations	
IEC 61511-1	Functional safety - Safety instrumented systems for the process industry sector - Part 1: Framework, definitions, system, hardware and software requirements	
EN 62061	Safety of machinery - Functional safety of safety-related electrical, electronic and programmable electronic control systems	

¹⁾ Replacement for EN 60068-2-32

9.2.2 Requirements for immunity to disturbances

Immunity	Test carried out in accordance with	Requirements in accordance with
		EN 61131-2: Product standard -
Electricated discharge (ECD)	EN 61000-4-2	Programmable logic controllers
Electrostatic discharge (ESD)		EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
		EN 61131-2: Product standard -
High fragment also transported fields (HE field)	EN 61000 4 3	Programmable logic controllers
High-frequency electromagnetic fields (HF field)	EN 61000-4-3	EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
		EN 61131-2: Product standard -
High area day reject all strict district and (D. 1951)	EN 61000-4-4	Programmable logic controllers
High-speed transient electrical disturbances (Burst)	EN 61000-4-4	EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
		EN 61131-2: Product standard -
Companyalta and (Company	EN 61000 4 F	Programmable logic controllers
Surge voltages (Surge)	EN 61000-4-5	EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
		EN 61131-2: Product standard -
Conducted disturbances	EN 61000 4 6	Programmable logic controllers
Conducted disturbances	EN 61000-4-6	EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
		EN 61131-2: Product standard -
NAC and the Control of the other based on the control of	EN 61000-4-8	Programmable logic controllers
Magnetic fields with electrical frequencies	EN 61000-4-8	EN 61000-6-2: Generic standard -
		Immunity to disturbances in industrial sectors
Walter on aller a (AC)		EN 61131-2: Product standard -
Voltage dips (AC)	EN 61000-4-11	Programmable logic controllers
Short-term interruptions (AC)		EN 61000-6-2: Generic standard -
Voltage fluctuations (AC)		Immunity to disturbances in industrial sectors
Short-term interruptions (DC)	EN 61000 1 00	EN 61131-2: Product standard -
Voltage fluctuations (DC)	EN 61000-4-29	Programmable logic controllers

Evaluation criteria for performance

Criteria	During testing	After testing
А	The PLC system shall continue to operate as intended. No loss of function or performance.	The PLC system shall continue to operate as intended.
В	Degradation of performance accepted. No change of operating mode. No irreversible loss of stored data.	The PLC system shall continue to operate as intended. Temporary degradation of performance must be self-recoverable.
С	or software (programme or data).	The PLC system shall continue to operate as intended automatically, after manual restart or power off/power on.
D	Degradation or failure of functionality that can no longer be restored.	PLC system permanently damaged or destroyed.

International and national certifications

Electrostatic discharge (ESD)

Test carried out in accordance with EN 61000-4-2	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
Contact discharge (CD) to conductive external	±4 kV	
parts	Criteria B	
Air discharge (AD) to insulating external parts	±8 kV	
	Crit	eria B

High-frequency electromagnetic fields (HF field)

Test carried out in accordance with EN 61000-4-3	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
Housing, completely wired	80 MHz to 1 GHz, 10 V/m	80 MHz to 1 GHz, 10 V/m
	1.4 GHz to 2 GHz, 3 V/m	1.4 GHz to 6 GHz, 3 V/m
	2 GHz to 2.7 GHz, 1 V/m	Criteria A
	Criteria A	

High-speed transient electrical disturbances (Burst)

Test carried out in accordance with EN 61000-4-4	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
AC mains inputs >3 m	±2 kV / 5 kHz	±2 kV / 5 kHz or 100 kHz
	Criteria B	Criteria B
AC mains outputs >3 m	±2 kV / 5 kHz	±2 kV / 5 kHz or 100 kHz ¹⁾
	Criteria B	Criteria B
AC other I/Os >3 m	±2 kV / 5 kHz	-
	Criteria B	
DC mains inputs/outputs >3 m	±2 kV / 5 kHz	±1 kV / 5 kHz or 100 kHz
	Criteria B	Criteria B
Other I/Os and interface >3 m	±1 kV / 5 kHz	±1 kV / 5 kHz or 100 kHz
	Criteria B	Criteria B

¹⁾ Without length limitation

Surge voltages (Surge)

Test carried out in accordance with EN 61000-4-5	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
AC mains inputs/outputs	±1 kV	±1 kV
(line to line)	Criteria B	Criteria B
AC mains inputs/outputs	±2 kV	±2 kV
(line to PE)	Criteria B	Criteria B
DC mains inputs/outputs >30 m	±0.5 kV	±0.5 kV ¹⁾
(line to line)	Criteria B	Criteria B
DC mains inputs/outputs >30 m	±0.5 kV	±1 kV ¹⁾
(line to PE)	Criteria B	Criteria B
Signal connections, unshielded >30 m	±1 kV	±1 kV
(line to PE)	Criteria B	Criteria B
All shielded lines >30 m	±1 kV	-
(line to PE)	Criteria B	

¹⁾ Without length limitation

Conducted disturbances

Test carried out in accordance with EN 61000-4-6	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2	
AC mains inputs/outputs	10	0 V	
	150 kHz	to 80 MHz	
	80% AI	M (1 kHz)	
	Crit	Criteria A	
DC mains inputs/outputs	10 V		
	150 kHz to 80 MHz		
	80% AM (1 kHz)		
	Criteria A		
Other I/Os and interfaces	10 V ¹⁾		
	150 kHz to 80 MHz		
	80% AM (1 kHz)		
	Criteria A		

¹⁾ Only for connections with a permitted line length >3 m.

Magnetic fields with electrical frequencies

Test carried out in accordance with EN 61000-4-8	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
Housing, completely wired	30 A/m	
	3 axes	(x, y, z)
	50/60 Hz ¹⁾	
	Crite	eria A

¹⁾ Mains frequency per manufacturer data

Voltage dips

Test carried out in accordance with EN 61000-4-11	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
AC power inputs	0% residual voltage	
	250/300 perio	ods (50/60 Hz) ¹⁾
	20 at	tempts
	Crit	eria C
	40% residual voltage	
	10/12 period	ds (50/60 Hz) ¹⁾
	20 at	tempts
	Criteria C	
	70% resid	dual voltage
	25/30 periods (50/60 Hz) ¹⁾	
	20 at	tempts
Criteria C		eria C

Mains frequency per manufacturer data

Short-term interruptions

Test carried out in accordance with EN 61000-4-11 / EN 61000-4-29	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
AC power inputs	0% residual voltage	0% residual voltage
	0.5 periods (50/60 Hz) ¹⁾	1 period (50/60 Hz) ¹⁾
	20 interruptions	3 interruptions
	Criteria A	Criteria B
DC power inputs	0% residual voltage	-
	≥10 ms (PS2)	
	20 interruptions	
	Criteria A	

¹⁾ Mains frequency per manufacturer data

Voltage fluctuations

Test carried out in accordance with EN 61000-4-11 / EN 61000-4-29	Requirements in accordance with EN 61131-2 / Zone B	Requirements in accordance with EN 61000-6-2
AC power inputs	-15% / +10%	-
	Test duration per 30 minutes	
	Criteria A	
DC power inputs	-15% / +20%	=
	Test duration per 30 minutes	
	Criteria A	

International and national certifications

9.2.3 Emission requirements

Phenomenon	Test carried out in accordance with	Limits in accordance with
		EN 61131-2: Product standard -
Emissions related to lines	EN 55011 / EN 55032	Programmable logic controllers
Emissions related to lines	EN 55016-2-1	EN 61000-6-4: Generic standard -
		Emissions in industrial sectors
		EN 61131-2: Product standard -
Radiated emissions	EN 55011 / EN 55032	Programmable logic controllers
	EN 55016-2-3	EN 61000-6-4: Generic standard -
		Emissions in industrial sectors

Emissions related to lines

Testing performed per EN 55011 / EN 55032 / EN 55016-2-1	Limits in accordance with EN 61131-2 / Zone B	Limits in accordance with EN 61000-6-4		
AC mains connection	150 kHz to 500 kHz			
150 kHz to 30 MHz	79 dB (μV) qu	uasi-peak value		
	66 dB (μV) a	average value		
	500 kHz	to 30 MHz		
	73 dB (μV) qι	uasi-peak value		
	60 dB (μV) average value			
Telecommunications / network connection	-	150 kHz to 500 kHz		
150 kHz to 30 MHz		97 to 87 dB (μV) quasi-peak value 53 to 40 dB (μA) quasi-peak value		
		84 to 74 dB (μV) average value 40 to 30 dB (μA) average value		
	-	500 kHz to 30 MHz		
		87 dB (μV) quasi-peak value		
		43 dB (μA) quasi-peak value		
		74 dB (μV) average value		
		30 dB (μA) average value		

Radiated emissions

Testing performed per EN 55011 / EN 55032 / EN 55016-2-3	Limits in accordance with EN 61131-2 / Zone B	Limits in accordance with EN 61000-6-4		
Electric field / Measured from 10 m	30 MHz	to 230 MHz		
30 MHz to 1 GHz	40 dB (μV/m)	quasi-peak value		
	230 MH	z to 1 GHz		
	47 dB (μV/m) quasi-peak value			
Electric field / Measured from 3 m	-	1 GHz to 3 GHz ¹⁾		
1 GHz to 6 GHz ¹⁾	76 dB (μV/m) peak valu			
		56 dB (μV/m) average value		
	-	3 GHz to 6 GHz ¹⁾		
		80 dB (μV/m) peak value		
		60 dB (μV/m) average value		

¹⁾ Depending on highest internal frequency

9.2.4 Mechanical conditions

Testing	Test carried out in accordance with	Requirements in accordance with
		EN 61131-2: Product standard -
Vibration (sinusoidal) / Operation	EN 60068-2-6	Programmable logic controllers
		EN 60721-3-5 / Class 5M3
		EN 61131-2: Product standard -
Shock / Operation	EN 60068-2-27	Programmable logic controllers
		EN 60721-3-5 / Class 5M3
		EN 60721-3-2 / Class 2M1
Vibration (sinusoidal) / Transport (packaged)	EN 60068-2-6	EN 60721-3-2 / Class 2M2
		EN 60721-3-2 / Class 2M3
Charle / Transport (nactioned)	EN 60060 2 27	EN 60721-3-2 / Class 2M1
Shock / Transport (packaged)	EN 60068-2-27	EN 60721-3-2 / Class 2M2
		EN 61131-2: Product standard -
Free fall / Transport (packaged)	EN 60068-2-311)	Programmable logic controllers
		EN 60721-3-2 / Class 2M1
		EN 60721-3-2 / Class 2M1
Toppling / Transport (packaged)	EN 60068-2-31	EN 60721-3-2 / Class 2M2
		EN 60721-3-2 / Class 2M3

¹⁾ Replacement for EN 60068-2-32

Vibration (sinusoidal) / Operation

Test carried out in accordance with EN 60068-2-6	Requirements in accordance with EN 61131-2		Requirements in accordance with EN 60721-3-5 / Class 5M3		
Vibration (sinusoidal) /	Frequency	Amplitude	Frequency	Amplitude	
Operation ¹⁾	5 to 8.4 Hz	Deflection	2 to 8 Hz	Deflection	
		3.5 mm		7.5 mm	
	8.4 to 150 Hz	Acceleration 1 g ²⁾	8 to 200 Hz	Acceleration 2 g ²⁾	
	-	-	200 to 500 Hz	Acceleration 4 g ²⁾	
		20 sweeps fo	or each axis ³⁾	•	

- 1) Uninterrupted duty with movable frequency in all 3 axes (x, y, z); 1 octave per minute
- 2) $1 g = 10 \text{ m/s}^2$
- 3) 2 sweeps = 1 frequency cycle (fmin \rightarrow fmax \rightarrow fmin)

Shock / Operation

Test carried out in accordance with EN 60068-2-27	Requirements in accordance with EN 61131-2	Requirements in accordance with EN 60721-3-5 / Class 5M3
Shock /	Acceleration 15 g	Acceleration 30 g
Operation ¹⁾	Duration 11 ms	Duration 11 ms
	18 shocks	18 shocks

¹⁾ Pulse (half-sine) stress in all 3 axes (x, y, z)

Vibration (sinusoidal) / Transport (packaged)

Test carried out in accordance with EN 60068-2-6	Requirements in accordance with EN 60721-3-2 / Class 2M1		Requirements in accordance with EN 60721-3-2 / Class 2M2		Requirements in accordance with EN 60721-3-2 / Class 2M3	
Vibration (sinusoidal) /	Frequency	Amplitude	Frequency	Amplitude	Frequency	Amplitude
Transport (packaged) ¹⁾	2 to 9 Hz	Deflection	2 to 9 Hz	Deflection	2 to 8 Hz	Deflection
		3.5 mm		3.5 mm		7.5 mm
	9 to 200 Hz	Acceleration	9 to 200 Hz	Acceleration	8 to 200 Hz	Acceleration
		1 g ²⁾		1 g ²⁾		2 g ²⁾
	200 to 500 Hz	Acceleration	200 to 500 Hz	Acceleration	200 to 500 Hz	Acceleration
		1.5 g ²⁾		1.5 g ²⁾		4 g ²⁾
			20 sweeps fo	or each axis³)		

- 1) Uninterrupted duty with movable frequency in all 3 axes (x, y, z); 1 octave per minute
- 2) $1 g = 10 \text{ m/s}^2$
- 2 sweeps = 1 frequency cycle (fmin → fmax → fmin)

Shock / Transport (packaged)

Test carried out in accordance with EN 60068-2-27	Requirements in accordance with EN 60721-3-2 / Class 2M1	Requirements in accordance with EN 60721-3-2 / Class 2M2	
Shock /	Ту	rpe I	
Transport (packaged) ¹⁾	Accelera	ation 10 g	
	Duration 11 ms		
	18 shocks		
	Type II	Type II	
	-	Acceleration 30 g	
		Duration 6 ms	
		18 shocks	

¹⁾ Pulse (half-sine) stress in all 3 axes (x, y, z)

International and national certifications

Free fall / Transport (packaged)

Tests in accordance with EN 60068-2-31	Requirements in accordance with EN 61131-2 with shipping packaging		•		Requirements in accordance with EN 60721-3-2 / Class 2M1	
Free fall /	Weight	Height	Weight	Height	Weight	Height
Transport (packaged)	<10 kg	1.0 m	<10 kg	0.3 m	<20 kg	0.25 m
	10 to 40 kg	0.5 m	10 to 40 kg	0.3 m	20 to 100 kg	0.25 m
	>40 kg	0.25 m	>40 kg	0.25 m	>100 kg	0.1 m
	5 attempts					

¹⁾ Replacement for EN 60068-2-32

Toppling / Transport (packaged)

Test carried out in accordance with EN 60068-2-31	Requirements in accordance with EN 60721-3-2 / Class 2M1		Requirements in accordance with EN 60721-3-2 / Class 2M2		Requirements in accordance with EN 60721-3-2 / Class 2M3	
Toppling /	Weight	Required	Weight	Required	Weight	Required
Transport (packaged)	<20 kg	Yes	<20 kg	Yes	<20 kg	Yes
	20 to 100 kg	-	20 to 100 kg	Yes	20 to 100 kg	Yes
	>100 kg	-	>100 kg	-	>100 kg	Yes
	Topple on all edges					

9.2.5 Electrical safety

Overvoltage category

Requirement per EN 61131-2	Definition per EN 60664-1
Overvoltage category II	Equipment of "Overvoltage category II" is energy-consuming equipment to be supplied by the fixed installation.

Pollution degree

Requirement per EN 61131-2	Definition per EN 60664-1		
Pollution degree 2	Only non-conductive pollution occurs. Occasionally, however, temporary conductivity caused by conden-		
	sation is to be expected.		

Protection rating provided by enclosure (IP code)

Requirement per manufacturer	Meaning of codes per EN 60529	Meaning for the protection of equipment	Meaning for the protection of personnel
IP67	First number IP 6 x	Dust-proof	Protected against touching dangerous parts with conductor.
	Second number IPx 7	Protected against the effects of temporary submersion in water.	

9.3 UL / CSA

UL



Ind. Cont. Eq. E115267

Canada / USA

Underwriters Laboratories (UL)

Products with this mark are tested by Underwriters Laboratories and listed as "industrial control equipment" in category NRAQ (programmable controllers) with file number E115267.

The mark is valid for the USA and Canada and facilitates the certification of your machines and systems in this economic area.

Standards applied:

UL 508 Standard for industrial control equipment

UL 61010-1 Safety requirements for electrical equipment for measurement, control and laboratory use - Part 1: General re-

quirements

UL 61010-2-201 Standard for safety requirements for electrical equipment for measurement, control and laboratory use - Part

2-201: Particular requirements for control equipment

CSA C22.2 No. 142-M1987 Process control equipment

CSA C22.2 No. 61010-1 Safety requirements for electrical equipment for measurement, control and laboratory use - Part 1: General re-

quirements

CSA C22.2 No. 61010-2-201 Safety requirements for electrical equipment for measurement, control and laboratory use - Part 2-201: Particular

requirements for control equipment



Certificate

Website > Downloads > Certificates > UL > X67 > E115267 UL Certificate of Compliance - X67

CSA HazLoc



Hazardous Locations

HazLoc Cl. I, Div. 2 **Group ABCD** 0-60°C T5

Canada / USA

Canadian Standards Association (CSA)

Products with this mark are certified by the Canadian Standard Association and suitable for use in potentially explosive atmospheres.

The products are listed in CLASS 2258 (Process control equipment - For hazardous locations) with file number 244665.

The X67 system has a hazardous locations certification for class I, division 2. Each certified module is accompanied by an information sheet providing detailed installation and safety guidelines.

The mark is valid for the USA and Canada and facilitates the certification of your machines and systems in this economic area.

Standards applied:

CSA C22.2 No. 0-M1991 General requirements - Canadian electrical code part II

CSA C22.2 No. 142-M1987 Process control equipment

CSA C22.2 No. 213-M1987 Nonincendive electrical equipment for use in class I, division 2 hazardous locations

UL Std No. 916:2007 Energy management equipment

ANSI/ISA 12.12.01:2007 Nonincendive Electrical Equipment for Use in Class I and II, Division 2 and Class III, Division 1 and 2 Hazardous

(Classified) Locations



Certificate

Website > Downloads > Certificate > HazLoc > CSA > X20, X67 > 244665 CSA HazLoc Certificate of Compliance - X20, X67

9.4 Other certifications

KC

Korean Conformity (KC)

Products with this marking have been tested by an accredited testing laboratory and approved for import to the Korean market (based on EU compliance).

RCM



Regulatory Compliance Mark (RCM)

Products with this marking have been tested by an accredited testing laboratory and certified by the ACMA. This marking is valid in Australia/Oceania and simplifies the certification of your machines and systems in these areas (based on EU compliance).

10 Environmentally friendly disposal

All B&R control components are designed to inflict as little harm on the environment as possible.

10.1 Separation of materials

It is necessary to separate different materials so the device can undergo an environmentally friendly recycling process.

Component	Disposal
X67 modules,	Electronics recycling
Cables	
Cardboard box / Paper packaging	Cardboard box / Paper recycling

Disposal must comply with applicable legal regulations.

11 Additional information

11.1 EMC information

11.1.1 Electromagnetic compatibility (EMC)

This refers to the ability of a device or system to function satisfactorily in its electromagnetic environment without introducing unacceptable electromagnetic disturbances into this environment, which also includes other devices.

11.1.2 Interference

Automation systems are generally affected by conducted and radiated electromagnetic interference in their operating locations.

These are then adjusted in test standards and tested for resistance to these disturbances during conformity testing of the products.

Conducted interference via

- Supply lines
- · Process wiring
- · Communication lines
- Grounding

Radiated interference via

- · Openings in metal housings
- Plastic housings (no shielding effect)

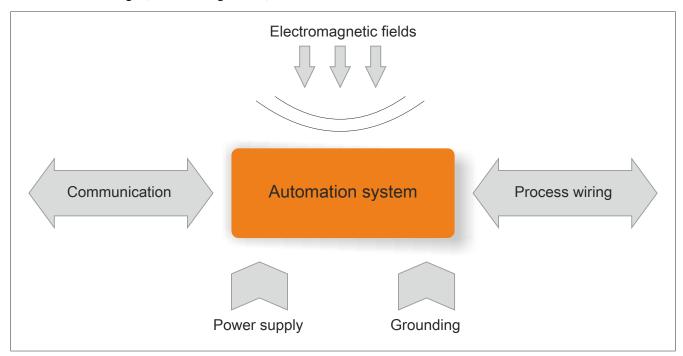


Figure 15: Interference

11.1.3 Types of couplings

Direct coupling

- · Clocked modules
- Startup of a motor
- Differences in potential

Capacitive coupling (electric field)

- Wires running in parallel
- · Static discharge

Inductive coupling (magnetic field)

- · Mains wires running in parallel, connected wires
- · Transformers, motors, etc.

Radiative coupling (electromagnetic field)

- Radio transmitters (mobile telephony, citizens band radio)
- Radio links (welding equipment)

11.1.4 Wiring basics

Wiring arrangement

- · Spatial separation of supply lines and signal lines
- · Always cross wires from individual categories at right angles
- · Ground unused wires on both sides
- · Lay wires along the reference surface as much as possible
- Avoid ground loops as much as possible
- · Lay outgoing and return lines together along the entire length
- · Lay ground and power supply lines together
- · Lay cables in a metallic tray as close to the side walls as possible

Shielded lines

- The cable shield should extend as close as possible to the end of the cable.
- The cable shield should be grounded over as wide an area as possible.
- · The cable shield should always be grounded on both sides.
- The cable shield should be grounded when routing into the control cabinet and again directly at the connector.

Grounding

- · Good conducting connection of all conductive machine components over a wide area
- Connection to ground potential dimensioned with sufficient strength (≥16 mm² to the control cabinet,
 ≥4 mm² to the products)
- Centralized star-shaped grounding point (no loops)

11.1.5 Application-specific measures

When installing the X67 System, no additional measures regarding leakage currents and filters are generally required.

However, specific applications may require this:

11.1.5.1 Switching inductive loads (coils, contactors, relays)

- A load-dependent protective circuit for the outputs is required for various modules. Inductive loads with DC voltage can create voltage reflections that can result in overshoot. This can damage the output devices or shorten their service life.
- Interference suppression of contactor coils

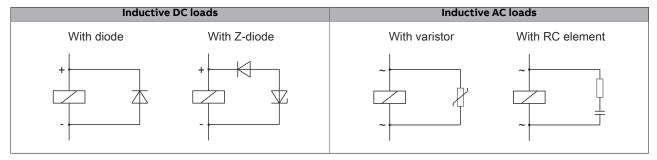


Table 36: Application-specific measures



Notice!

For the use of UL-listed in North and South America, a varistor of UL category "VZCA (surge-protective devices) / Type 2" corresponding to the inductive load is required.

11.1.5.2 Lighting with fluorescent tubes

· Additional interference suppression for control cabinet lighting with fluorescent tubes

11.1.6 Shielded lines

Shielded lines for guaranteeing disturbance-free operation are essential for many applications, for example:

- Fieldbus modules (Ethernet, POWERLINK, X2X Link, CAN bus, etc.)
- · reACTION Technology modules
- Analog modules (inputs and outputs)
- · Counter modules/functions
- PWM outputs
- Safety technology (safety modules)
- Temperature measurement modules
- Motor control
- ACOPOSinverter
- etc.

For all details regarding wiring in accordance with regulations, see the respective user's manual. If not described otherwise, grounding on both sides is preferred. A shield connection on both sides generally provides optimal damping of all coupled interference frequencies.

The use of a shield connection on only one side is not permitted with potential differences. Possible potential differences must be prevented using an equipotential bonding conductor.

11.1.6.1 Recommended cables

Cables available from B&R are recommended for wiring. All available variants and lengths are available in section Accessories or on the B&R website.

For example: Ethernet/POWERLINK




Figure 16: X20/67 cable

(B&R material number: X67CA0E41.xxxx, length specifications: 1 m (xxxx = 0010) to 50 m (xxxx = 0500)).

The following wiring guidelines must be observed:

- Use CAT 5 SF/UTP industrial data cables.
- Observe the minimum cable bend radius (see data sheet for the cable).
- Fasten the cable underneath the bus controller. The cable must be fastened vertically under the female RJ45 connector on the bus controller.
- The customer must implement additional measures in the event of further requirements.

11.1.7 X2X Link settings

To improve the EMC radiation of the X2X Link network, the following settings must be made in Automation Studio:

- 1) Setting the number of stations: By default, the value is set to 64 stations. This value should be set to the number of stations actually present; otherwise, the X2X Link master will search for unavailable stations and amplify the signal.
- 2) Reduce the cable length: Reduce the cable length to the cable length you are actually using.

11.1.8 Environmental characteristics

The table below contains general environmental characteristics.

The product-specific data sheets contain more detailed information about any reduced ambient conditions (derating). These are available under the order number of the respective product on the B&R website (www.br-automation.com) and can be downloaded from there.

The specifications must be checked and taken into account.

General requirements

Characteristics			Specification
Ambient temperature for operation	All modules	-25 to 60°C	Any mounting orientation
Relative humidity for operation	All modules	Up to 100%	Condensing possible
Operating elevation	All modules	0 to 2000 m	Installation elevation above sea level
		>2000 m	See data sheet.
Vibration resistance for operation (EN 60068-2-6)	All modules	2 to 4 g	Requirement per EN 60721-3-5 / class 5M3
Shock resistance for operation (EN 60068-2-27)	All modules	30 g	Requirement per EN 60721-3-5 / class 5M3 (type I)
Overvoltage category (EN 60664-1)	All modules	II	Requirement per EN 61131-2
Pollution degree(EN 60664-1)	All modules	2	Requirement per EN 61131-2
Degree of protection (IP code) (EN 60529)	All X67 modules	IP67	No installation required

 $¹ g = 10 m/s^2$

In addition to the general specifications in this table, the technical data of the respective products must be checked and any necessary derating must be taken into account!

Vibration and shock resistance values are valid only under the condition that the connection lines are installed properly and components are mounted correctly.

Additional information

Definitions per EN 60664-1

Overvoltage category II: Energy-consuming equipment supplied from the fixed installation.

Overvoltage category III: Equipment in fixed installations and for cases in which special requirements are placed on the reliability and avail-

ability of the equipment.

Pollution degree 2: Only non-conductive pollution occurs. Temporary conductivity caused by condensation must occasionally be ex-

pected, however.

Degree of protection provided by enclosure (IP code) per EN 60529

IP20 protection First number IP2x Protection against ingress of solid foreign bodies ≥12.5 mm diameter.

Second number IPx0 Not protected against ingress of water with harmful effects.

IP65 protection First number IP6x Dust-proof

Second number IPx5 Protected against water jets

IP67 protection First number IP6x Dust-proof

Second number IPx7 Protected against temporary submersion

11.2 Using I/O modules on the bus controller

If an I/O module is used after a bus controller, the X2X module registers and functions that can be used depend on the bus controller used.

· Non-configurable bus controllers

By default, "Function model 254 - Bus controller" is used here. This includes:

° CAN I/O bus controllers: X20BC0073, X67BC7321, X67BC7321-1

PROFIBUS bus controllers

Only the X2X module registers listed in the PROFIBUS user's manual can be used for the supported modules. The PROFIBUS user's manual can be downloaded from the B&R website.

PROFINET bus controllers

Only the X2X module registers listed in the GSDML file can be used for the supported modules. This file can be downloaded from the B&R website. The PDF document included in the GSDML package lists all available X2X module registers.

Using the automatic configuration

With all other bus controllers, "Function model 254 - Bus controller" is used by default when using the automatic configuration.

Fully configurable bus controllers

When operating an I/O module on a fully configurable bus controller (e.g. X20BC0043-10), all available functions and registers of the respective I/O module can be used. In this case, "Function model 0 - Standard" is used as the default setting when adding X2X modules in Automation Studio.

If additional function models are available in the I/O module (e.g. "Function model OSP" for digital output modules), they can also be used as long as it makes sense to use them with the bus controller. Full configurations for CANopen, Modbus, EtherCAT, EtherNet/IP and POWERLINK can be made with Automation Studio V4.3 or later.



Information:

Automation Studio can be downloaded at no cost from the B&R website (www.br-automation.com). The evaluation license is permitted to be used to create complete configurations for fieldbus bus controllers at no cost.

Overview of possible configuration types

	CANopen	EtherNet/IP	PROFIBUS	OPC UA	EtherCAT
	X20BC0043-10 X20BC0143-10 X67BC4321-10 X67BC4321.L08-10 X67BC4321.L12-10	X20(c)BC0088 X67BCD321.L12	X20BC0063 X67BC6321 X67BC6321.L08 X67BC6321.L12	X20BC008U	X20BC00G3 X67BCG321.L12
Automatic configuration	•	•		•	•
Full configuration	•	•	•	•	•

	Modbus	PROFINET	CAN I/O	POWERLINK	
	X20(c)BC0087	X20(c)BC00E3	X20BC0073	e.g. X20BC0083	
	X67BCJ321.L12	X67BCE321.L12	X67BC7321-1	e.g. X67BC8321-1	
Automatic configuration	•		•	•	
Full configuration	•	•		•	

11.3 General data points

In addition to the registers listed in the register description, X67 modules also have other more general data points. These registers are not specific to the module but contain general information such as serial number and hardware version.

11.3.1 FirmwareVersion

Name:

FirmwareVersion

The firmware version of the module can be read using this data point.

The last two positions correspond to the number after the decimal point.

Example: 345 corresponds to 3.45.

Data type	Values	Information
UINT	1 to 99	Release version of older modules or developmental versions of new modules
	100 to 29999	Release version
	30000 to 59999	Test version

11.3.2 HardwareVariant

Name:

HardwareVariant

The hardware variant of the module can be read using this data point.

Data type	Values
UINT	0 to 65535

11.3.3 ModuleID

Name:

ModuleID

The module ID of the module can be read using this data point. The module hardware ID can be found in the corresponding module documentation (B&R ID code in the technical data). In addition, a serial number is printed on each electronics module; the module hardware ID corresponds to the first 4 positions of the serial number. (See figure: Hardware ID is also colored black.)



Data type	Values
UINT	0 to 65535



Information:

IDs beginning from 9999 are printed as hexadecimal numbers and must be converted to their decimal values for comparison!

11.3.4 SerialNumber

Name:

SerialNumber

The module's unique serial number can be read using this data point.

The complete serial number is made up of ModuleID and SerialNumber as follows: Serial number = (Hardware ID * 1E+7) + SerialNumber

The serial number is printed in decimal form on the module's housing.

Example

Hardware ID = (decimal) 1213

Serial number = (decimal) 671339

Module serial number = 1213 * 10000000 + 671339 = 12130671339

Data type	Values
UDINT	0 to 4,294,967,295

11.3.5 ModuleOK

Name:

ModuleOK

Whether the module is physically present in the slot or not can be read from this register.

Data type	Value	Information
BOOL	0	Module not ready for operation
	1	Module connected and configured

11.3.6 StaleData

Name:

StaleData

Whether the transferred data originates from the current cycle or a previous cycle can be read using this data point.

This error can result from cycle times that are too short or disturbances in module communication, for example.



Information:

This data point is only valid if ModuleOK = 1.

Data type	Value	Information			
BOOL	0	Data originates from the current cycle			
	1	Data does not originate from the current cycle			

11.4 NetTime Technology

NetTime refers to the ability to precisely synchronize and transfer system times between individual components of the controller or network (controller, I/O modules, X2X Link, POWERLINK, etc.).

This allows the moment that events occur to be determined system-wide with microsecond precision. Upcoming events can also be executed precisely at a specified moment.



11.4.1 Time information

Various time information is available in the controller or on the network:

- System time (on the PLC, Automation PC, etc.)
- X2X Link time (for each X2X Link network)
- POWERLINK time (for each POWERLINK network)
- Time data points of I/O modules

The NetTime is based on 32-bit counters, which are increased with microsecond resolution. The sign of the time information changes after 35 min, 47 s, 483 ms and 648 μ s; an overflow occurs after 71 min, 34 s, 967 ms and 296 μ s.


The initialization of the times is based on the system time during the startup of the X2X Link, the I/O modules or the POWERLINK interface.

Current time information in the application can also be determined via library AsIOTime.

11.4.1.1 Controller data points

The NetTime I/O data points of the controller are latched to each system clock and made available.


11.4.1.2 X2X Link - Reference time point

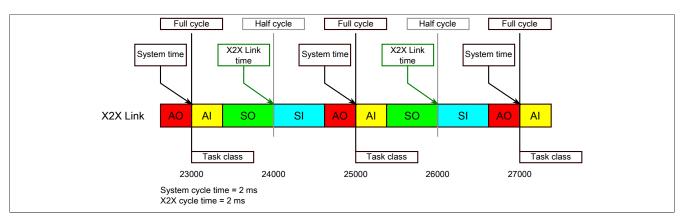

The reference time point on the X2X Link network is always calculated at the half cycle of the X2X Link cycle. This results in a difference between the system time and the X2X Link reference time point when the reference time is read out.

In the example above, this results in a difference of 1 ms, i.e. if the system time and X2X Link reference time are compared at time 25000 in the task, then the system time returns the value 25000 and the X2X Link reference time returns the value 24000.

11.4.1.3 POWERLINK - Reference time point

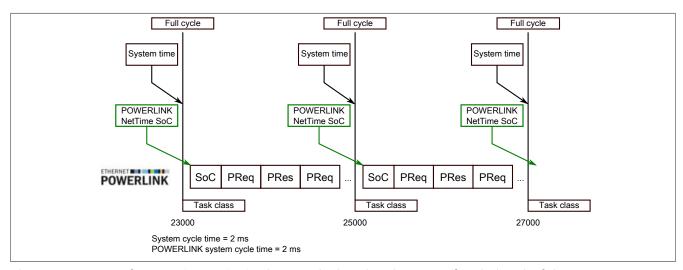


The POWERLINK reference time point is always calculated at the start of cycle (SoC) of the POWERLINK network. The SoC starts $20 \,\mu s$ after the system clock due to the system. This results in the following difference between the system time and the POWERLINK reference time:

POWERLINK reference time = System time - POWERLINK cycle time + 20 μs

In the example above, this means a difference of 1980 μ s, i.e. if the system time and POWERLINK reference time are compared at time 25000 in the task, then the system time returns the value 25000 and the POWERLINK reference time returns the value 23020.

11.4.1.4 Synchronization of system time/POWERLINK time and I/O module

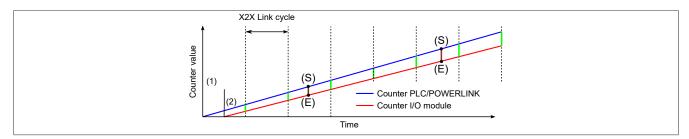

At startup, the internal counters for the controller/POWERLINK (1) and the I/O module (2) start at different times and increase the values with microsecond resolution.

At the beginning of each X2X Link cycle, the controller or POWERLINK network sends time information to the I/O module. The I/O module compares this time information with the module's internal time and forms a difference (green line) between the two times and stores it.

When a NetTime event (E) occurs, the internal module time is read out and corrected with the stored difference value (brown line). This means that the exact system moment (S) of an event can always be determined, even if the counters are not absolutely synchronous.

Note

The deviation from the clock signal is strongly exaggerated in the picture as a red line.

11.4.2 Timestamp functions

NetTime-capable modules provide various timestamp functions depending on the scope of functions. If a timestamp event occurs, the module immediately saves the current NetTime. After the respective data is transferred to the controller, including this precise moment, the controller can then evaluate the data using its own NetTime (or system time), if necessary.

For details, see the respective module documentation.

11.4.2.1 Time-based inputs

NetTime Technology can be used to determine the exact moment of a rising edge at an input. The rising and falling edges can also be detected and the duration between 2 events can be determined.



Information:

The determined moment always lies in the past.

11.4.2.2 Time-based outputs

NetTime Technology can be used to specify the exact moment of a rising edge on an output. The rising and falling edges can also be specified and a pulse pattern generated from them.



Information:

The specified time must always be in the future, and the set X2X Link cycle time must be taken into account for the definition of the moment.

11.4.2.3 Time-based measurements

NetTime Technology can be used to determine the exact moment of a measurement that has taken place. Both the starting and end moment of the measurement can be transmitted.

11.5 Flatstream communication

11.5.1 Introduction

B&R offers an additional communication method for some modules. "Flatstream" was designed for X2X and POWERLINK networks and allows data transfer to be adapted to individual demands. Although this method is not 100% real-time capable, it still allows data transfer to be handled more efficiently than with standard cyclic polling.

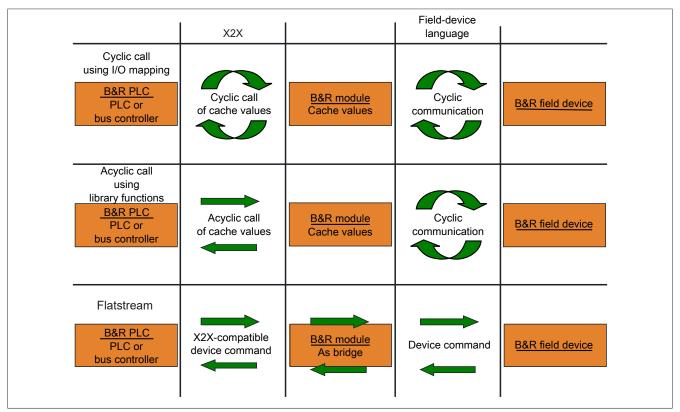


Figure 17: 3 types of communication

Flatstream extends cyclic and acyclic data queries. With Flatstream communication, the module acts as a bridge. The module is used to pass controller requests directly on to the field device.

11.5.2 Message, segment, sequence, MTU

The physical properties of the bus system limit the amount of data that can be transmitted during one bus cycle. With Flatstream communication, all messages are viewed as part of a continuous data stream. Long data streams must be broken down into several fragments that are sent one after the other. To understand how the receiver puts these fragments back together to get the original information, it is important to understand the difference between a message, a segment, a sequence and an MTU.

Message

A message refers to information exchanged between 2 communicating partner stations. The length of a message is not restricted by the Flatstream communication method. Nevertheless, module-specific limitations must be considered.

Segment (logical division of a message):

A segment has a finite size and can be understood as a section of a message. The number of segments per message is arbitrary. So that the recipient can correctly reassemble the transferred segments, each segment is preceded by a byte with additional information. This control byte contains information such as the length of a segment and whether the approaching segment completes the message. This makes it possible for the receiving station to interpret the incoming data stream correctly.

Sequence (how a segment must be arranged physically):

The maximum size of a sequence corresponds to the number of enabled Rx or Tx bytes (later: "MTU"). The transmitting station splits the transmit array into valid sequences. These sequences are then written successively to the MTU and transferred to the receiving station where they are lined up together again. The receiver stores the incoming sequences in a receive array, obtaining an image of the data stream in the process.

With Flatstream communication, the number of sequences sent are counted. Successfully transferred sequences must be acknowledged by the receiving station to ensure the integrity of the transfer.

MTU (Maximum Transmission Unit) - Physical transport:

MTU refers to the enabled USINT registers used with Flatstream. These registers can accept at least one sequence and transfer it to the receiving station. A separate MTU is defined for each direction of communication. OutputMTU defines the number of Flatstream Tx bytes, and InputMTU specifies the number of Flatstream Rx bytes. The MTUs are transported cyclically via the X2X Link network, increasing the load with each additional enabled USINT register.

Properties

Flatstream messages are not transferred cyclically or in 100% real time. Many bus cycles may be needed to transfer a particular message. Although the Rx and Tx registers are exchanged between the transmitter and the receiver cyclically, they are only processed further if explicitly accepted by register "InputSequence" or "OutputSequence".

Behavior in the event of an error (brief summary)

The protocol for X2X and POWERLINK networks specifies that the last valid values should be retained when disturbances occur. With conventional communication (cyclic/acyclic data queries), this type of error can generally be ignored.

In order for communication to also take place without errors using Flatstream, all of the sequences issued by the receiver must be acknowledged. If Forward functionality is not used, then subsequent communication is delayed for the length of the disturbance.

If Forward functionality is being used, the receiving station receives a transmission counter that is incremented twice. The receiver stops, i.e. it no longer returns any acknowledgments. The transmitting station uses SequenceAck to determine that the transfer was faulty and that all affected sequences must be repeated.

11.5.3 The Flatstream principle

Requirements

Before Flatstream can be used, the respective communication direction must be synchronized, i.e. both communication partners cyclically query the sequence counter on the remote station. This checks to see if there is new data that should be accepted.

Communication

If a communication partner wants to transmit a message to its remote station, it should first create a transmit array that corresponds to Flatstream conventions. This allows the Flatstream data to be organized very efficiently without having to block other important resources.

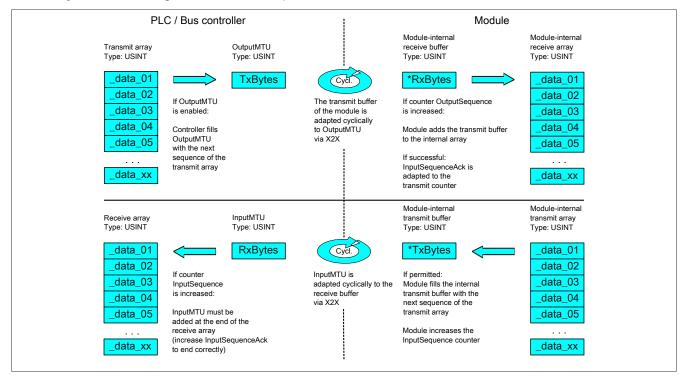


Figure 18: Flatstream communication

Procedure

The first thing that happens is that the message is broken into valid segments of up to 63 bytes, and the corresponding control bytes are created. The data is formed into a data stream made up of one control bytes per associated segment. This data stream can be written to the transmit array. The maximum size of each array element matches that of the enabled MTU so that one element corresponds to one sequence. If the array has been completely created, the transmitter checks whether the MTU is permitted to be refilled. It then copies the first element of the array or the first sequence to the Tx byte registers. The MTU is transported to the receiver station via X2X Link and stored in the corresponding Rx byte registers. To signal that the data should be accepted by the receiver, the transmitter increases its SequenceCounter. If the communication direction is synchronized, the remote station detects the incremented Sequence-Counter. The current sequence is appended to the receive array and acknowledged by SequenceAck. This acknowledgment signals to the transmitter that the MTU can now be refilled.

If the transfer is successful, the data in the receive array will correspond 100% to the data in the transmit array. During the transfer, the receiving station must detect and evaluate the incoming control bytes. A separate receive array should be created for each message. This allows the receiver to immediately begin further processing of messages that are completely transferred.

11.5.4 Registers for Flatstream mode

5 registers are available for configuring Flatstream. The default configuration can be used to transmit small amounts of data relatively easily.



Information:

The controller communicates directly with the field device via registers "OutputSequence" and "InputSequence" as well as the enabled Tx and RxBytes bytes. For this reason, the user must have sufficient knowledge of the communication protocol being used on the field device.

11.5.4.1 Flatstream configuration

To use Flatstream, the program sequence must first be expanded. The cycle time of the Flatstream routines must be set to a multiple of the bus cycle. Other program routines should be implemented in Cyclic #1 to ensure data consistency.

At the absolute minimum, registers "InputMTU" and "OutputMTU" must be set. All other registers are filled in with default values at the beginning and can be used immediately. These registers are used for additional options, e.g. to transfer data in a more compact way or to increase the efficiency of the general procedure.

The Forward registers extend the functionality of the Flatstream protocol. This functionality is useful for substantially increasing the Flatstream data rate, but it also requires quite a bit of extra work when creating the program sequence.



Information:

In the rest of this description, the names "OutputMTU" and "InputMTU" do not refer to the registers names. Instead, they are used as synonyms for the currently enabled Tx or Rx bytes.



Information:

Registers are described in section "Flatstream communication" in the respective data sheets.

11.5.4.2 Flatstream operation

When using Flatstream, the communication direction is very important. For transmitting data to a module (output direction), Tx bytes are used. For receiving data from a module (input direction), Rx bytes are used. Registers "OutputSequence" and "InputSequence" are used to control or secure communication, i.e. the transmitter uses them to give instructions to apply data and the receiver confirms a successfully transferred sequence.



Information:

Registers are described in section "Flatstream communication" in the respective data sheets.

11.5.4.2.1 Format of input and output bytes

Name:

"Format of Flatstream" in Automation Studio

On some modules, this function can be used to set how the Flatstream input and output bytes (Tx or Rx bytes) are transferred.

- Packed: Data is transferred as an array.
- Byte-by-byte: Data is transferred as individual bytes.

11.5.4.2.2 Transporting payload data and control bytes

The Tx and Rx bytes are cyclic registers used to transport the payload data and the necessary control bytes. The number of active Tx and Rx bytes is taken from the configuration of registers "OutputMTU" and "InputMTU", respectively.

In the user program, only the Tx and Rx bytes from the controller can be used. The corresponding counterparts are located in the module and are not accessible to the user. For this reason, the names were chosen from the point of view of the controller.

- "T" "Transmit" → Controller transmits data to the module.
- "R" "Receive" → Controller receives data from the module.

11.5.4.2.2.1 Control bytes

In addition to the payload data, the Tx and Rx bytes also transfer the necessary control bytes. These control bytes contain additional information about the data stream so that the receiver can reconstruct the original message from the transferred segments.

Bit structure of a control byte

Bit	Name	Value	Information
0 - 5	SegmentLength	0 - 63	Size of the subsequent segment in bytes (default: Max. MTU size - 1)
6	nextCBPos	0	Next control byte at the beginning of the next MTU
		1	Next control byte directly after the end of the current segment
7	MessageEndBit	0	Message continues after the subsequent segment
		1	Message ended by the subsequent segment

SegmentLength

The segment length lets the receiver know the length of the coming segment. If the set segment length is insufficient for a message, then the information must be distributed over several segments. In these cases, the actual end of the message is detected using bit 7 (control byte).



Information:

The control byte is not included in the calculation to determine the segment length. The segment length is only derived from the bytes of payload data.

nextCBPos

This bit indicates the position where the next control byte is expected. This information is especially important when using option "MultiSegmentMTU".

When using Flatstream communication with MultiSegmentMTUs, the next control byte is no longer expected in the first Rx byte of the subsequent MTU, but transferred directly after the current segment.

MessageEndBit

"MessageEndBit" is set if the subsequent segment completes a message. The message has then been completely transferred and is ready for further processing.



Information:

In the output direction, this bit must also be set if one individual segment is enough to hold the entire message. The module will only process a message internally if this identifier is detected.

The size of the message being transferred can be calculated by adding all of the message's segment lengths together.

Flatstream formula for calculating message length:

Message [bytes] = Segment lengths (all CBs without ME) + Segment length (of the first CB	СВ	Control byte
with ME)	ME	MessageEndBit

11.5.4.2.3 Communication status

The communication status is determined via registers "OutputSequence" and "InputSequence".

- OutputSequence contains information about the communication status of the controller. It is written by the controller and read by the module.
- InputSequence contains information about the communication status of the module. It is written by the module and should only be read by the controller.

11.5.4.2.3.1 Relationship between OutputSequence and InputSequence

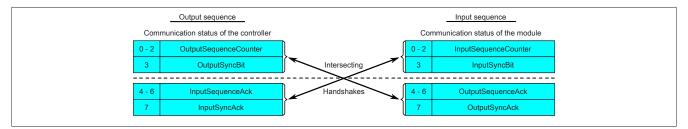


Figure 19: Relationship between OutputSequence and InputSequence

Registers OutputSequence and InputSequence are logically composed of 2 half-bytes. The low part indicates to the remote station whether a channel should be opened or whether data should be accepted. The high part is to acknowledge that the requested action was carried out.

SyncBit and SyncAck

If SyncBit and SyncAck are set in one communication direction, then the channel is considered "synchronized", i.e. it is possible to send messages in this direction. The status bit of the remote station must be checked cyclically. If SyncAck has been reset, then SyncBit on that station must be adjusted. Before new data can be transferred, the channel must be resynchronized.

SequenceCounter and SequenceAck

The communication partners cyclically check whether the low nibble on the remote station changes. When one of the communication partners finishes writing a new sequence to the MTU, it increments its Sequence-Counter. The current sequence is then transmitted to the receiver, which acknowledges its receipt with SequenceAck. In this way, a "handshake" is initiated.



Information:

If communication is interrupted, segments from the unfinished message are discarded. All messages that were transferred completely are processed.

11.5.4.3 Synchronization

During synchronization, a communication channel is opened. It is important to make sure that a module is present and that the current value of SequenceCounter is stored on the station receiving the message. Flatstream can handle full-duplex communication. This means that both channels / communication directions can be handled separately. They must be synchronized independently so that simplex communication can theoretically be carried out as well.

Synchronization in the output direction (controller as the transmitter):

The corresponding synchronization bits (OutputSyncBit and OutputSyncAck) are reset. Because of this, Flatstream cannot be used at this point in time to transfer messages from the controller to the module.

Algorithm

1) The controller must write 000 to OutputSequenceCounter and reset OutputSyncBit.

The controller must cyclically query the high nibble of register "InputSequence" (checks for 000 in OutputSequenceAck and 0 in OutputSyncAck).

The module does not accept the current contents of InputMTU since the channel is not yet synchronized.

The module matches OutputSequenceAck and OutputSyncAck to the values of OutputSequenceCounter and OutputSyncBit.

2) If the controller registers the expected values in OutputSequenceAck and OutputSyncAck, it is permitted to increment OutputSequenceCounter. The controller continues cyclically querying the high nibble of register "OutputSequence" (checks for 001 in OutputSequenceAck and 0 in InputSyn-

The module does not accept the current contents of InputMTU since the channel is not yet synchronized.

The module matches OutputSequenceAck and OutputSyncAck to the values of OutputSequenceCounter and OutputSyncBit.

3) If the controller registers the expected values in OutputSequenceAck and OutputSyncAck, it is permitted to increment OutputSequenceCounter. The controller continues cyclically querying the high nibble of register "OutputSequence" (checks for 001 in OutputSequenceAck and 1 in InputSyncAck).

Note:

Theoretically, data can be transferred from this point forward. However, it is still recommended to wait until the output direction is completely synchronized before transferring data.

The module sets OutputSyncAck

The output direction is synchronized, and the controller can transmit data to the module.

Synchronization in the input direction (controller as the receiver):

The corresponding synchronization bits (InputSyncBit and InputSyncAck) are reset. Because of this, Flatstream cannot be used at this point in time to transfer messages from the module to the controller.

Algorithm

The module writes 000 to InputSequenceCounter and resets InputSyncBit.

The module monitors the high nibble of register "OutputSequence" and expects 000 in InputSequenceAck and 0 in InputSyncAck.

1) The controller is not permitted to accept the current contents of InputMTU since the channel is not yet synchronized.

The controller must match InputSequenceAck and InputSyncAck to the values of InputSequenceCounter and InputSyncBit.

If the module registers the expected values in InputSequenceAck and InputSyncAck, it increments InputSequenceCounter The module monitors the high nibble of register "OutputSequence" and expects 001 in InputSequenceAck and 0 in InputSyncAck.

2) The controller is not permitted to accept the current contents of InputMTU since the channel is not yet synchronized.

The controller must match InputSequenceAck and InputSyncAck to the values of InputSequenceCounter and InputSyncBit.

If the module registers the expected values in InputSequenceAck and InputSyncAck, it sets InputSyncBit. The module monitors the high nibble of register "OutputSequence" and expects 1 in InputSyncAck

3) The controller is permitted to set InputSyncAck.

Theoretically, data could already be transferred in this cycle.

If InputSyncBit is set and InputSequenceCounter has been increased by 1, the values in the enabled Rx bytes must be accepted and acknowledged (see also "Communication in the input direction").

The input direction is synchronized, and the module can transmit data to the controller.

11.5.4.4 Transmitting and receiving

If a channel is synchronized, then the remote station is ready to receive messages from the transmitter. Before the transmitter can send data, it must first create a transmit array in order to meet Flatstream requirements.

The transmitting station must also generate a control byte for each segment created. This control byte contains information about how the subsequent part of the data being transferred should be processed. The position of the next control byte in the data stream can vary. For this reason, it must be clearly defined at all times when a new control byte is being transmitted. The first control byte is always in the first byte of the first sequence. All subsequent positions are determined recursively.

Flatstream formula for calculating the position of the next control byte:

Position (of the next control byte) = Current position + 1 + Segment length

Example

3 autonomous messages (7 bytes, 2 bytes and 9 bytes) are being transmitted using an MTU with a width of 7 bytes. The rest of the configuration corresponds to the default settings.

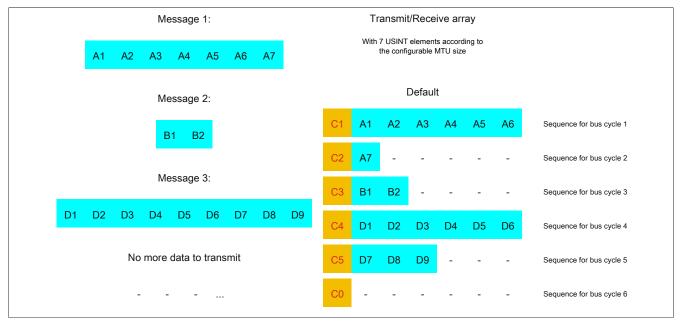


Figure 20: Transmit/Receive array (default)

Additional information

The messages must first be split into segments. In the default configuration, it is important to ensure that each sequence can hold an entire segment, including the associated control byte. The sequence is limited to the size of the enable MTU. In other words, a segment must be at least 1 byte smaller than the MTU.

MTU = 7 bytes \rightarrow Max. segment length = 6 bytes

- Message 1 (7 bytes)
 - ⇒ First segment = Control byte + 6 bytes of data
 - ⇒ Second segment = Control byte + 1 data byte
- Message 2 (2 bytes)
 - ⇒ First segment = Control byte + 2 bytes of data
- Message 3 (9 bytes)
 - ⇒ First segment = Control byte + 6 bytes of data
 - ⇒ Second segment = Control byte + 3 data bytes
- No more messages
 - ⇒ C0 control byte

A unique control byte must be generated for each segment. In addition, the C0 control byte is generated to keep communication on standby.

C0 (control byte 0)			C1 (control byte 1)			C2 (control byte 2)		
- SegmentLength (0)	=	0	- SegmentLength (6)	=	6	- SegmentLength (1)	=	1
- nextCBPos (0)	=	0	- nextCBPos (0)	=	0	- nextCBPos (0)	=	0
- MessageEndBit (0)	=	0	- MessageEndBit (0)	=	0	- MessageEndBit (1)	=	128
Control byte	Σ	0	Control byte	Σ	6	Control byte	Σ	129

Table 37: Flatstream determination of the control bytes for the default configuration example (part 1)

C3 (control byte 3)			C4 (control byte 4)			C5 (control byte 5)		
- SegmentLength (2)	=	2	- SegmentLength (6)	=	6	- SegmentLength (3)	=	3
- nextCBPos (0)	=	0	- nextCBPos (0)	=	0	- nextCBPos (0)	=	0
- MessageEndBit (1)	=	128	- MessageEndBit (0)	=	0	- MessageEndBit (1)	=	128
Control byte	Σ	130	Control byte	Σ	6	Control byte	Σ	131

Table 38: Flatstream determination of the control bytes for the default configuration example (part 2)

11.5.4.4.1 Transmitting data to a module (output)

When transmitting data, the transmit array must be generated in the application program. Sequences are then transferred one by one using Flatstream and received by the module.



Information:

Although all B&R modules with Flatstream communication always support the most compact transfers in the output direction, it is recommended to use the same design for the transfer arrays in both communication directions.

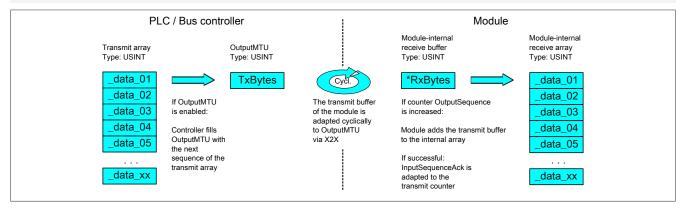


Figure 21: Flatstream communication (output)

Message smaller than OutputMTU

The length of the message is initially smaller than OutputMTU. In this case, one sequence would be sufficient to transfer the entire message and the necessary control byte.

Algorithm

Cyclic status query:

- The module monitors OutputSequenceCounter.

0) Cyclic checks:

- The controller must check OutputSyncAck.
- → If OutputSyncAck = 0: Reset OutputSyncBit and resynchronize the channel.
- The controller must check whether OutputMTU is enabled.
- → If OutputSequenceCounter > InputSequenceAck: MTU is not enabled because the last sequence has not yet been acknowledged.
- 1) Preparation (create transmit array):
- The controller must split up the message into valid segments and create the necessary control bytes.
- The controller must add the segments and control bytes to the transmit array.

2) Transmit:

- The controller transfers the current element of the transmit array to OutputMTU.
- ightarrow OutputMTU is transferred cyclically to the module's transmit buffer but not processed further.
- The controller must increase OutputSequenceCounter.

Reaction

- The module accepts the bytes from the internal receive buffer and adds them to the internal receive array.
- The module transmits acknowledgment and writes the value of OutputSequenceCounter to OutputSequenceAck

3) Completion:

- The controller must monitor OutputSequenceAck.
- → A sequence is only considered to have been transferred successfully if it has been acknowledged via OutputSequenceAck. In order to detect potential transfer errors in the last sequence as well, it is important to make sure that the length of the Completion phase is run through long enough.

Note

To monitor communication times exactly, the task cycles that have passed since the last increase of OutputSequenceCounter should be counted. In this way, the number of previous bus cycles necessary for the transfer can be measured. If the monitoring counter exceeds a predefined threshold, then the sequence can be considered lost.

(The relationship of bus to task cycle can be influenced by the user so that the threshold value must be determined individually.)

- Subsequent sequences are only permitted to be transmitted in the next bus cycle after the completion check has been carried out successfully.

Additional information

Message larger than OutputMTU

The transmit array, which must be created in the program sequence, consists of several elements. The user must arrange the control and data bytes correctly and transfer the array elements one after the other. The transfer algorithm remains the same and is repeated starting at the point Cyclic checks.

General flowchart

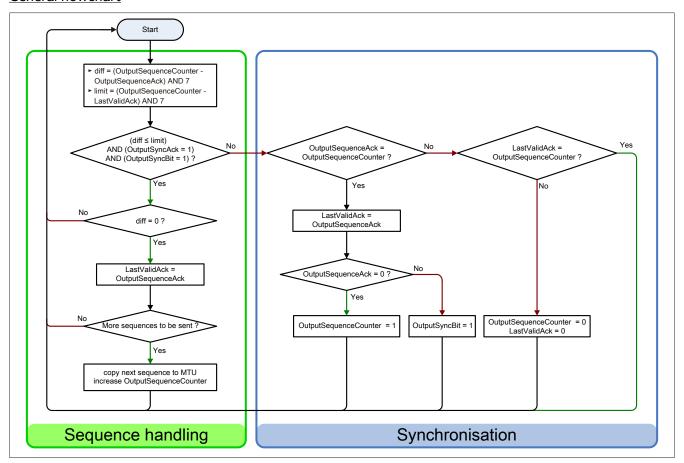


Figure 22: Flowchart for the output direction

11.5.4.4.2 Receiving data from a module (input)

When receiving data, the transmit array is generated by the module, transferred via Flatstream and must then be reproduced in the receive array. The structure of the incoming data stream can be set with the mode register. The algorithm for receiving the data remains unchanged in this regard.

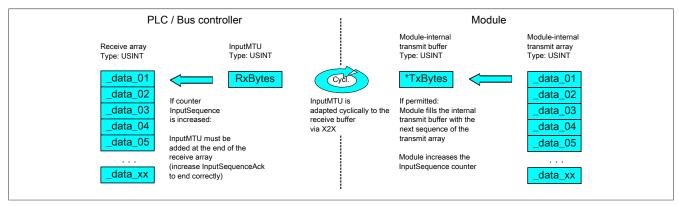


Figure 23: Flatstream communication (input)

Algorithm

0) Cyclic status query:

The controller must monitor InputSequenceCounter.

Cyclic checks:

- The module checks InputSyncAck.
- The module checks InputSequenceAck

Preparation:

- The module forms the segments and control bytes and creates the transmit array.

Action:

- The module transfers the current element of the internal transmit array to the internal transmit buffer.
- The module increases InputSequenceCounter.
- 1) Receiving (as soon as InputSequenceCounter is increased):
- The controller must apply data from InputMTU and append it to the end of the receive array.
- The controller must match InputSequenceAck to InputSequenceCounter of the sequence currently being processed.

Completion:

- The module monitors InputSequenceAck.
- ightarrow A sequence is only considered to have been transferred successfully if it has been acknowledged via InputSequenceAck.
- Subsequent sequences are only transmitted in the next bus cycle after the completion check has been carried out successfully.

General flowchart

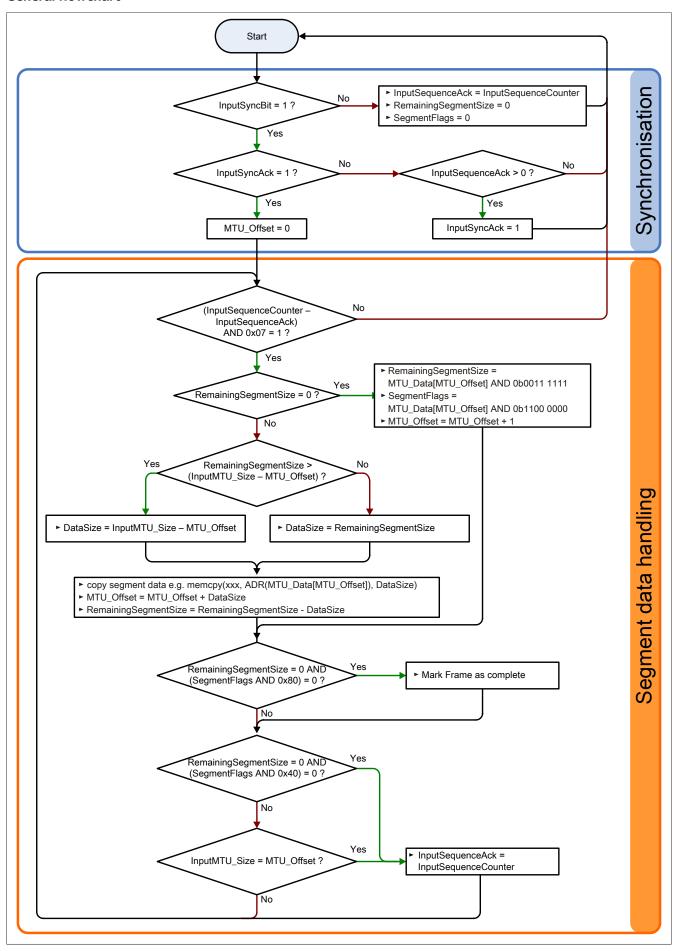


Figure 24: Flowchart for the input direction

11.5.4.4.3 Details

It is recommended to store transferred messages in separate receive arrays.

After a set MessageEndBit is transmitted, the subsequent segment should be added to the receive array. The message is then complete and can be passed on internally for further processing. A new/separate array should be created for the next message.



Information:

When transferring with MultiSegmentMTUs, it is possible for several small messages to be part of one sequence. In the program, it is important to make sure that a sufficient number of receive arrays can be managed. The acknowledge register is only permitted to be adjusted after the entire sequence has been applied.

If SequenceCounter is incremented by more than one counter, an error is present.

In this case, the receiver stops. All additional incoming sequences are ignored until the transmission with the correct SequenceCounter is retried. This response prevents the transmitter from receiving any more acknowledgments for transmitted sequences. The transmitter can identify the last successfully transferred sequence from the remote station's SequenceAck and continue the transfer from this point.



Information:

This situation is very unlikely when operating without "Forward" functionality.

Acknowledgments must be checked for validity.

If the receiver has successfully accepted a sequence, it must be acknowledged. The receiver takes on the value of SequenceCounter sent along with the transmission and matches SequenceAck to it. The transmitter reads SequenceAck and registers the successful transmission. If the transmitter acknowledges a sequence that has not yet been dispatched, then the transfer must be interrupted and the channel resynchronized. The synchronization bits are reset and the current/incomplete message is discarded. It must be sent again after the channel has been resynchronized.

11.5.4.5 Flatstream mode

In the input direction, the transmit array is generated automatically. Flatstream mode offers several options to the user that allow an incoming data stream to have a more compact arrangement. These include:

- Standard
- MultiSegmentMTU allowed
- Large segments allowed:

Once enabled, the program code for evaluation must be adapted accordingly.



Information:

All B&R modules that offer Flatstream mode support options "Large segments" and "MultiSegmentMTU" in the output direction. Compact transfer must be explicitly allowed only in the input direction.

Standard

By default, both options relating to compact transfer in the input direction are disabled.

- 1. The module only forms segments that are at least one byte smaller than the enabled MTU. Each sequence begins with a control byte so that the data stream is clearly structured and relatively easy to evaluate.
- Since a Flatstream message is permitted to be any length, the last segment of the message frequently does not fill up all of the MTU's space. By default, the remaining bytes during this type of transfer cycle are not used.

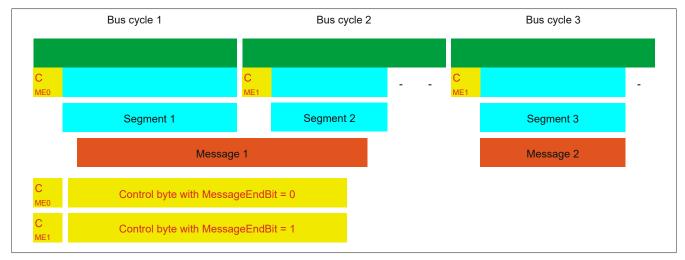


Figure 25: Message arrangement in the MTU (default)

MultiSegmentMTU allowed

With this option, InputMTU is completely filled (if enough data is pending). The previously unfilled Rx bytes transfer the next control bytes and their segments. This allows the enabled Rx bytes to be used more efficiently.

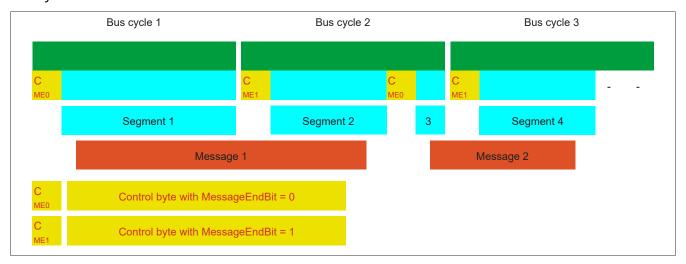


Figure 26: Arrangement of messages in the MTU (MultiSegmentMTU)

Large segments allowed:

When transferring very long messages or when enabling only very few Rx bytes, then a great many segments must be created by default. The bus system is more stressed than necessary since an additional control byte must be created and transferred for each segment. With option "Large segments", the segment length is limited to 63 bytes independently of InputMTU. One segment is permitted to stretch across several sequences, i.e. it is possible for "pure" sequences to occur without a control byte.



Information:

It is still possible to split up a message into several segments, however. If this option is used and messages with more than 63 bytes occur, for example, then messages can still be split up among several segments.

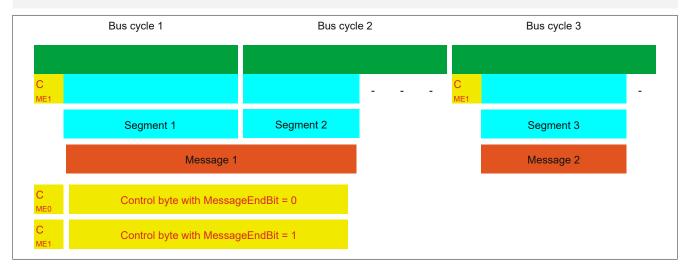


Figure 27: Arrangement of messages in the MTU (large segments)

Using both options

Using both options at the same time is also permitted.

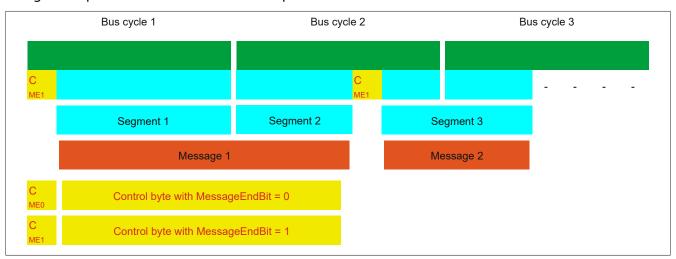


Figure 28: Arrangement of messages in the MTU (large segments and MultiSegmentMTU)

11.5.4.6 Adjusting the Flatstream

If the way messages are structured is changed, then the way data in the transmit/receive array is arranged is also different. The following changes apply to the example given earlier.

MultiSegmentMTU

If MultiSegmentMTUs are allowed, then "open positions" in an MTU can be used. These "open positions" occur if the last segment in a message does not fully use the entire MTU. MultiSegmentMTUs allow these bits to be used to transfer the subsequent control bytes and segments. In the program sequence, the "nextCB-Pos" bit in the control byte is set so that the receiver can correctly identify the next control byte.

Example

3 autonomous messages (7 bytes, 2 bytes and 9 bytes) are being transmitted using an MTU with a width of 7 bytes. The configuration allows the transfer of MultiSegmentMTUs.

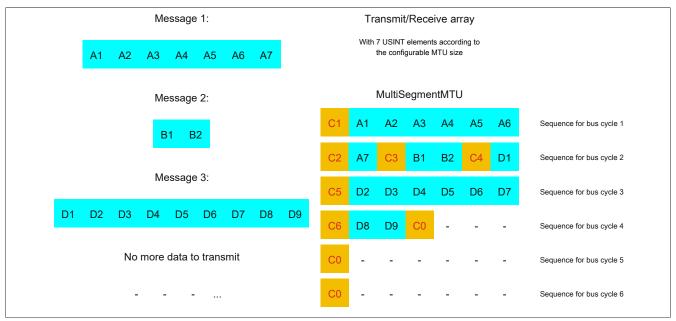


Figure 29: Transmit/Receive array (MultiSegmentMTU)

The messages must first be split into segments. As in the default configuration, it is important for each sequence to begin with a control byte. The free bits in the MTU at the end of a message are filled with data from the following message, however. With this option, the "nextCBPos" bit is always set if payload data is transferred after the control byte.

MTU = 7 bytes → Max. segment length = 6 bytes

- Message 1 (7 bytes)
 - ⇒ First segment = Control byte + 6 bytes of data (MTU full)
 - ⇒ Second segment = Control byte + 1 byte of data (MTU still has 5 open bytes)
- Message 2 (2 bytes)
 - ⇒ First segment = Control byte + 2 bytes of data (MTU still has 2 open bytes)
- · Message 3 (9 bytes)
 - ⇒ First segment = Control byte + 1 byte of data (MTU full)
 - ⇒ Second segment = Control byte + 6 bytes of data (MTU full)
 - ⇒ Third segment = Control byte + 2 bytes of data (MTU still has 4 open bytes)
- No more messages
 - ⇒ C0 control byte

A unique control byte must be generated for each segment. In addition, the C0 control byte is generated to keep communication on standby.

C1 (control byte 1)			C2 (control byte 2)			C3 (control byte 3)		
- SegmentLength (6)	=	6	- SegmentLength (1)	=	1	- SegmentLength (2)	=	2
- nextCBPos (1)	=	64	- nextCBPos (1)	=	64	- nextCBPos (1)	=	64
- MessageEndBit (0)	=	0	- MessageEndBit (1)	=	128	- MessageEndBit (1)	=	128
Control byte	Σ	70	Control byte	Σ	193	Control byte	Σ	194

Table 39: Flatstream determination of the control bytes for the MultiSegmentMTU example (part 1)



Warning!

The second sequence is only permitted to be acknowledged via SequenceAck if it has been completely processed. In this example, there are 3 different segments within the second sequence, i.e. the program must include enough receive arrays to handle this situation.

C4 (control byte 4)			C5 (control byte 5)			C6 (control byte 6)		
- SegmentLength (1)	=	1	- SegmentLength (6)	=	6	- SegmentLength (2)	=	2
- nextCBPos (6)	=	6	- nextCBPos (1)	=	64	- nextCBPos (1)	=	64
- MessageEndBit (0)	=	0	- MessageEndBit (1)	=	0	- MessageEndBit (1)	=	128
Control byte	Σ	7	Control byte	Σ	70	Control byte	Σ	194

Table 40: Flatstream determination of the control bytes for the MultiSegmentMTU example (part 2)

Large segments

Segments are limited to a maximum of 63 bytes. This means they can be larger than the active MTU. These large segments are divided among several sequences when transferred. It is possible for sequences to be completely filled with payload data and not have a control byte.



Information:

It is still possible to subdivide a message into several segments so that the size of a data packet does not also have to be limited to 63 bytes.

Example

3 autonomous messages (7 bytes, 2 bytes and 9 bytes) are being transmitted using an MTU with a width of 7 bytes. The configuration allows the transfer of large segments.

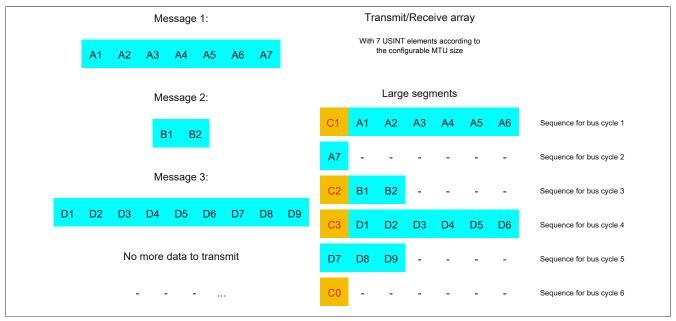


Figure 30: Transmit/receive array (large segments)

The messages must first be split into segments. The ability to form large segments means that messages are split up less frequently, which results in fewer control bytes generated.

Large segments allowed → Max. segment length = 63 bytes

- Message 1 (7 bytes)
 - ⇒ First segment = Control byte + 7 bytes of data
- Message 2 (2 bytes)
 - ⇒ First segment = Control byte + 2 bytes of data
- · Message 3 (9 bytes)
 - ⇒ First segment = Control byte + 9 bytes of data
- · No more messages
 - ⇒ C0 control byte

A unique control byte must be generated for each segment. In addition, the C0 control byte is generated to keep communication on standby.

C1 (control byte 1)			C2 (control byte 2)			C3 (control byte 3)		
- SegmentLength (7)	=	7	- SegmentLength (2)	=	2	- SegmentLength (9)	=	9
- nextCBPos (0)	=	0	- nextCBPos (0)	=	0	- nextCBPos (0)	=	0
- MessageEndBit (1)	=	128	- MessageEndBit (1)	=	128	- MessageEndBit (1)	=	128
Control byte	Σ	135	Control byte	Σ	130	Control byte	Σ	137

Table 41: Flatstream determination of the control bytes for the large segment example

Large segments and MultiSegmentMTU

Example

3 autonomous messages (7 bytes, 2 bytes and 9 bytes) are being transmitted using an MTU with a width of 7 bytes. The configuration allows transfer of large segments as well as MultiSegmentMTUs.

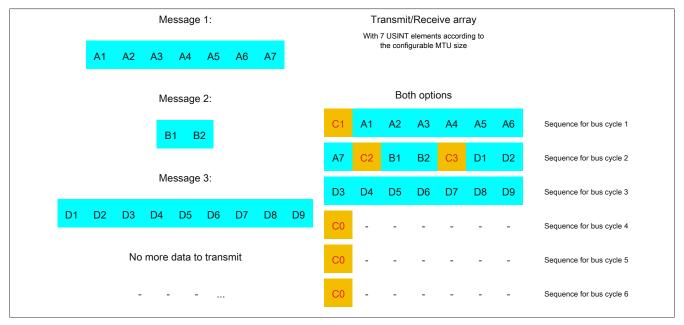


Figure 31: Transmit/Receive array (large segments and MultiSegmentMTU)

The messages must first be split into segments. If the last segment of a message does not completely fill the MTU, it is permitted to be used for other data in the data stream. Bit "nextCBPos" must always be set if the control byte belongs to a segment with payload data.

The ability to form large segments means that messages are split up less frequently, which results in fewer control bytes generated. Control bytes are generated in the same way as with option "Large segments".

Large segments allowed \rightarrow Max. segment length = 63 bytes

- Message 1 (7 bytes)
 - ⇒ First segment = Control byte + 7 bytes of data
- Message 2 (2 bytes)
 - ⇒ First segment = Control byte + 2 bytes of data
- Message 3 (9 bytes)
 - ⇒ First segment = Control byte + 9 bytes of data
- No more messages
 - ⇒ C0 control byte

A unique control byte must be generated for each segment. In addition, the C0 control byte is generated to keep communication on standby.

C1 (control byte 1)			C2 (control byte 2)	·			C3 (control byte 3)		
- SegmentLength (7)	=	7	- SegmentLength (2)	=	=	2	- SegmentLength (9)	=	9
- nextCBPos (0)	=	0	- nextCBPos (0)	=	=	0	- nextCBPos (0)	=	0
- MessageEndBit (1)	=	128	- MessageEndBit (1)	=		128	- MessageEndBit (1)	=	128
Control byte	Σ	135	Control byte	Σ	Σ	130	Control byte	Σ	137

Table 42: Flatstream determination of the control bytes for the large segment and MultiSegmentMTU example

11.5.5 Example of function "Forward" with X2X Link

Function "Forward" is a method that can be used to substantially increase the Flatstream data rate. The basic principle is also used in other technical areas such as "pipelining" for microprocessors.

11.5.5.1 Function principle

X2X Link communication cycles through 5 different steps to transfer a Flatstream sequence. At least 5 bus cycles are therefore required to successfully transfer the sequence.

	Step I		Step II		Step III		Step I	V		Step V	
	Transfer sequence from transmit array, increase Sequence- Counter		Cyclic synch MTU and mo	ronization of odule buffer	ceive arra	sequence to re ay, quenceAck		synchroniza and module b		Check Sequence	eAck
esource	Transmitter (task to transm	nit)	Bus system (direction 1)		Recipient (task to r		Bus sy (direc	rstem tion 2)		Transmitter (task for Ack che	eckin
Sequence	e 1 Step I	Step II	Step III	Step IV	Step V	T		T	T		
Sequence	e 2					Step I	Step II	Step III	Step IV	Step V	·
Sequence	e 3	T									
		<u> </u>									
	Bus cycle 1	Bus cycle 2	Bus cycle 3	Bus cycle 4	Bus cycle 5	Bus cycle 6 Bu	ıs cycle 7	Bus cycle 8	Bus cycle	9 Bus cycle 10	
	Bus cycle 1	Bus cycle 2	Bus cycle 3	Bus cycle 4	Bus cycle 5	Bus cycle 6 Bu	ıs cycle 7	Bus cycle 8	Bus cycle	9 Bus cycle 10	>
Sequence	,	Bus cycle 2	Bus cycle 3	Bus cycle 4 Step IV	Bus cycle 5 Step V	Bus cycle 6 Bu	is cycle 7	Bus cycle 8	Bus cycle		>
Sequence Sequence	e 1 Step I	,		·	•	Bus cycle 6 Bu	is cycle 7	Bus cycle 8	Bus cycle		>
<u> </u>	e 1 Step I	Step II	Step III	Step IV	Step V	Step V	s cycle 7	Bus cycle 8	Bus cycle		>

Figure 32: Comparison of transfer without/with Forward

Each of the 5 steps (tasks) requires different resources. If Forward functionality is not used, the sequences are executed one after the other. Each resource is then only active if it is needed for the current sub-action. With Forward, a resource that has executed its task can already be used for the next message. The condition for enabling the MTU is changed to allow for this. Sequences are then passed to the MTU according to the timing. The transmitting station no longer waits for an acknowledgment from SequenceAck, which means that the available bandwidth can be used much more efficiently.

In the most ideal situation, all resources are working during each bus cycle. The receiver must still acknowledge every sequence received. Only when SequenceAck has been changed and checked by the transmitter is the sequence considered as having been transferred successfully.

11.5.5.2 Configuration

The Forward function must only be enabled for the input direction. Flatstream modules have been optimized in such a way that they support this function. In the output direction, the Forward function can be used as soon as the size of OutputMTU is specified.



Information:

Registers are described in section "Flatstream communication" in the respective data sheets.

11.5.5.2.1 Delay time

The delay time is specified in microseconds. This is the amount of time the module must wait after sending a sequence until it is permitted to write new data to the MTU in the following bus cycle. The program routine for receiving sequences from a module can therefore be run in a task class whose cycle time is slower than the bus cycle.

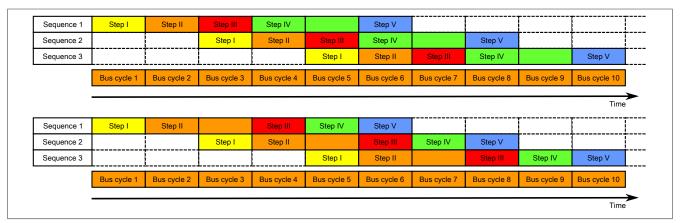


Figure 33: Effect of ForwardDelay when using Flatstream communication with the Forward function

In the program, it is important to make sure that the controller is processing all of the incoming InputSequences and InputMTUs. The ForwardDelay value causes delayed acknowledgment in the output direction and delayed reception in the input direction. In this way, the controller has more time to process the incoming InputSequence or InputMTU.

11.5.5.3 Transmitting and receiving with Forward

The basic algorithm for transmitting and receiving data remains the same. With the Forward function, up to 7 unacknowledged sequences can be transmitted. Sequences can be transmitted without having to wait for the previous message to be acknowledged. Since the delay between writing and response is eliminated, a considerable amount of additional data can be transferred in the same time window.

Algorithm for transmitting

Cyclic status query:

- The module monitors OutputSequenceCounter.

0) Cyclic checks:

- The controller must check OutputSyncAck.
- → If OutputSyncAck = 0: Reset OutputSyncBit and resynchronize the channel.
- The controller must check whether OutputMTU is enabled.
- → If OutputSequenceCounter > OutputSequenceAck + 7, then it is not enabled because the last sequence has not yet been acknowledged.

1) Preparation (create transmit array):

- The controller must split up the message into valid segments and create the necessary control bytes.
- The controller must add the segments and control bytes to the transmit array.

2) Transmit:

- The controller must transfer the current part of the transmit array to OutputMTU.
- The controller must increase OutputSequenceCounter for the sequence to be accepted by the module.
- The controller is then permitted to transmit in the next bus cycle if the MTU has been enabled.

The module responds since OutputSequenceCounter > OutputSequenceAck:

- The module accepts data from the internal receive buffer and appends it to the end of the internal receive array.
- The module is acknowledged and the currently received value of OutputSequenceCounter is transferred to OutputSequenceAck.
- The module queries the status cyclically again.

3) Completion (acknowledgment):

- The controller must check OutputSequenceAck cyclically.
- → A sequence is only considered to have been transferred successfully if it has been acknowledged via OutputSequenceAck. In order to detect potential transfer errors in the last sequence as well, it is important to make sure that the algorithm is run through long enough.

Note:

To monitor communication times exactly, the task cycles that have passed since the last increase of OutputSequenceCounter should be counted. In this way, the number of previous bus cycles necessary for the transfer can be measured. If the monitoring counter exceeds a predefined threshold, then the sequence can be considered lost (the relationship of bus to task cycle can be influenced by the user so that the threshold value must be determined individually).

Algorithm for receiving

0) Cyclic status query:

- The controller must monitor InputSequenceCounter.

Cyclic checks:

- The module checks InputSyncAck.
- The module checks if InputMTU for enabling.
- ightarrow Enabling criteria: InputSequenceCounter > InputSequenceAck + Forward

Preparation:

- The module forms the control bytes / segments and creates the transmit array.

Action:

- The module transfers the current part of the transmit array to the receive buffer.
- The module increases InputSequenceCounter.
- The module waits for a new bus cycle after time from ForwardDelay has expired.
- The module repeats the action if InputMTU is enabled.

1) Receiving (InputSequenceCounter > InputSequenceAck):

- The controller must apply data from InputMTU and append it to the end of the receive array.
- The controller must match InputSequenceAck to InputSequenceCounter of the sequence currently being processed.

Completion:

- The module monitors InputSequenceAck.
- o A sequence is only considered to have been transferred successfully if it has been acknowledged via InputSequenceAck.

Details/Background

1. Illegal SequenceCounter size (counter offset)

Error situation: MTU not enabled

If the difference between SequenceCounter and SequenceAck during transmission is larger than permitted, a transfer error occurs. In this case, all unacknowledged sequences must be repeated with the old SequenceCounter value.

2. Checking an acknowledgment

After an acknowledgment has been received, a check must verify whether the acknowledged sequence has been transmitted and had not yet been unacknowledged. If a sequence is acknowledged multiple times, a severe error occurs. The channel must be closed and resynchronized (same behavior as when not using Forward).



Information:

In exceptional cases, the module can increment OutputSequenceAck by more than 1 when using Forward.

An error does not occur in this case. The controller is permitted to consider all sequences up to the one being acknowledged as having been transferred successfully.

3. Transmit and receive arrays

The Forward function has no effect on the structure of the transmit and receive arrays. They are created and must be evaluated in the same way.

11.5.5.4 Errors when using Forward

In industrial environments, it is often the case that many different devices from various manufacturers are being used side by side. The electrical and/or electromagnetic properties of these technical devices can sometimes cause them to interfere with one another. These kinds of situations can be reproduced and protected against in laboratory conditions only to a certain point.

Precautions have been taken for transfer via X2X Link in case such interference should occur. For example, if an invalid checksum occurs, the I/O system will ignore the data from this bus cycle and the receiver receives the last valid data once more. With conventional (cyclic) data points, this error can often be ignored. In the following cycle, the same data point is again retrieved, adjusted and transferred.

Using Forward functionality with Flatstream communication makes this situation more complex. The receiver receives the old data again in this situation as well, i.e. the previous values for SequenceAck/SequenceCounter and the old MTU.

Loss of acknowledgment (SequenceAck)

If a SequenceAck value is lost, then the MTU was already transferred properly. For this reason, the receiver is permitted to continue processing with the next sequence. The SequenceAck is aligned with the associated SequenceCounter and sent back to the transmitter. Checking the incoming acknowledgments shows that all sequences up to the last one acknowledged have been transferred successfully (see sequences 1 and 2 in the image).

Additional information

Loss of transmission (SequenceCounter, MTU):

If a bus cycle drops out and causes the value of SequenceCounter and/or the filled MTU to be lost, then no data reaches the receiver. At this point, the transmission routine is not yet affected by the error. The time-controlled MTU is released again and can be rewritten to.

The receiver receives SequenceCounter values that have been incremented several times. For the receive array to be put together correctly, the receiver is only permitted to process transmissions whose Sequence-Counter has been increased by one. The incoming sequences must be ignored, i.e. the receiver stops and no longer transmits back any acknowledgments.

If the maximum number of unacknowledged sequences has been sent and no acknowledgments are returned, the transmitter must repeat the affected SequenceCounter and associated MTUs (see sequence 3 and 4 in the image).

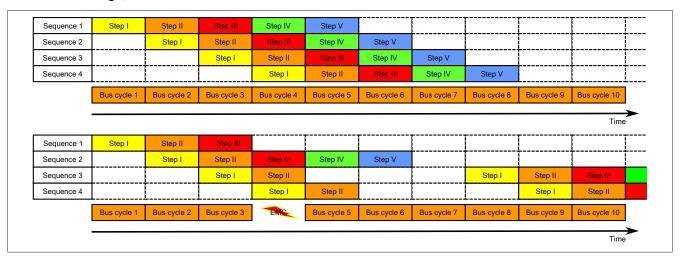


Figure 34: Effect of a lost bus cycle

Loss of acknowledgment

In sequence 1, the acknowledgment is lost due to disturbance. Sequences 1 and 2 are therefore acknowledged in Step V of sequence 2.

Loss of transmission

In sequence 3, the entire transmission is lost due to disturbance. The receiver stops and no longer sends back any acknowledgments.

The transmitting station continues transmitting until it has issued the maximum permissible number of unacknowledged transmissions.

5 bus cycles later at the earliest (depending on the configuration), it begins resending the unsuccessfully sent transmissions.