




### Mechanical features

#### Fixing

Front lateral  
mounting

#### Dimensions

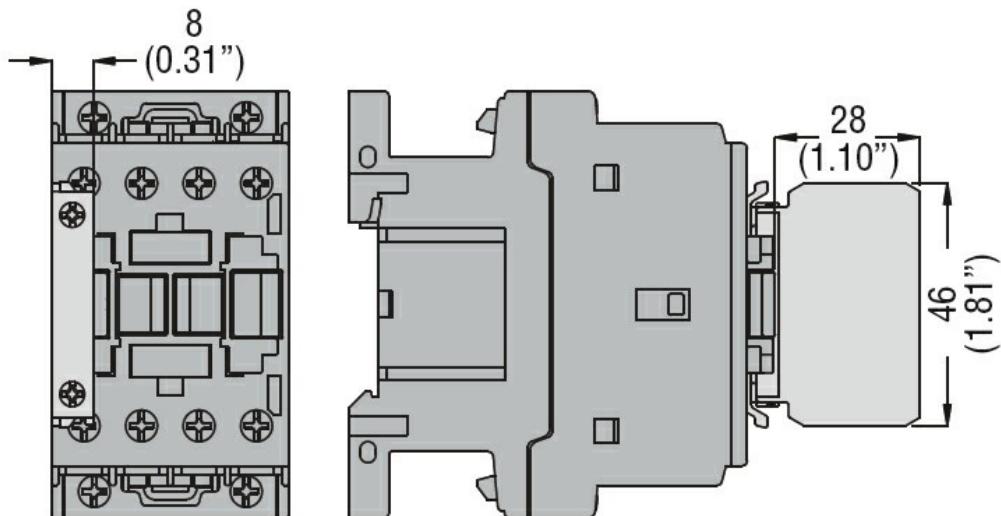

### Wiring diagrams

02

91



96

05

### Certifications and compliance

#### Compliance

CSA C22.2 n° 60947-1

CSA C22.2 n° 60947-5-1

IEC/EN 60947-1

IEC/EN 60947-5-1

UL 60947-1

UL 60947-5-1

### Certificates

CCC

CSA

cURus

EAC

**ETIM classification**

ETIM 8.0

EC000041 -  
Auxiliary contact  
block