wictotouic



Operating Manual Ultrasonic proximity switch with one switching output

nero-15/CD nero-25/CD nero-35/CD nero-100/CD nero-15/WK/CD nero-25/WK/CD nero-35/WK/CD

nero-15/CE nero-25/CE nero-35/CE nero-100/CE nero-15/WK/CE nero-25/WK/CE nero-100/WK/CE

Diagram 1: Set sensor parameters via Teach-in procedure

Product description

The nero sensor offers a non-contact measurement of the distance to an object which must be positioned within the sensor's detection zone. The switching output is set conditional upon the adjusted detect distance. Via the Teach-in procedure, the detect distance and operating mode can be adjusted. Two LEDs indicate the state of the switching output.

Safety instructions

- Read the operating manual prior to start-up.
- Connection, installation and adjustments may only be carried out by qualified staff.
- No safety component in accordance with the EU Machine Directive, use in the area of personal and machine protection not permitted.

Use for intended purpose only

nero ultrasonic sensors are used for non-contact detection of objects.

Installation

- → Mount the sensor at the place of fitting.
- → Connect a connection cable to the M12 device plug, see Fig. 1.

The assembly distances shown in Fig. 2 for two or more sensors should not be fallen below in order to avoid mutual interference.

2 • 4 1 • • 3	7	colour
1	+U _B	brown
3	-U _B	blue
4	D/E	black
2	Teach-in	white

Fig. 1: Pin assignment with view onto sensor plug and colour coding of the microsonic connection cable

Start-up

- → Connect the power supply.
- → Carry out sensor adjustment in accordance with Diagram 1.

Factory setting

nero-sensors are delivered factory made with the following settings:

- Switching point operation
- Switching output on NOC
- Detect distance at operating range

Operating modes

Three operating modes are available for the switching output:

Operation with one switching point

The switching output is set when the object falls below the set switching point.

■ Window mode

The switching output is set when the object is inside the set window.

Two-way reflective barrier

The switching output is set when the object is between sensor and fixed reflector.

		D↔a
nero-15	≥0.25 m	≥1.30 m
nero-25	≥0.35 m	≥2.50 m
nero-35	≥0.40 m	≥2.50 m
nero-100	≥0.70 m	≥4.00 m

Fig. 2: Minimal assembly distances

Checking operation mode

→ In normal operating mode shortly connect Teach-in to +U_B. Both LEDs stop shining for one second. The green LED indicates the current operating mode:

■ 1x flashing = operation with one switching point

■ 2x flashing = window mode

■ 3x flashing = reflective barrier

After a break of 3 s the green LED shows the **output function**:

- 1x flashing = NOC
- 2x flashing = NCC


To change the operating mode und output function, see Diagram 1.


Maintenance

microsonic sensors are maintenancefree. In case of excess caked-on dirt we recommend cleaning the white sensor surface.


Notes

- The sensors of the nero family have a blind zone, within which a distance measurement is not possible.
- In the normal operating mode, an illuminated yellow LED signals that the switching output is switched through.
- In the »Two-way reflective barrier« operating mode, the object has to be within the range of 0 to 85 % of the set distance.
- In the »Set switching point method A« Teach-in procedure the actual distance to the object is taught to the sensor as the switching point. If the object moves towards the sensor (e.g. with level control) then the taught distance is the level at which the sensor has to switch the output (see Fig. 3).
- If the object to be scanned moves into the detection area from the side, the »Set switching point +8 % method B « Teach-in procedure should be used. In this way the switching distance is set 8 % further than the actual measured distance to the object. This ensures a reliable switching distance even if the height of the objects varies slightly (see Fig. 3).




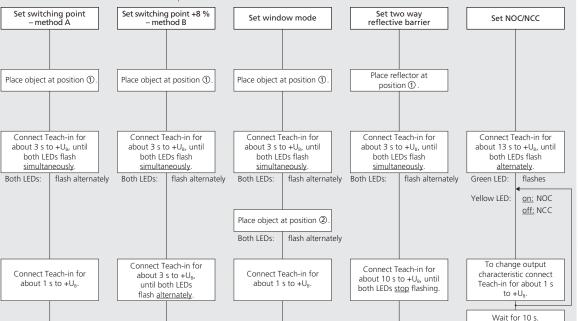

Normal operating mode

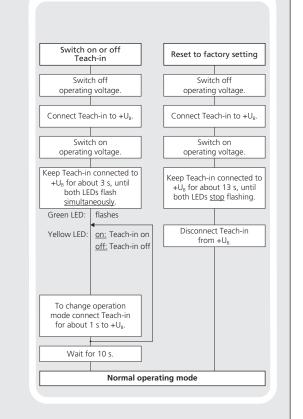

Further settings

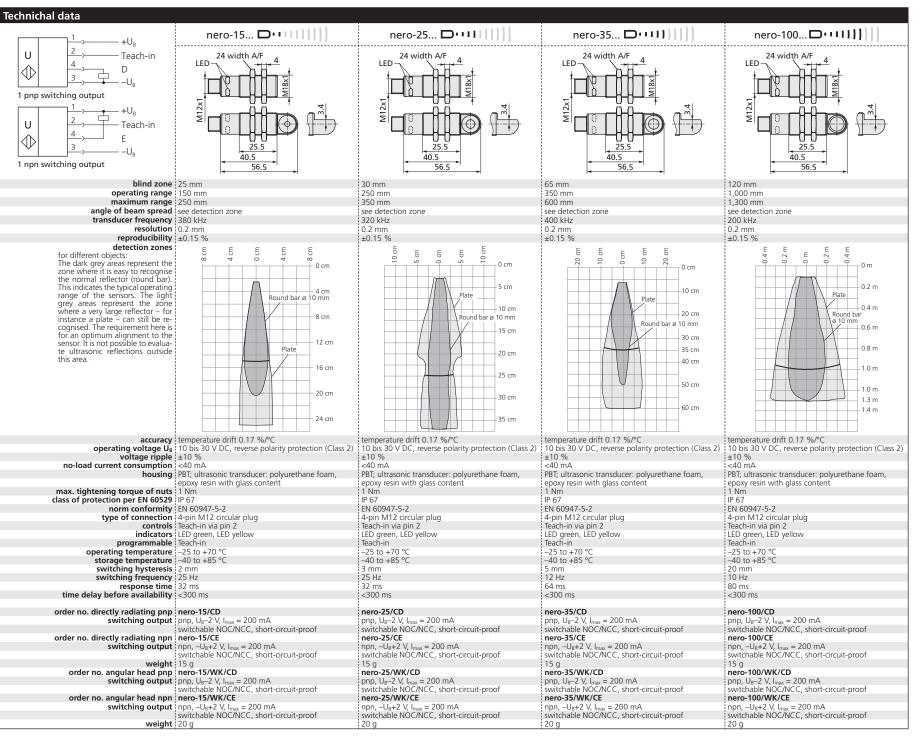




Fig. 3: Setting the switching point for different directions of movement of the ob-

■ The sensor can be reset to its factory setting (see »Further settings«, Diagram 1).



₩ CK CE 2014/30/EU



Enclosure Type 1 For use only in industrial machinery NFPA 79 applications.

The proximity switches shall be used with a Listed (CYJV/7) cable/connector assembly rated mini-mum 32 Vdc, minimum 290 mA, in the final in-