

INVERTER FR-A800 Plus

Optimum functions for cranes added
[Ethernet communication model added to the line-up]



A800 Plus

for CRANES



- Reduction in tact time
- Load slippage prevention
- Dedicated monitoring functions
- Wide range of applications
- Easier maintenance
- Pursuit of leading drive performance
- System support

GLOBAL IMPACT OF MITSUBISHI ELECTRIC



Through Mitsubishi Electric's vision, "Changes for the Better" are possible for a brighter future.

Changes for the Better

We bring together the best minds to create the best technologies. At Mitsubishi Electric, we understand that technology is the driving force of change in our lives. By bringing greater comfort to daily life, maximizing the efficiency of businesses and keeping things running across society, we integrate technology and innovation to bring changes for the better.

Mitsubishi Electric is involved in many areas including the following

Energy and Electric Systems

A wide range of power and electrical products from generators to large-scale displays.

Electronic Devices

A wide portfolio of cutting-edge semiconductor devices for systems and products.

Home Appliance

Dependable consumer products like air conditioners and home entertainment systems.

Information and Communication Systems

Commercial and consumer-centric equipment, products and systems.

Industrial Automation Systems


Maximizing productivity and efficiency with cutting-edge automation technology.

Features	6	1
Standard specifications	13	2
Outline dimensions	17	3
Crane function parameters	19	4
Warranty	25	5
Support	26	6

Pursuing optimum functions to

A new lineup of dedicated inverters for specialized fields are born!

Plus! The optimum functions for each dedicated field are added to the already high

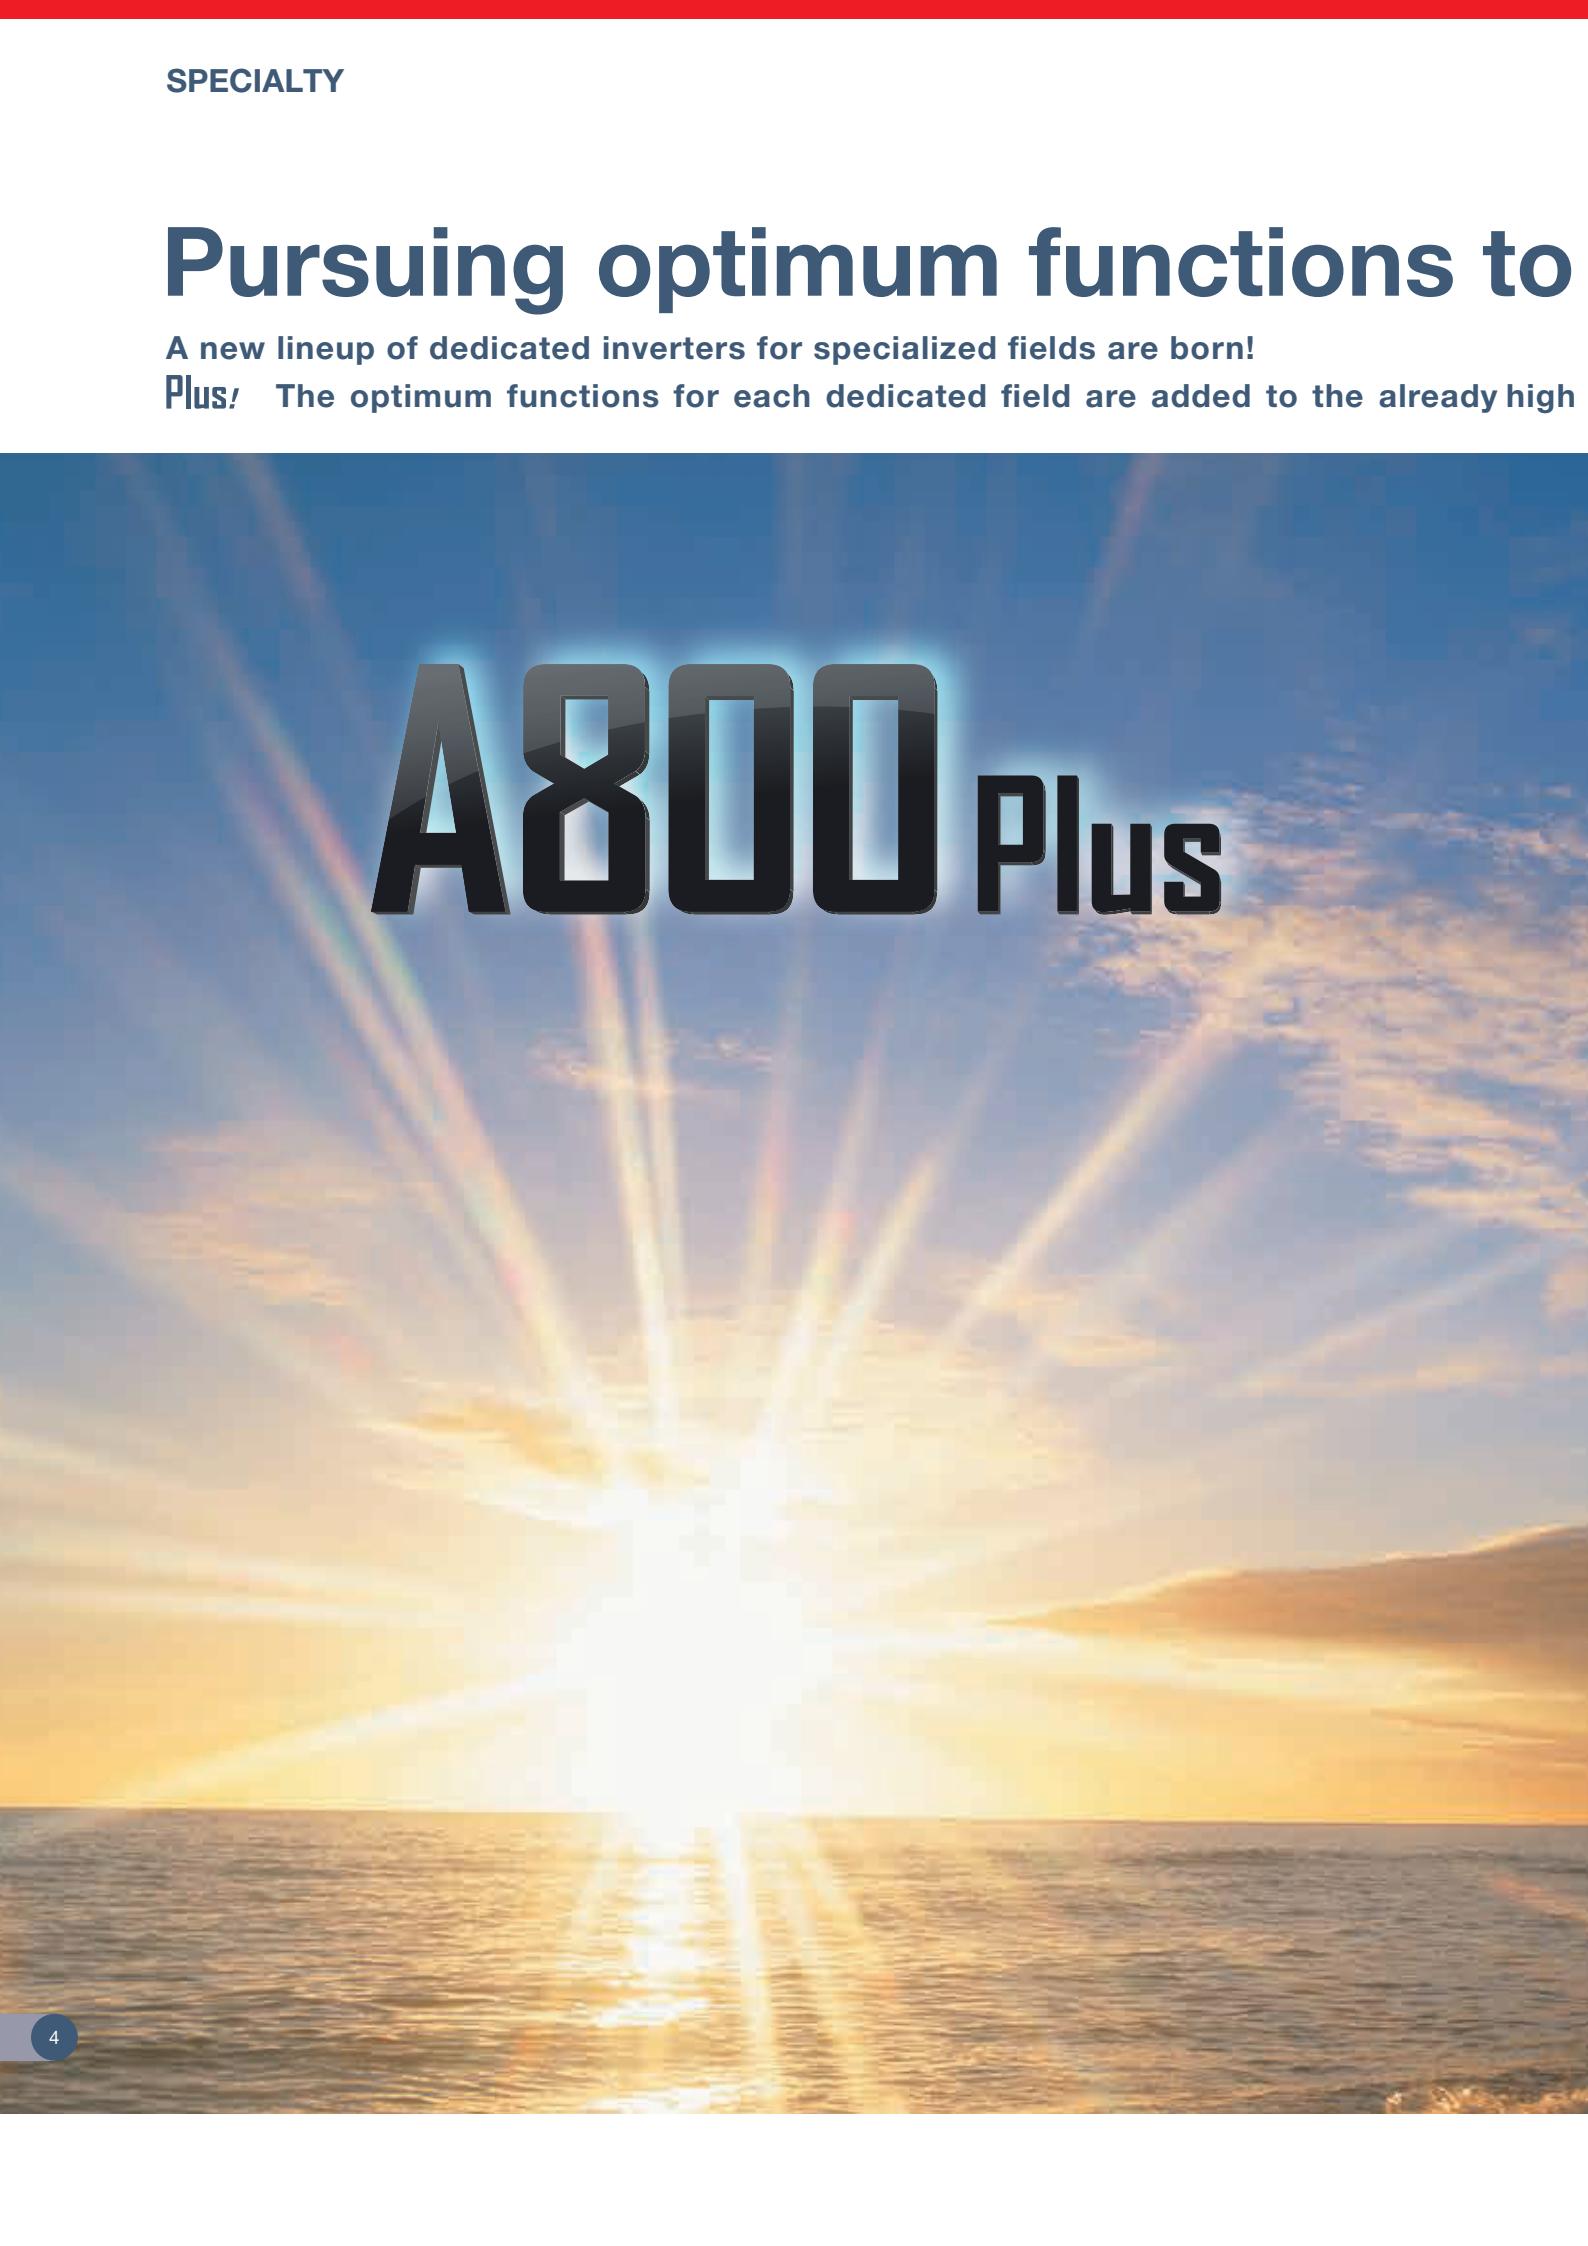A large, bold, black text "A800 Plus" is centered in the upper portion of the image. The background is a vibrant sunset or sunrise over a body of water, with rays of light streaming through the clouds. The text has a slight glow and appears to be floating in the air.

A800 Plus

meet our customers' needs

performance and high functionality FR-A800 series inverter.



for CRANES

Suited for various cranes to achieve fast, robust, and smooth operations

1


Features

Plus! Reduction in tact time

Anti-sway control

By using Mitsubishi Electric's original anti-sway control technology, the swinging of an object moved by a crane is suppressed at the time of stopping, even without operator's input adjustment.

This control cuts down the tact time and facilitates efficient operation.

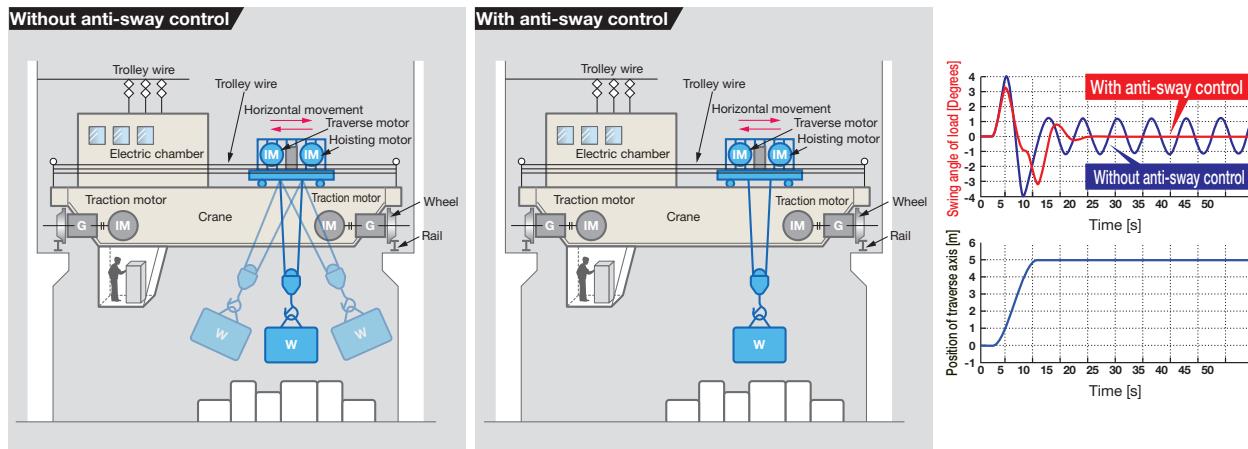

Load torque high-speed frequency control (mode 2)

When there is a light-load (when light loads are moved up or down by a crane), the speed will automatically be increased. This reduces the tact time and facilitates efficient operation. The possible operation speed is set automatically according to the load. After starting the inverter, the inverter runs at high speed with a light load.

Built-in brake transistor

22K inverters or lower in the 200 V class and 55K inverters or lower in the 400 V class have a built-in brake transistor.

Connecting a brake resistor^{*1} can shorten the deceleration time; no brake unit or power regeneration converter is required.

Shortest-time torque startup function


The time from the start command to when the brake opens is shortened. This will contributes to reduction in tact time.

• Shortest-time torque startup function

The optimum distribution of the excitation current and torque current enables rapid startup of the torque.

• Magnetic flux command during pre-excitation

Decreasing the pre-excitation current during a motor stop reduces power consumption during standby, and enables rapid startup of the torque.

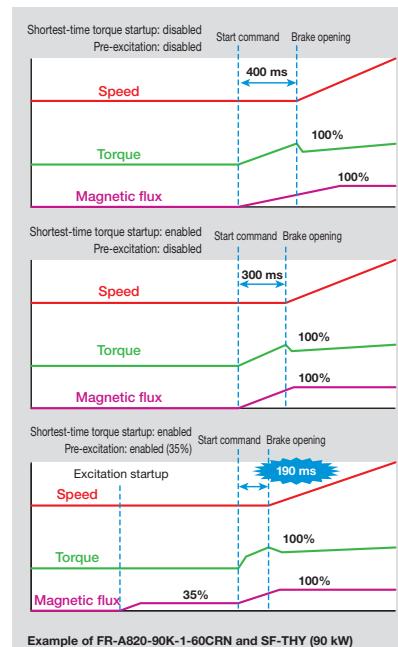

^{*1} The brake resistor must have a sufficient capacity to consume the regenerative power.

Plus! Load slippage prevention

Brake sequence function

The highly scalable brake sequence function enables the output of a brake opening signal for the optimum brake operation calculated from the load torque or the speed.

The function enables setting of the brake opening level individually for forward rotation and reverse rotation.

Low-speed range speed control P gain

When an inverter is connected to a lift, the inverter has a load immediately after the lift brake is released. Adjusting the speed control P gain in the low-speed range improves the response at low speed, and shortens the time from startup to brake opening.



Falling detection

Slippage during the start of a lift can be checked.

When the commanded direction differs from the actual motor rotation direction, the falling detection signal is output.

Plus! Dedicated monitoring functions

Overload detection function

By outputting an overload detection signal when too much load (overload) is applied to a crane, this information can be transmitted to the superordinate controller.

During constant speed operation, when the motor torque is equal to or higher than the torque setting for the time setting or longer, the overload detection signal is turned ON.

Start count monitor

The inverter starting times can be counted.

Confirming the starting times can be used to determinate the timing of the maintenance, or can be used as a reference for system inspection or parts replacement.



Start count monitor

Wide range of applications

Compliance with ship classification standards

Using the recommended noise filter in combination with the inverter supports compliance with various countries ship classifications, such as NK, LR, DNV GL, ABS, BV, CCS, and KR. The FR-A800-CRN can be used for electric deck cranes on ship.



Easier maintenance



Enhanced vibration resistance

Protection against vibration

1

Features


Enhanced adhesion of the circuit board components

Components on the circuit board are fixed with adhesive for enhanced vibration resistance.




Enhanced countermeasure of connector coming-off prevention

Instead of a simple locking mechanism, a full locking mechanism is adopted for cable connectors.

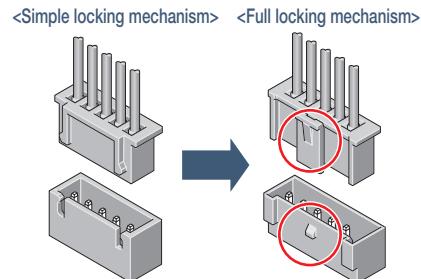

Adoption of cable ties

Cables are bound and fixed to avoid contact with conductive components inside the inverter in case of strong vibrations.

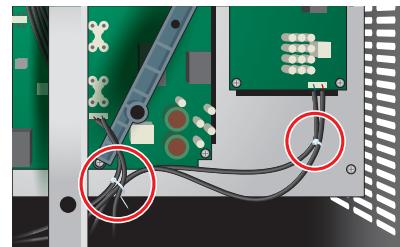

Improved environmental resistance

Measures against dust, dirt, and corrosion

Using the inverter in a dusty environment may cause faults such as a short circuit. The inverter with circuit board coating (conforming to IEC60721-3-3:1994 3C2/3S2) ensures reliability even in poor environments. Furthermore, an inverter with plated conductors is also available.


Pursuit of leading drive performance

High response

The improved speed response ensures a minimal speed fluctuation to maintain a constant speed when the load fluctuates.

- Speed response

Real sensorless vector control 50 Hz*1 (A700: 20 Hz)
Vector control*2 130 Hz*3 (A700: 50 Hz)

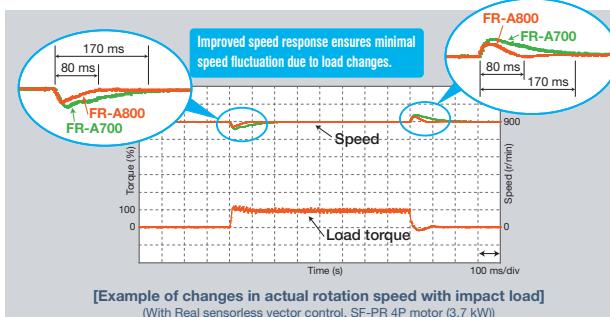


High torque at low speed

Our new inverter realizes smooth cargo handling work at low speed and high torque for the slow and stable movements required for heavy objects.

- Starting torque (at 0.3 Hz)

Real sensorless vector control 200% (ND rating)
Vector control*2 200% (ND rating)
(150% of initial setting for 5.5K or higher)

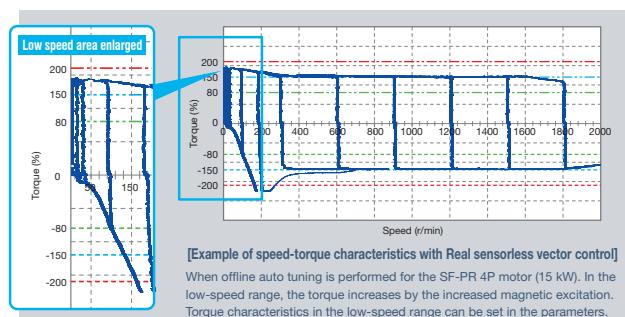

*1 At 3.7 kW with no load. Differs depending on the load conditions and motor capacity.

*2 The vector control is available when a vector control compatible option is installed.

*3 The option (FR-A8AP, FR-A8AL, or FR-A8TP) is required.

System support


Compatibility with various open networks

Using a controller, the inverter can be controlled and monitored via various types of network.

Ethernet communication **FR-A800-E-CRN** **CC-Link IE Field Basic**


(1) CC-Link IE Field Network Basic supported

CC-Link IE Field Network Basic is supported, so the network can be created easily. The inverter's status can be monitored and the parameters can be set via Internet. (MODBUS/TCP is also supported.)

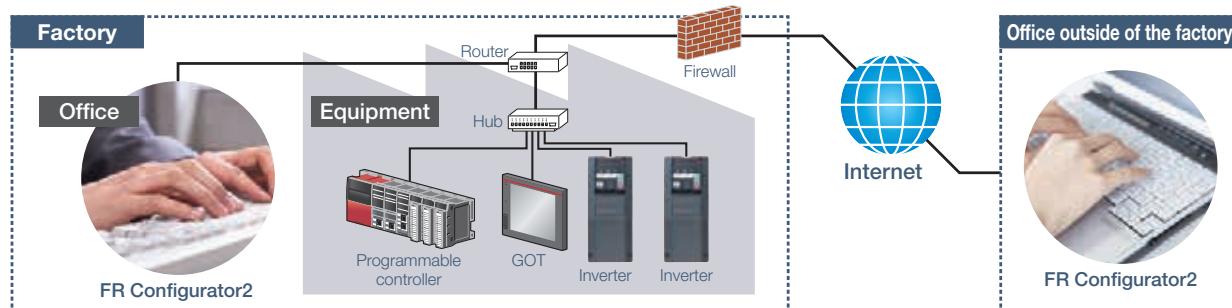

(2) Monitoring from a remote location

The FR-A800-E-CRN inverter can be connected to FR Configurator2 using a commercially-available industrial wireless LAN^{*1} access point.^{*2} Adjustments of inverter parameters, inverter monitoring (simultaneous monitoring of multiple axes possible) and inverter maintenance such as life diagnosis checks can be performed wirelessly.

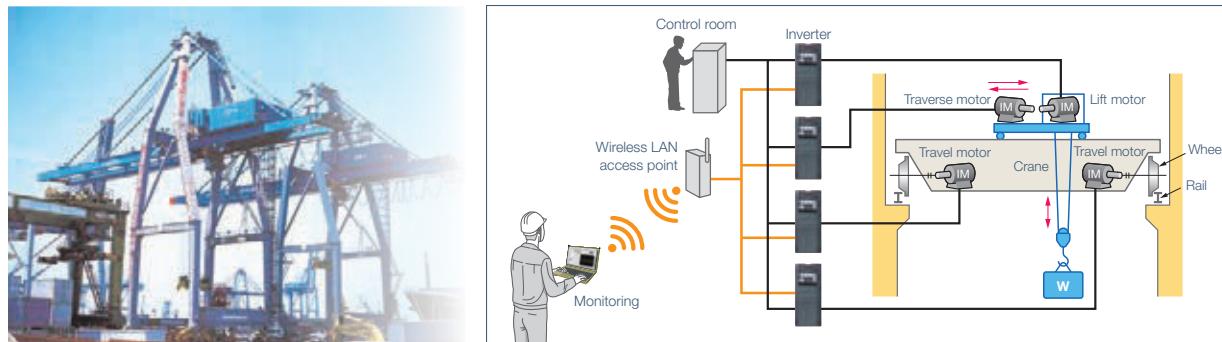

*1 A wireless LAN suitable for the industrial use in severe environments or in environments requiring high reliability (redundancy).

*2 Under certain environments or installation conditions, Ethernet communication through wireless LAN is not as stable as communication through wired LAN. Before starting operation, always check the communication status. For applications requiring data transmission or update periodically or within a certain time period, a wired connection is recommended.

Other network communication

- CC-Link, SSCNETIII (/H), DeviceNet™, PROFIBUS-DPv0 are supported using a compatible communication option. Other Ethernet-based communication such as the CC-Link IE Field Network communication and the FL remote communication can be also supported.
- A function block (FB) programming for CC-Link communication is available for the MELSEC-Q/L series to create the inverter control sequence programs easily. (The FB library (collection of FB elements) can be downloaded from the Mitsubishi Electric FA Global Website.)
- The standard model with an RS-485 interface (Mitsubishi inverter protocol, MODBUS® RTU protocol) enables communication with other devices without using a communication option.

Control the machines as you desire

– PLC function


Inverter operation sequence customized for the machine

Inverter control such as inverter operations triggered by input signals, signal output based on inverter operation status, and monitor output can be freely customized based on the machine specifications. Control programs can be created in sequence ladders using the inverter setup software (FR Configurator2).

1
Features

Application example 1: Position error correction

The traveled distance (total number of travel pulses) of each wheel is directly read from the encoder installed at the wheel. The pulses from the two wheels are then compared, and their speed is adjusted to synchronize the wheel positions. There is no need to use an external controller to offset speed, allowing high accuracy control.

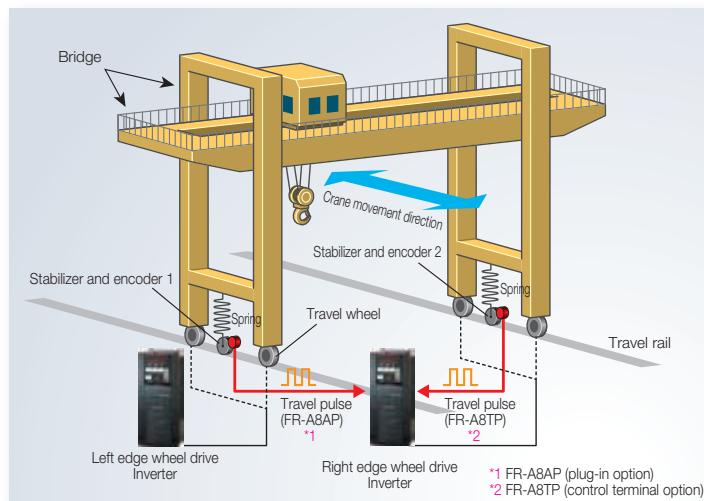


Application example 2: Wire rope length measurement

The travel axis reads the amount of lifting/lowering movement (encoder pulse) of the lift axis to calculate the wire rope length.

The wire rope length according to the operating condition can be applied to the anti-sway control.


The lifting/lowering speed can be slowed down when the rope length reaches a predetermined value to prevent the object from colliding into the lift axis drum, etc.

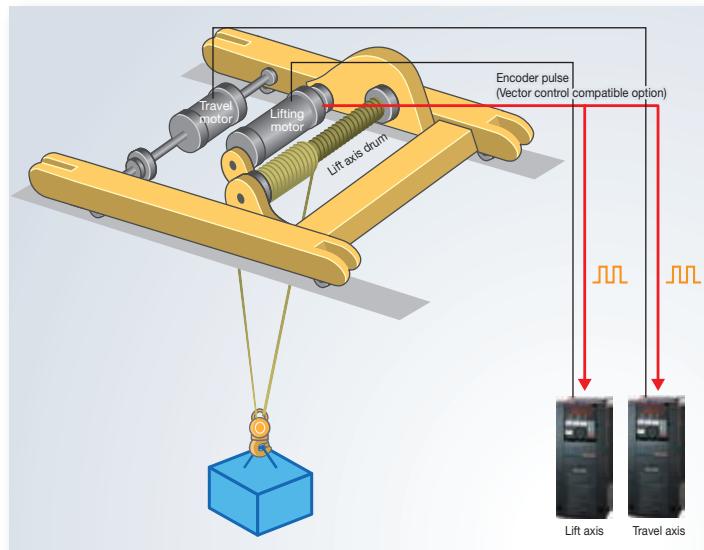

Delivering a comfortable inverter operating environment – FR Configurator2


Easy USB cable connection

A USB connector (mini B connector) is provided as standard. Connection with a personal computer can be established easily without using an adapter.

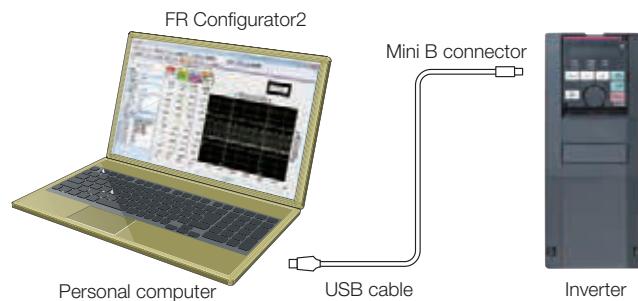

Easy setup FR-A800-E-CRN

Detect the inverter and easily configure network settings using the inverter setup software FR Configurator2.

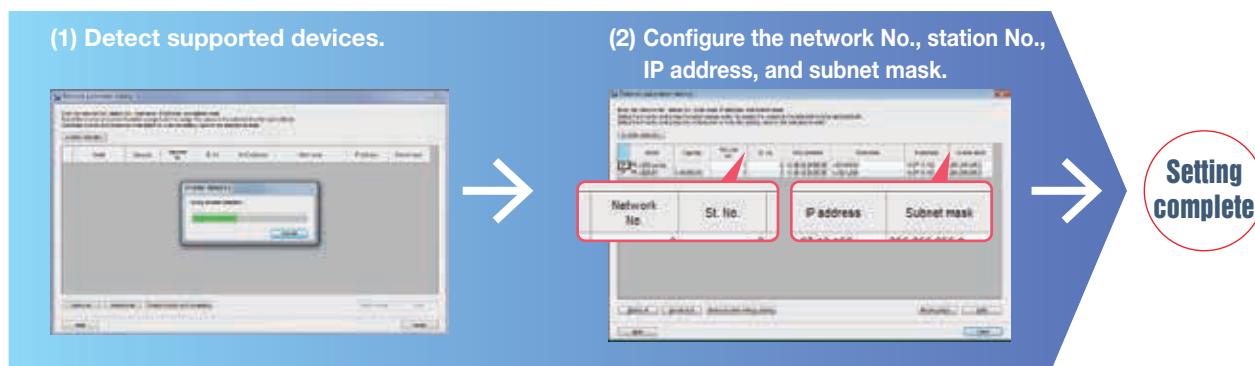

Easy-to-follow platform facilitates easy maintenance


- Fault history

Fault history and fault occurrence time can be displayed together. Faults can also be displayed while they are occurring and the inverter can be reset.

- Life diagnosis check

Inverter life information data can be displayed. A warning icon is shown in the part life alarm field of the parts recommended for replacement.

Diagnosis results can be exported to a file with the Diagnosis data output function.

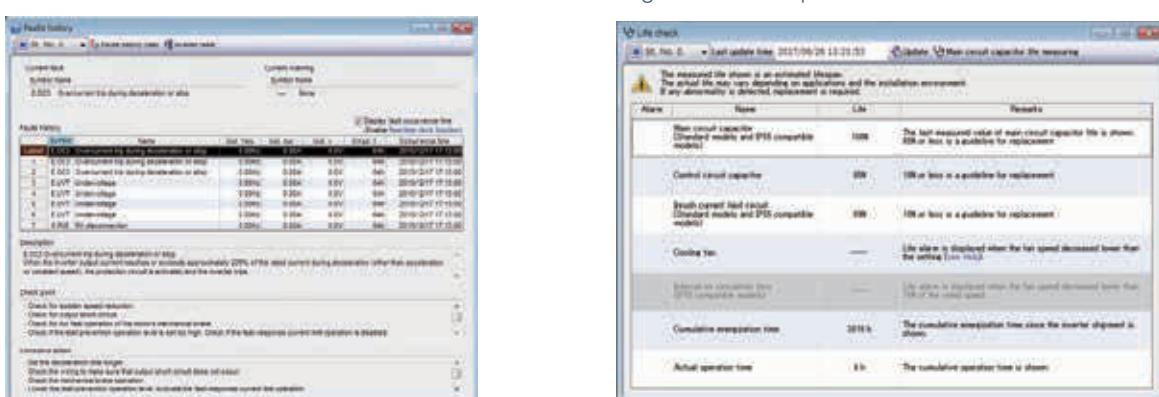

Lineup.

●: Released model

Standard model

F R - A 8 2 0 - 0.4K - 1 - 60 CRN

Symbol	Voltage class	Symbol	Structure/function	Capacity ¹	Description	Symbol	Type ²	Communication type	Symbol	Circuit board coating (IEC60721-3-3:1994 3C2/3S2 compatible)	Plated conductor	Enhanced vibration resistance	Symbol	Dedicated function
2	200 V class	0	Standard model	0.4K to 280K	Inverter ND rated capacity (kW)	1	FM		60	With	Without	Without	CRN	Functions for crane applications
4	400 V class					2	CA	RS-485	06 ³		With	With		
						E1	FM	Ethernet	61		Without	With		
						E2	CA		16 ³		With	With		
Three-phase 200 V class FR-A820-I ⁴														
0.4K	0.75K	1.5K	2.2K	3.7K	5.5K	7.5K	11K	15K	18.5K	22K	30K	37K	45K	55K 75K 90K
00046	00077	00105	00167	00250	00340	00490	00630	00770	00930	01250	01540	01870	02330	03160 03800 04750
●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
0.4K	0.75K	1.5K	2.2K	3.7K	5.5K	7.5K	11K	15K	18.5K	22K	30K	37K	45K	55K 75K 90K
00023	00038	00052	00083	00126	00170	00250	00310	00380	00470	00620	00770	00930	01160	01800 02160 02600
●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
Three-phase 400 V class FR-A840-I ⁴														
110K	132K	160K	185K	220K	250K	280K								
03250	03610	04320	04810	05470	06100	06830								
●	●	●	●	●	●	●								

Separated converter type

F R - A 8 4 2 - 315K - 1 - 60 CRN

Symbol	Voltage class	Symbol	Structure/function	Capacity ¹	Description	Symbol	Type ²	Communication type	Symbol	Circuit board coating (IEC60721-3-3:1994 3C2/3S2 compatible)	Plated conductor	Enhanced vibration resistance	Symbol	Dedicated function
4	400 V class	2	Separated converter type	315K to 500K	Inverter ND rated capacity (kW)	1	FM		60	With	Without	Without	CRN	Functions for crane applications
						2	CA	RS-485	06		With	With		
						E1	FM	Ethernet	61		Without	With		
						E2	CA		16		With	With		
Three-phase 400 V class FR-A842-□														
315K	355K	400K	450K	500K										
07700	08660	09620	10940	12120										
●	●	●	●	●										

¹: Models can be alternatively indicated with the inverter rated current (SLD rating).

²: Specification differs depending on the type shown in the following table.

³: Available for the 5.5K or higher.

⁴: For the 75K or higher inverter, or whenever a 75 kW or higher motor is used, always connect a DC reactor (FR-HEL), which is available as an option.

Type	Monitor output			Initial setting			
	Built-in EMC filter	Control logic	Rated frequency	Pr.19 Base frequency voltage			
FM (terminal FM equipped model)	Terminal FM: pulse train output Terminal AM: analog voltage output (0 to ±10VDC)	OFF	Sink logic	60 Hz	9999 (same as the power supply voltage)		
CA (terminal CA equipped model)	Terminal CA: analog current output (0 to 20mAADC) Terminal AM: analog voltage output (0 to ±10VDC)	ON	Source logic	50 Hz	8888 (95% of the power supply voltage)		

Inverter by rating

• 200 V class

Inverter model	SLD (superlight duty)		LD (light duty)		ND (normal duty, initial value)		HD (heavy duty)	
	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)
FR-A820-□	0.4K	00046	0.75	4.6	0.75	4.2	0.4	3
	0.75K	00077	1.5	7.7	1.5	7	0.75	5
	1.5K	00105	2.2	10.5	2.2	9.6	1.5	8
	2.2K	00167	3.7	16.7	3.7	15.2	2.2	11
	3.7K	00250	5.5	25	5.5	23	3.7	17.5
	5.5K	00340	7.5	34	7.5	31	5.5	24
	7.5K	00490	11	49	11	45	7.5	33
	11K	00630	15	63	15	58	11	46
	15K	00770	18.5	77	18.5	70.5	15	61
	18.5K	00930	22	93	22	85	18.5	61
	22K	01250	30	125	30	114	22	90
	30K	01540	37	154	37	140	30	115
	37K	01870	45	187	45	170	37	145
	45K	02330	55	233	55	212	45	175
	55K	03160	75	316	75	288	55	215
	75K	03800	90/110	380	90	346	75	288
	90K	04750	132	475	110	432	90	346
							75	288

• 400 V class

Inverter model	SLD (superlight duty)		LD (light duty)		ND (normal duty, initial value)		HD (heavy duty)	
	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)	Motor capacity (kW) ⁵	Rated current (A)
FR-A840-I/FR-A842-□	0.4K	00023	0.75	2.3	0.75	2.1	0.4	1.5
	0.75K	00038	1.5	3.8	1.5	3.5	0.75	2.5
	1.5K	00052	2.2	5.2	2.2	4.8	1.5	4
	2.2K	00083	3.7	8.3	3.7	7.6	2.2	6
	3.7K	00126	5.5	12.6	5.5	11.5	3.7	9
	5.5K	00170	7.5	17	7.5	16	5.5	12
	7.5K	00250	11	25	11	23	7.5	17
	11K	00310	15	31	15	29	11	23
	15K	00380	18.5	38	18.5	35	15	31
	18.5K	00470	22	47	22	43	18.5	38
	22K	00620	30	62	30	57	22	44
	30K	00770	37	77	37	70	30	57
	37K	00930	45	93	45	85	37	71
	45K	01160	55	116	55	106	45	86
	55K	01800	75/90	180	75	144	55	110
	75K	02160	110	216	90	180	75	144
	90K	02600	132	260	110	216	90	180
	110K	03250	160	325	132	260	110	216
	132K	03610	185	361	160	325	132	260
	160K	04320	220	432	185	361	160	325
	185K	04810	250	481	220	432	185	361
	220K	05470	280	547	250	481	220	432
	250K	06100	315	610	280	547	250	481
	280K	06830	355	683	315	610	280	547
	315K	07070	400	770	355	683	315	610
	355K	08660	450	866	400	770	355	610
	400K	09620	500	962	450	866	400	770
	450K	10940	560	1094	500	962	450	866
	500K	12120	630	1212	560	1094	500	962

⁵ Indicates the maximum capacity applicable with the Mitsubishi Electric 4-pole standard motor.

• Overload current rating

SLD	110% 60 s, 120% 3 s (inverse-time characteristics) at surrounding air temperature of 40°C
LD	120% 60 s, 150% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C
ND	150% 60 s, 200% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C
HD	200% 60 s, 250% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C

Standard specifications

● Rating (Standard model)

◆ 200 V class

Model FR-A820-□		00046	00077	00105	00167	00250	00340	00490	00630	00770	00930	01250	01540	01870	02330	03160	03800	04750											
		0.4K	0.75K	1.5K	2.2K	3.7K	5.5K	7.5K	11K	15K	18.5K	22K	30K	37K	45K	55K	75K	90K											
Applicable motor capacity (kW) *1	SLD	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90/110	132											
	LD	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90	110											
	ND (initial setting)	0.4	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90											
	HD	0.2*2	0.4	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75											
Rated capacity (kVA) *3	SLD	1.8	2.9	4	6.4	10	13	19	24	29	35	48	59	71	89	120	145	181											
	LD	1.6	2.7	3.7	5.8	8.8	12	17	22	27	32	43	53	65	81	110	132	165											
	ND (initial setting)	1.1	1.9	3	4.2	6.7	9.1	13	18	23	29	34	44	55	67	82	110	132											
	HD	0.6	1.1	1.9	3	4.2	6.7	9.1	13	18	23	29	34	44	55	67	82	110											
Rated current (A)	SLD	4.6	7.7	10.5	16.7	25	34	49	63	77	93	125	154	187	233	316	380	475											
	LD	4.2	7	9.6	15.2	23	31	45	58	70.5	85	114	140	170	212	288	346	432											
	ND (initial setting)	3	5	8	11	17.5	24	33	46	61	76	90	115	145	175	215	288	346											
	HD	1.5	3	5	8	11	17.5	24	33	46	61	76	90	115	145	175	215	288											
IndInO	SLD	110% 60 s, 120% 3 s (inverse-time characteristics) at surrounding air temperature of 40°C																											
	LD	120% 60 s, 150% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																											
	ND (initial setting)	150% 60 s, 200% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																											
	HD	200% 60 s, 250% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																											
Rated voltage *5		Three-phase 200 to 240 V																											
Regenerative braking	Built-in brake transistor	Built-in										FR-BU2 (option)																	
	Maximum brake torque *7	150% torque/3%ED *6			100% torque/3%ED *6			100% torque/continuous			20% torque/continuous							10% torque/continuous											
	FR-ABR (when the option is used)	150% torque/10%ED		100% torque/10%ED				100% torque/6%ED				—	—	—	—	—	—	—											
	Rated input AC voltage/frequency	Three-phase 200 to 240 V, 50 Hz/60 Hz																											
Permissible AC voltage fluctuation		170 to 264 V, 50 Hz/60 Hz																											
Permissible frequency fluctuation		±5%																											
Power supply	SLD	5.3	8.9	13.2	19.7	31.3	45.1	62.8	80.6	96.7	115	151	185	221	269	—	—	—											
	LD	5	8.3	12.2	18.3	28.5	41.6	58.2	74.8	90.9	106	139	178	207	255	—	—	—											
	ND (initial setting)	3.9	6.3	10.6	14.1	22.6	33.4	44.2	60.9	80	96.3	113	150	181	216	266	—	—											
	HD	2.3	3.9	6.3	10.6	14.1	22.6	33.4	44.2	60.9	80	96.3	113	150	181	216	—	—											
Rated input current (A) *8	SLD	4.6	7.7	10.5	16.7	25	34	49	63	77	93	125	154	187	233	316	380	475											
	LD	4.2	7	9.6	15.2	23	31	45	58	70.5	85	114	140	170	212	288	346	432											
	ND (initial setting)	3	5	8	11	17.5	24	33	46	61	76	90	115	145	175	215	288	346											
	HD	1.5	3	5	8	11	17.5	24	33	46	61	76	90	115	145	175	215	288											
Power supply capacity (kVA) *9	Without DC reactor	SLD	2	3.4	5	7.5	12	17	24	31	37	44	58	70	84	103	—	—											
	LD	1.9	3.2	4.7	7	11	16	22	29	35	41	53	68	79	97	—	—	—											
	ND (initial setting)	1.5	2.4	4	5.4	8.6	13	17	23	30	37	43	57	69	82	101	—	—											
	HD	0.9	1.5	2.4	4	5.4	8.6	13	17	23	30	37	43	57	69	82	—	—											
With DC reactor	SLD	1.8	2.9	4	6.4	10	13	19	24	29	35	48	59	71	89	120	145	181											
	LD	1.6	2.7	3.7	5.8	8.8	12	17	22	27	32	43	53	65	81	110	132	165											
	ND (initial setting)	1.1	1.9	3	4.2	6.7	9.1	13	18	23	29	34	44	55	67	82	110	132											
	HD	0.6	1.1	1.9	3	4.2	6.7	9.1	13	18	23	29	34	44	55	67	82	110											
Protective structure (IEC 60529) *10		Enclosed type (IP20)										Open type (IP00)																	
Cooling system		Self-cooling		Forced air cooling																									
Approx. mass (kg)		2.0	2.2	3.3	3.3	3.3	6.7	6.7	8.3	15	15	15	22	42	42	54	74	74											

*1 The applicable motor capacity indicated is the maximum capacity applicable for use of the Mitsubishi Electric 4-pole standard motor.

*2 0.2 kW motors can be used only under V/F control.

*3 The rated output capacity indicated assumes that the output voltage is 220 V.

*4 The % value of the overload current rating indicated is the ratio of the overload current to the inverter's rated output current. For repeated duty, allow time for the inverter and motor to return to or below the temperatures under 100% load.

*5 The maximum output voltage does not exceed the power supply voltage. The maximum output voltage can be changed within the setting range. However, the maximum point of the voltage waveform at the inverter output side is the power supply voltage multiplied by about $\sqrt{2}$.

*6 With the built-in brake resistor

*7 ND rating reference value

*8 The rated input current is the value when at the rated output current. The impedance at the power supply side (including those of the input reactor and cables) affects the rated input current.

*9 The power supply capacity is the value when at the rated output current. The impedance at the power supply side (including those of the input reactor and cables) affects the power supply capacity.

*10 FR-DU08: IP40 (except for the PU connector)

Standard specifications

◆ 400 V class

Model FR-A840-□		00023	00036	00052	00083	00126	00170	00250	00310	00380	00470	00620	00770	00930	01160	01800	02160	02600	03250	03610	04320	04810	05470	06100	06830						
		0.4K	0.75K	1.5K	2.2K	3.7K	5.5K	7.5K	11K	15K	18.5K	22K	30K	37K	45K	55K	75K	90K	110K	132K	160K	185K	220K	250K	280K						
Applicable motor capacity (kW) *1	SLD	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75/90	110	132	160	185	220	250	280	315	355						
	LD	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90	110	132	160	185	220	250	280	315						
	ND (initial setting)	0.4	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90	110	132	160	185	220	250	280						
	HD	0.2	0.4	0.75	1.5	2.2	3.7	5.5	7.5	11	15	18.5	22	30	37	45	55	75	90	110	132	160	185	220	250						
Rated capacity (kVA) *3	SLD	1.8	2.9	4	6.3	10	13	19	24	29	36	47	59	71	88	137	165	198	248	275	329	367	417	465	521						
	LD	1.6	2.7	3.7	5.8	8.8	12	18	22	27	33	43	53	65	81	110	137	165	198	248	275	329	367	417	465						
	ND (initial setting)	1.1	1.9	3	4.6	6.9	9.1	13	18	24	29	34	43	54	66	84	110	137	165	198	248	275	329	367	417						
	HD	0.6	1.1	1.9	3	4.6	6.9	9.1	13	18	24	29	34	43	54	66	84	110	137	165	198	248	275	329	367						
Rated current (A)	SLD	2.3	3.8	5.2	8.3	12.6	17	25	31	38	47	62	77	93	116	180	216	260	325	361	432	481	547	610	683						
	LD	2.1	3.5	4.8	7.6	11.5	16	23	29	35	43	57	70	85	106	144	180	216	260	325	361	432	481	547	610						
	ND (initial setting)	1.5	2.5	4	6	9	12	17	23	31	38	44	57	71	86	110	144	180	216	260	325	361	432	481	547						
	HD	0.8	1.5	2.5	4	6	9	12	17	23	31	38	44	57	71	86	110	144	180	216	260	325	361	432	481						
Indoor	SLD	110% 60 s, 120% 3 s (inverse-time characteristics) at surrounding air temperature of 40°C																													
	LD	120% 60 s, 150% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																													
	ND (initial setting)	150% 60 s, 200% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																													
	HD	200% 60 s, 250% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C																													
Rated voltage *5		Three-phase 380 to 500 V																													
Regenerative braking	Built-in brake transistor	Built-in												FR-BU2 (option)																	
	Maximum brake torque *7	100% torque/2%ED *6						20% torque/continuous						10% torque/continuous																	
	FR-ABR (when the option is used)	100% torque/10%ED						100% torque/6%ED			—*12			—	—	—	—	—	—	—	—	—	—	—	—						
	Rated input AC voltage/frequency	Three-phase 380 to 500 V, 50 Hz/60 Hz *11																													
Power supply side	Permissible AC voltage fluctuation	323 to 550 V, 50 Hz/60 Hz																													
	Permissible frequency fluctuation	±5%																													
	Without DC reactor	SLD	3.2	5.4	7.8	10.9	16.4	22.5	31.7	40.3	48.2	58.4	76.8	97.6	115	141	—	—	—	—	—	—	—	—	—						
	ND (initial setting)	LD	3	4.9	7.3	10.1	15.1	22.3	31	38.2	44.9	53.9	75.1	89.7	106	130	—	—	—	—	—	—	—	—	—						
Rated input current (A) *8	HD	2.3	3.7	6.2	8.3	12.3	17.4	22.5	31	40.3	48.2	56.5	75.1	91	108	134	—	—	—	—	—	—	—	—	—						
	With DC reactor	SLD	2.3	3.8	5.2	8.3	12.6	17	25	31	38	47	62	77	93	116	180	216	260	325	361	432	481	547	610	683					
	ND (initial setting)	LD	2.1	3.5	4.8	7.6	11.5	16	23	29	35	43	57	70	85	106	144	180	216	260	325	361	432	481	547	610					
	HD	1.5	2.5	4	6	9	12	17	23	31	38	44	57	71	86	110	144	180	216	260	325	361	432	481	547						
Power supply capacity (kVA) *9	Without DC reactor	SLD	2.5	4.1	5.9	8.3	12	17	24	31	37	44	59	74	88	107	—	—	—	—	—	—	—	—	—						
	ND (initial setting)	LD	2.3	3.7	5.5	7.7	12	17	24	29	34	41	57	68	81	99	—	—	—	—	—	—	—	—	—						
	HD	1.7	2.8	4.7	6.3	9.4	13	17	24	31	37	43	57	69	83	102	—	—	—	—	—	—	—	—	—						
	With DC reactor	SLD	1.8	2.9	4	6.3	10	13	19	24	29	36	47	59	71	88	137	165	198	248	275	329	367	417	465	521					
Protective structure (IEC 60529) *10	LD	1.6	2.7	3.7	5.8	8.8	12	18	22	27	33	43	53	65	81	110	137	165	198	248	275	329	367	417	465						
	ND (initial setting)	1.1	1.9	3	4.6	6.9	9.1	13	18	24	29	34	43	54	66	84	110	137	165	198	248	275	329	367	417						
	HD	0.6	1.1	1.9	3	4.6	6.9	9.1	13	18	24	29	34	43	54	66	84	110	137	165	198	248	275	329	367						
	Enclosed type (IP20)	Open type (IP00)																													
Cooling system		Self-cooling												Forced air cooling																	
Approx. mass (kg)		2.8	2.8	2.8	3.3	3.3	6.7	6.7	8.3	8.3	15	15	23	41	41	43	52	55	71	78	117	117	166	166	166						

*1 The applicable motor capacity indicated is the maximum capacity applicable for use of the Mitsubishi Electric 4-pole standard motor.

*2 0.2 kW motors can be used only under V/F control.

*3 The rated output capacity indicated assumes that the output voltage is 440 V.

*4 The % value of the overload current rating indicated is the ratio of the overload current to the inverter's rated output current. For repeated duty, allow time for the inverter and motor to return to or below the temperatures under 100% load.

*5 The maximum output voltage does not exceed the power supply voltage. The maximum output voltage can be changed within the setting range. However, the maximum point of the voltage waveform at the inverter output side is the power supply voltage multiplied by about $\sqrt{2}$.

*6 With the built-in brake resistor

*7 ND rating reference value

*8 The rated input current is the value when at the rated output current. The impedance at the power supply side (including those of the input reactor and cables) affects the rated input current.

*9 The power supply capacity is the value when at the rated output current. The impedance at the power supply side (including those of the input reactor and cables) affects the power supply capacity.

*10 FR-DU08: IP40 (except for the PU connector)

*11 For the power voltage exceeding 480 V, set **Pr.977 Input voltage mode selection**.

*12 A commercial brake resistor can be used to improve the braking capability of the inverter built-in brake. Please contact your sales representative for details.

● Rating (Separated converter type)

◆ 400 V class

- Inverter

Model FR-A842-□		07700	08660	09620	10940	12120	
		315K	355K	400K	450K	500K	
Applicable motor capacity (kW) *1	SLD	400	450	500	560	630	
	LD	355	400	450	500	560	
	ND (initial setting)	315	355	400	450	500	
	HD	280	315	355	400	450	
Rated capacity (kVA) *2	SLD	587	660	733	834	924	
	LD	521	587	660	733	834	
	ND (initial setting)	465	521	587	660	733	
	HD	417	465	521	587	660	
Rated current (A)	SLD	770	866	962	1094	1212	
	LD	683	770	866	962	1094	
	ND (initial setting)	610	683	770	866	962	
	HD	547	610	683	770	866	
Overload current rating *3	SLD	110% 60 s, 120% 3 s (inverse-time characteristics) at surrounding air temperature of 40°C					
	LD	120% 60 s, 150% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C					
	ND (initial setting)	150% 60 s, 200% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C					
	HD	200% 60 s, 250% 3 s (inverse-time characteristics) at surrounding air temperature of 50°C					
Rated voltage *4		Three-phase 380 to 500 V					
Input power	Regenerative braking torque*5 (when the converter unit (FR-CC2) is used)	Maximum brake torque	10% torque/continuous				
	Power supply voltage	430 to 780 VDC					
	Control power supply auxiliary input	Single-phase 380 to 500 V, 50 Hz/60 Hz *7					
Output power	Permissible control power supply auxiliary input fluctuation	Frequency ±5%, voltage ±10%					
	Protective structure (IEC 60529) *6	Open type (IP00)					
	Cooling system	Forced air cooling					
Approx. mass (kg)		163	163	243	243	243	

*1 The applicable motor capacity indicated is the maximum capacity applicable for use of the Mitsubishi Electric 4-pole standard motor.

*2 The rated output capacity indicated assumes that the output voltage is 440 V.

*3 The % value of the overload current rating indicated is the ratio of the overload current to the inverter's rated output current. For repeated duty, allow time for the inverter and motor to return to or below the temperatures under 100% load.

*4 The maximum output voltage does not exceed the power supply voltage. The maximum output voltage can be changed within the setting range. However, the maximum point of the voltage waveform at the inverter output side is the power supply voltage multiplied by about $\sqrt{2}$.

*5 ND rating reference value

*6 FR-DU08: IP40 (except for the PU connector)

*7 For the power voltage exceeding 480 V, set Pr.977 Input voltage mode selection.

- Converter unit (FR-CC2)

Model FR-CC2-H□		315K	355K	400K	450K	500K	560K	630K
Applicable motor capacity (kW)		315	355	400	450	500	560	630
Output power	Overload current rating *1	200% 60 s, 250% 3 s				150% 60 s, 200% 3 s	120% 60 s, 150% 3 s	110% 60 s, 120% 3 s
	Rated voltage *2	430 to 780 VDC *4						
Power supply	Rated input AC voltage/frequency	Three-phase 380 to 500 V, 50 Hz/60 Hz						
	Permissible AC voltage fluctuation	Three-phase 323 to 550 V, 50 Hz/60 Hz						
Power	Permissible frequency fluctuation	±5%						
	Rated input current (A)	610	683	770	866	962	1094	1212
Power supply capacity (kVA) *3		465	521	587	660	733	833	924
Protective structure (IEC 60529)		Open type (IP00)						
Cooling system		Forced air cooling						
DC reactor		Built-in						
Approx. mass (kg)		210	213	282	285	288	293	294

*1 The % value of the overload current rating indicated is the ratio of the overload current to the inverter's rated output current. For repeated duty, allow time for the converter unit and the inverter to return to or below the temperatures under 100% load.

*2 The converter unit output voltage varies according to the input power supply voltage and the load. The maximum point of the voltage waveform at the converter unit output side is approximately the power supply voltage multiplied by $\sqrt{2}$.

*3 The power supply capacity is the value when at the rated output current. The impedance at the power supply side (including those of the input reactor and cables) affects the rated input current.

*4 The permissible voltage imbalance ratio is 3% or less. (Imbalance ratio = (highest voltage between lines - average voltage between three lines) / average voltage between three lines × 100)

Standard specifications

● Common specifications

Control specifications	Control method		Soft-PWM control, high carrier frequency PWM control (selectable among V/F control, Advanced magnetic flux vector control, Real sensorless vector control), Optimum excitation control, vector control ^{*1} , and PM sensorless vector control
	Output frequency range		0.2 to 590 Hz (The upper frequency limit is 400 Hz under Advanced magnetic flux vector control, Real sensorless vector control, vector control ^{*1} , PM sensorless vector control.)
	Frequency setting resolution	Analog Input	0.015 Hz/60 Hz (0 to 10 V/12 bits for terminals 2 and 4) 0.03 Hz/60 Hz (0 to 5 V/11 bits or 0 to 20 mA/approx. 11 bits for terminals 2 and 4, 0 to ±10 V/12 bits for terminal 1)
		Digital input	0.06 Hz/60 Hz (0 to ±5 V/11 bits for terminal 1) 0.01 Hz
	Frequency accuracy	Analog Input	Within ±0.2% of the max. output frequency (25°C±10°C)
		Digital input	Within 0.01% of the set output frequency
	Voltage/frequency characteristics		Base frequency can be set from 0 to 590 Hz. Constant-torque/variable-torque pattern or adjustable 5 points V/F can be selected.
	Starting torque		SLD rating: 120% 0.3 Hz, LD rating: 150% 0.3 Hz, ND rating: 200% ^{*2} 0.3 Hz, HD rating: 250% ^{*2} 0.3 Hz (under Real sensorless vector control or vector control ^{*1})
	Torque boost		Manual torque boost
	Acceleration/deceleration time setting		0 to 3600 s (acceleration and deceleration can be set individually), linear or S-pattern acceleration/deceleration mode, backlash countermeasures acceleration/deceleration can be selected.
Operation specifications	DC injection brake (induction motor)		Operation frequency (0 to 120 Hz), operation time (0 to 10 s), operation voltage (0 to 30%) variable
	Stall prevention operation level		Activation range of stall prevention operation (SLD rating: 0 to 120%, LD rating: 0 to 150%, ND rating: 0 to 220%, HD rating: 0 to 280%). Whether to use the stall prevention or not can be selected (V/F control, Advanced magnetic flux vector control).
	Torque limit level		Torque limit value can be set (0 to 400% variable). (Real sensorless vector control / vector control ^{*1} / PM sensorless vector control)
	Frequency setting signal	Analog Input	Terminals 2 and 4: 0 to 10 V, 0 to 5 V, 4 to 20 mA (0 to 20 mA) are available. Terminal 1: -10 to +10 V, -5 to +5 V are available.
		Digital input	Input using the setting dial of the operation panel or parameter unit Four-digit BCD or 16-bit binary (when used with option FR-A8AX)
	Start signal		Forward and reverse rotation or start signal automatic self-holding input (3-wire input) can be selected.
	Input signals (twelve terminals)		The following signals can be assigned to Pr.178 to Pr.189 (input terminal function selection) : Low-speed operation command, Middle-speed operation command, High-speed operation command, Second function selection, Terminal 4 input selection, Jog operation selection, Selection of automatic restart after instantaneous power failure, flying start, Output stop, Start self-holding selection, Forward rotation command, Reverse rotation command, Inverter reset
	Pulse train input		100 kpps
	Operational functions		Maximum and minimum frequency settings, multi-speed operation, acceleration/deceleration pattern, thermal protection, DC injection brake, starting frequency, JOG operation, output stop (MRS), stall prevention, regeneration avoidance, increased magnetic excitation deceleration, DC feeding ^{*3} , frequency jump, rotation display, automatic restart after instantaneous power failure, electronic bypass sequence, remote setting, automatic acceleration/deceleration, retry function, carrier frequency selection, fast-response current limit, forward/reverse rotation prevention, operation mode selection, slip compensation, droop control, load torque high-speed frequency control, speed smoothing control, traverse, auto tuning, applied motor selection, gain tuning, RS-485 communication, Ethernet communication ^{*5} , PID control, PID pre-charge function, easy dancer control, cooling fan operation selection, stop selection (deceleration stop/coasting), power failure time deceleration-to-stop function, stop-on-contact control, PLC function, life diagnosis, maintenance timer, current average monitor, multiple rating, orientation control ^{*1} , speed control, torque control, position control, pre-excitation, torque limit, test run, 24 V power supply input for control circuit, safety stop function, anti-sway control, low-speed range speed control P gain, shortest-time torque startup, inching time adjustment function, brake sequence function
Indication	Digital signal output	Open collector output (five terminals)	Inverter running, Up to frequency, Instantaneous power failure/undervoltage ^{*3} , Overload warning, Output frequency detection, Fault
		Relay output (two terminals)	The output signal can be changed using Pr.190 to Pr.196 (output terminal function selection) . Fault codes of the inverter can be output (4 bits) from the open collector.
		Pulse train output (FM type)	50 kpps
	For meter		Max. 2.4 kHz: one terminal (output frequency) The monitored item can be changed using Pr.54 FM/CA terminal function selection .
Operation panel (FR-DU08)	Current output (CA type)	Max. 20 mA/DC: one terminal (output frequency)	The monitored item can be changed using Pr.54 FM/CA terminal function selection .
		Max. 10 VDC: one terminal (output frequency)	The monitored item can be changed using Pr.158 AM terminal function selection .
	Operating status	Output frequency, Output current, Output voltage, Frequency setting value The monitored item can be changed using Pr.52 Operation panel main monitor selection .	
Protective/ warning function	Fault record	Fault record is displayed when a protective function is activated. Past 8 fault records and output voltage/current/frequency/ cumulative energization time / year/month/date/time immediately before the protective function is activated are stored.	
	Protective function	Overspeed trip during acceleration, Overspeed trip during constant speed, Overspeed trip during deceleration or stop, Regenerative overvoltage trip during acceleration, Regenerative overvoltage trip during constant speed, Regenerative overvoltage trip during deceleration or stop, Inverter overload trip, Motor overload trip, Heatsink overheat, Instantaneous power failure ^{*3} , Undervoltage ^{*3} , Input phase loss ^{*3} , Stall prevention stop, Loss of synchronism detection ^{*4} , Brake transistor alarm detection, Output side earth (ground) fault overcurrent, Output short circuit, Output phase loss, External thermal relay operation ^{*4} , PTC thermistor operation ^{*4} , Option fault, Communication option fault, Parameter storage device fault, PU disconnection, Retry count excess ^{*4} , Parameter storage device fault, CPU fault, Operation panel power supply short circuit/RS-485 terminals power supply short circuit, 24 VDC power fault, Abnormal output current detection ^{*4} , Inrush current limit circuit fault ^{*3} , Communication fault, Analog input fault, USB communication fault, Safety circuit fault, Overspeed occurrence ^{*4} , Speed deviation excess detection ^{*1} ^{*4} , Signal loss detection ^{*1} ^{*4} , Excessive position fault ^{*1} ^{*4} , Brake sequence fault ^{*4} , Encoder phase fault ^{*1} ^{*4} , 4 mA input fault ^{*4} , Pre-charge fault ^{*4} , PID signal fault ^{*4} , Option fault, Opposite rotation deceleration fault ^{*4} , Internal circuit fault, Magnetic pole position unknown ^{*1}	
		Fan alarm, Stall prevention (overspeed), Stall prevention (overvoltage), Regenerative brake pre-alarm ^{*3} ^{*4} , Electronic thermal relay function pre-alarm, PU stop, Speed limit indication ^{*4} , Parameter copy, Safety stop, Maintenance signal output ^{*4} , USB host error, Home position return setting error ^{*4} , Home position return uncompleted ^{*4} , Home position return parameter setting error ^{*4} , Operation panel lock ^{*4} , Password locked ^{*4} , Parameter write error, Copy operation error, 24 V external power supply operation, Ethernet communication fault ^{*5}	
Environment	Surrounding air temperature		-10°C to +50°C (non-freezing) (LD, ND, and HD ratings) -10°C to +40°C (non-freezing) (SLD rating)
	Surrounding air humidity		95% RH or less (non-condensing) (With circuit board coating (IEC60721-3-3: 1994 3C2/3S2 compatible)) 90% RH or less (non-condensing) (Without circuit board coating)
	Storage temperature ^{*6}		-20°C to +65°C
	Atmosphere		Indoors (without corrosive gas, flammable gas, oil mist, dust and dirt, etc.)
	Altitude/vibration		Maximum 2500 m (For installation at an altitude above 1000 m, consider a 3% reduction in the rated current per 500 m increase in altitude.), 5.9 m/s ² or less ^{*7} at 10 to 55 Hz (directions of X, Y, Z axes)

*1 The vector control is available only when a vector control compatible option is installed.

*2 In the initial setting for the FR-A820-00340(5.5K) or higher and the FR-A840-00170(5.5K) or higher, the starting torque is limited to 150% by the torque limit level.

*3 Available only for the standard model.

*4 This protective function is not available in the initial status.


*5 Available for the FR-A800-E only.

*6 Temperature applicable for a short time, e.g. in transit.

*7 2.9 m/s² or less for the FR-A840-04320(160K) or higher.

Outline dimensions

● Standard model

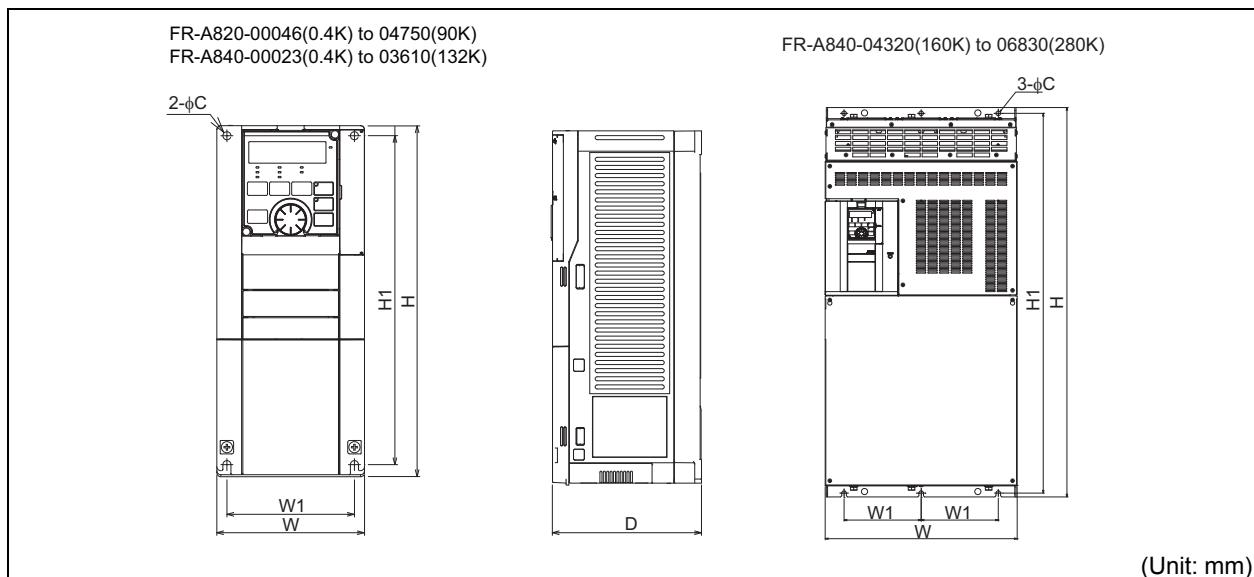

◆ 200 V class

Inverter model	W	W1	H	H1	D	C
FR-A820-00046(0.4K)	110	95			110	
FR-A820-00077(0.75K)					125	
FR-A820-00105(1.5K)	150	125	260	245	140	
FR-A820-00167(2.2K)					170	
FR-A820-00250(3.7K)						
FR-A820-00340(5.5K)	220	195	300	285	190	
FR-A820-00490(7.5K)						
FR-A820-00630(11K)			400	380	250	
FR-A820-00770(15K)	250	230			195	
FR-A820-00930(18.5K)						
FR-A820-01250(22K)						
FR-A820-01540(30K)	325	270	550	530	195	
FR-A820-01870(37K)	435	380		525	250	
FR-A820-02330(45K)						
FR-A820-03160(55K)	465	410	700	675	360	
FR-A820-03800(75K)						
FR-A820-04750(90K)		400	740	715		


◆ 400 V class

Inverter model	W	W1	H	H1	D	C
FR-A840-00023(0.4K)						
FR-A840-00038(0.75K)	150	125	260	245	140	
FR-A840-00052(1.5K)					170	
FR-A840-00083(2.2K)						
FR-A840-00126(3.7K)						
FR-A840-00170(5.5K)						
FR-A840-00250(7.5K)	220	195	300	285	190	
FR-A840-00310(11K)						
FR-A840-00380(15K)						
FR-A840-00470(18.5K)	250	230	400	380	250	
FR-A840-00620(22K)						
FR-A840-00770(30K)	325	270	550	530	195	
FR-A840-00930(37K)				525	250	
FR-A840-01160(45K)	435	380				
FR-A840-01800(55K)						
FR-A840-02160(75K)			620	595	300	
FR-A840-02600(90K)	465	400				
FR-A840-03250(110K)			740	715	360	
FR-A840-03610(132K)						
FR-A840-04320(160K)	498	200	1010	985	380	
FR-A840-04810(185K)						
FR-A840-05470(220K)						
FR-A840-06100(250K)	680	300		984		
FR-A840-06830(280K)						


Outline dimensions

- Separated converter type

FR-A842-07700(315K), 08660(355K)

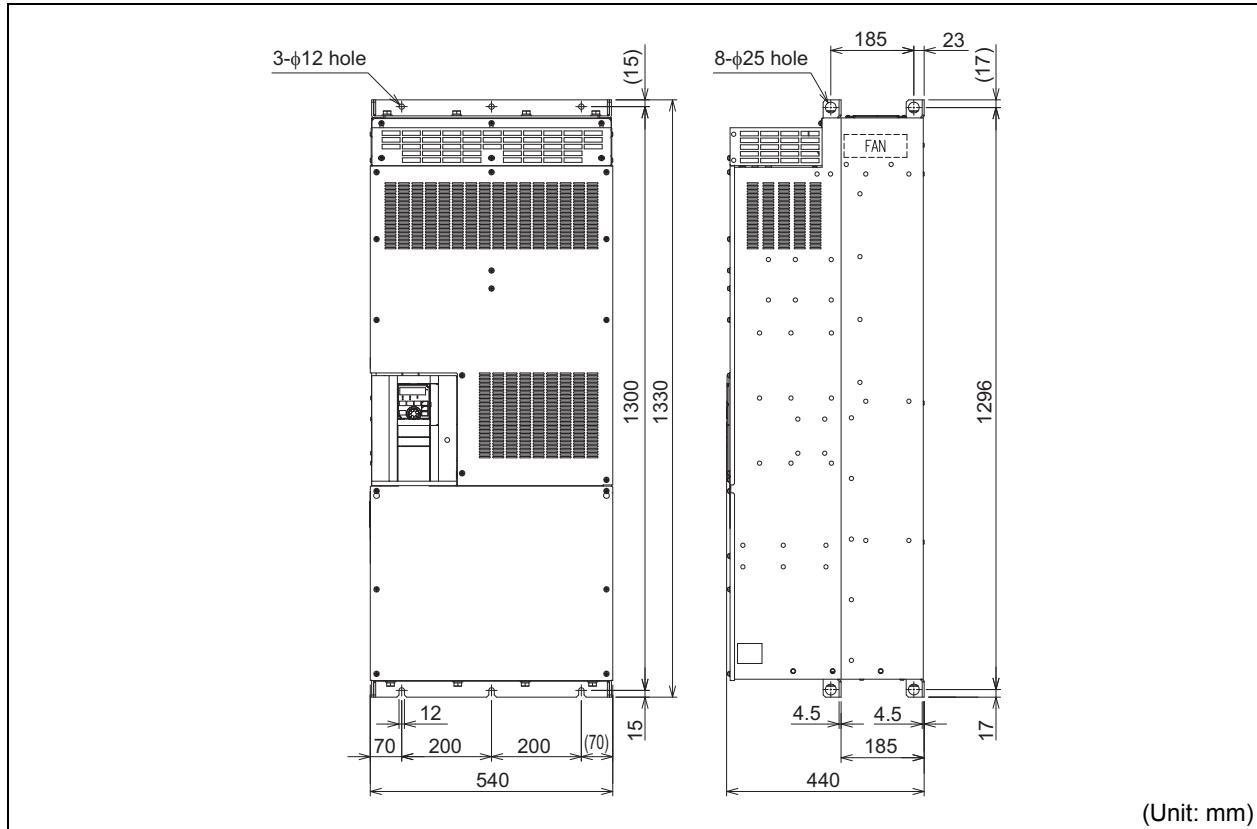

FR-A842-09620(400K), 10940(450K), 12120(500K)

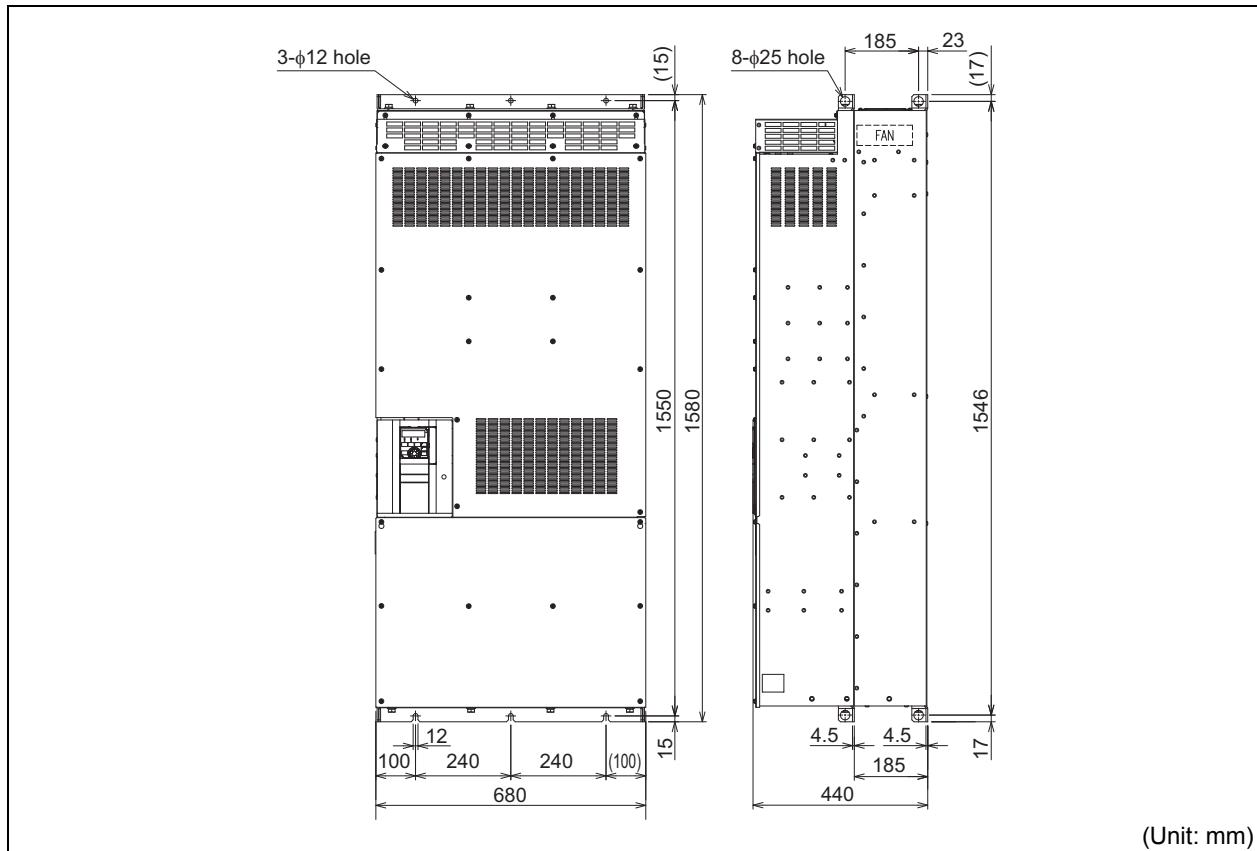

Crane function parameters

The following marks are used to show the applicable control method: **V/F** for V/F control, **Magnetic flux** for Advanced magnetic flux vector control, **Sensorless** for Real sensorless vector control, **Vector** for vector control, and **PM** for PM sensorless vector control. (Parameters without any mark are valid for all controls.)

Pr. denotes parameter numbers, **GROUP** denotes group parameter numbers.

● Parameter list

The following parameters are dedicated to the FR-A800-CRN. Set the parameters according to applications.

Pr.	GROUP	Name	Setting range	Minimum setting increment	Initial value	Refer to page	Customer setting
178 to 189	T700 to T711	Input terminal function selection	54*1	1	*2	22	
190 to 196	M400 to M406	Output terminal function selection	221 to 223, 321 to 323*1	1	*2	22, 23	
270	A200	Stop-on contact/load torque high-speed frequency control selection	0 to 3, 4, 5, 11, 13, 15	1	0	21	
1400	A160	Low-speed range speed control P gain 1	0 to 1000%, 9999	1%	9999	20	
1401	A161	Low-speed range speed control P gain 2	0 to 1000%, 9999	1%	9999	20	
1402	A162	Low-speed range gain corner frequency 1	0 to 60 Hz	0.01 Hz	3 Hz	20	
1403	A163	Low-speed range gain corner frequency 2	0 to 60 Hz	0.01 Hz	5 Hz	20	
1404	A164	Shortest-time torque startup selection	0, 1	1	0	20	
1405	A165	Overload detection time	0 to 10 s	0.1 s	1 s	22	
1406	A166	Inching prevention time	0 to 5 s	0.01 s	0 s	20	
1407	A167	Magnetic flux command during pre-excitation	0 to 100%	1%	9999	21	
1408	A168	Brake opening current for reverse rotation	0 to 400%	0.1 %	9999	23	
1409	A169	Second brake opening current for reverse rotation	0 to 400%	0.1 %	9999	23	
1410	A170	Starting times lower 4 digits	0 to 9999	1	0	24	
1411	A171	Starting times upper 4 digits	0 to 9999	1	0	24	

*1 For other settings, refer to the Instruction Manual (Detailed) of the FR-A800 inverter.

*2 For the initial setting of each parameter, refer to the Instruction Manual (Detailed) of the FR-A800 inverter.

● Parameter details

Low-speed range speed control P gain

Sensorless Vector PM


Pr.	GROUP	Name	Pr.	GROUP	Name
1400	A160	Low-speed range speed control P gain 1	1401	A161	Low-speed range speed control P gain 2
1402	A162	Low-speed range gain corner frequency 1	1403	A163	Low-speed range gain corner frequency 2

- The P gain for speed control in the low-speed range can be adjusted.
- When an inverter is connected to a lift, the inverter has a load immediately after the lift brake is released. For lift applications, slow response may cause a delay in the brake opening. Adjusting the speed control P gain in the low-speed range improves the response at low speed, and shortens the time from startup to brake opening. This will contribute to a reduction in tact time.

Pr.	Setting range	Description
1400	0 to 1000%	Set the proportional gain during speed control in the low-speed range. (Setting this parameter higher improves the trackability for speed command changes. It also reduces the speed fluctuation caused by external disturbance.)
	9999 (Initial value)	Low-speed range speed control P gain 1 disabled
1401	0 to 1000%	Second function of Pr.1400 (enabled when RT signal ON)
	9999 (Initial value)	Low-speed range speed control P gain 2 disabled
1402	0 to 60 Hz	Set the P gain operation during speed control in the low-speed range.
1403	0 to 60 Hz	

◆ Low-speed range speed control P gain operation

- The P gain operation during speed control in the low-speed range is determined by the Pr.1402 and Pr.1403 settings.

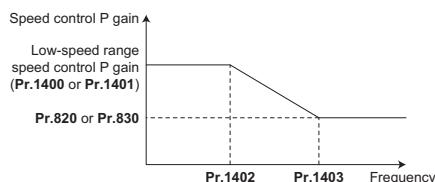

Shortest-time torque startup


Sensorless Vector

Pr.	GROUP	Name
1404	A164	Shortest-time torque startup selection

- The torque is started up in the shortest time.
- When an inverter is connected to a lift, the inverter has a load immediately after the lift brake is released. For lift applications, slow torque startup may cause a delay in the brake opening. Using the shortest-time torque startup function shortens the time from startup to brake opening. This will contribute to a reduction in tact time.

Pr.	Setting range	Description
1404	0 (Initial value)	Shortest-time torque startup disabled
	1	Shortest-time torque startup enabled

- When Pr.1404="1" and the inverter is not in stop status, the torque is generated by the shortest-time torque startup function.

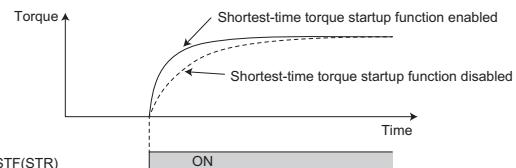


Inching time adjustment function

Pr.	GROUP	Name
1406	A166	Inching prevention time

- By setting a waiting time after the inverter is stopped until the inverter is restarted, inching in the setting time can be prevented.
- When the inverter is repeatedly started and stopped for a short time, overcurrent may occur due to the effect of the motor residual magnetic flux. Adjust the waiting time after the inverter is stopped until the inverter is restarted to suppress current.

Pr.	Setting range	Description
1406	0 to 5 s	Set the time after the inverter output is stopped until the inverter output can be restarted.

- After the inverter output is stopped by turning OFF the start command, the inverter output cannot be restarted for the time set in Pr.1406.

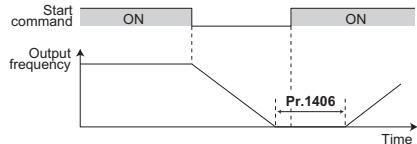

Magnetic flux command during pre-excitation


Sensorless Vector

Pr.	GROUP	Name
1407	A167	Magnetic flux command during pre-excitation

- Adjusting the magnetic flux command during pre-excitation reduces the excitation ratio and power consumption during standby.

Pr.	Setting range	Description
1407	0 to 100%	Set the magnetic flux command value during pre-excitation.
	9999 (Initial value)	Magnetic flux command during pre-excitation disabled

- When the pre-excitation signal (LX) is turned ON while the start command (STF/STR) is OFF, the inverter operates in the magnetic flux command value set in **Pr.1407**.
- During deceleration after the start command is OFF or during DC injection brake operation, the inverter operates in normal magnetic flux command value.

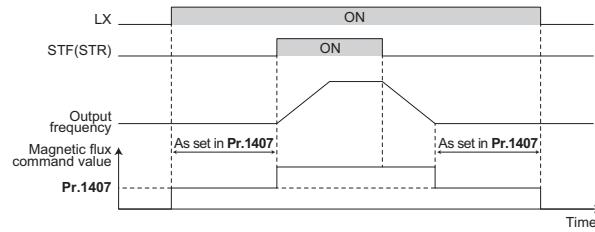

Load torque high-speed frequency control (mode 2)

Pr.	GROUP	Name	Pr.	GROUP	Name
270	A200	Stop-on contact/ load torque high-speed frequency control selection	271	A201	High-speed setting maximum current
272	A202	Middle-speed setting minimum current	273	A203	Current averaging range
274	A204	Current averaging filter time constant	286	G400	Droop gain
287	G401	Droop filter time constant	288	G402	Droop function activation selection
4	D301	Multi-speed setting (high speed)	5	D302	Multi-speed setting (middle speed)

- Load torque high-speed frequency control is a function that automatically sets the operable frequency according to the load.
- After starting the inverter, the inverter runs at high frequency with a light load, or at low frequency with a heavy load, depending on the value of the current. When light loads are moved up or down by a crane, the speed will accelerate automatically, which contributes to reduction in tact time.

Pr.	Setting range	Description	
4	0 to 590 Hz	Set the target frequency during forward rotation.	
5	0 to 590 Hz	Set the target frequency during reverse rotation.	
270	0 (Initial value) 1 2 3 4 5 11 13 15	Normal operation Stop-on-contact control*1 Load torque high-speed frequency control (mode 1)*1 Stop-on contact + load torque high-speed frequency control (mode 1)*1 Load torque high-speed frequency control (mode 2) Stop-on contact + load torque high-speed frequency control (mode 2) Stop-on-contact control*1 Stop-on contact + load torque high-speed frequency control (mode 1)*1 Stop-on contact + load torque high-speed frequency control (mode 2)	
271	0 to 400%	Set the reference torque current value during forward rotation.	
272	0 to 400%	Set the reference torque current value during reverse rotation.	
273	0 to 590 Hz 9999 (Initial value)	Set the frequency at which load torque high-speed frequency control (mode 2) is started. Load torque high-speed frequency control (mode 2) starts at 50% of the rated motor frequency.	
274	1 to 4000	Set the time constant of the primary delay filter relative to the output current. (The time constant [ms] is $0.5 \times \text{Pr.274}$, and the initial value is 8 ms.) A larger setting results in a stable operation with poorer response.	
286	0 (Initial value) 0.1 to 1000%*2	Without output frequency compensation Compensate the output frequency to suppress the torque rise after stopping acceleration.	
287	0 to 1 s	Set the filter time constant to apply to the current for torque.	
288	0 (Initial value) 1 2 10 11	Without droop control 2 during acceleration/deceleration (With 0 limit) Spool diameter expansion compensation Constant droop control 2 during operation (With 0 limit) Constant droop control 2 during operation (Without 0 limit) Without droop control 2 during acceleration/deceleration (With 0 limit) Constant droop control 2 during operation (With 0 limit)	Rated motor frequency is the droop compensation reference. Motor speed is the droop compensation reference.



*1 For the load torque high speed frequency control (mode 1) and the stop-on-contact control, refer to the Instruction Manual (Detailed) of the FR-A800 inverter.

*2 When "load torque high-speed frequency control (mode 2)" is not selected, the droop gain is internally restricted to 100% even if a value exceeding 100% is set.

◆ Operation of load torque high-speed frequency control (mode 2)


- The maximum frequency (**Pr.4** or **Pr.5**) is used as the target frequency for acceleration.
- When the output current (I_q) reaches or exceeds the torque current limit value (I_q limit level), acceleration is interrupted.
- When the output current (I_q) decreases by the interruption, acceleration starts again.
- By switching between acceleration and stopping, acceleration is controlled so that the torque current matches the torque current limit value.

Crane function parameters

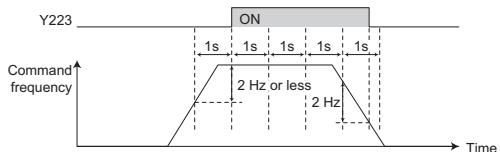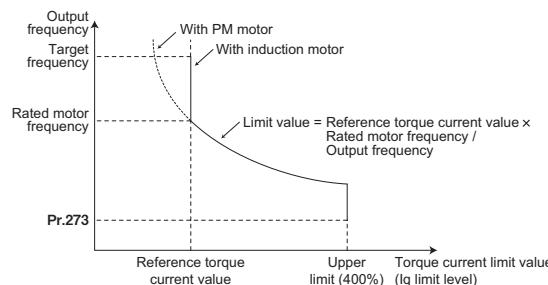


◆ Spool diameter expansion compensation (droop control 2)

- When a wire rope is wound, the motor torque increases along with the increase in spool diameter. The output frequency can be compensated in proportion to the increase in motor torque using droop control 2.
- To compensate against spool diameter expansion, set **Pr.288 Droop function activation selection = Droop gain**.

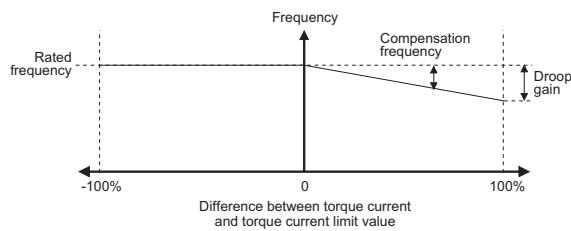

◆ Overload detection (Pr.864, Pr.1405, TU2 signal)

- During constant speed operation (the Y223 signal ON), when the motor torque is equal to or higher than the value set in **Pr.864 Torque detection** for a continuous time equal to or longer than the value set in **Pr.1405 Overload detection time**, the overload detection signal (TU2) is turned ON. When the TU2 signal is ON, the TU2 signal stays ON until the inverter output stops.
- For the TU2 signal, set "221 (positive logic) or 321 (negative logic)" in one of **Pr.190 to Pr.196 (output terminal function selection)** to assign the function to the output terminal.

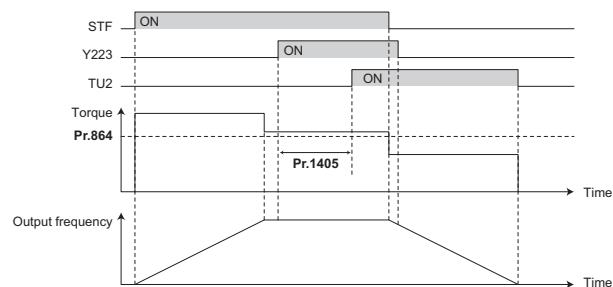

Overload detection

Pr.	GROUP	Name	Pr.	GROUP	Name
864	M470	Torque detection	1405	A165	Overload detection time

- The constant speed signal (Y223) can be output when the range of speed fluctuations is small. By the output of the constant speed signal output, the load torque without the acceleration/ deceleration torque can be confirmed. When this function is used together with the PLC function, the superordinate controller, etc., the control according to the load is enabled.
- The overload can be detected during constant speed operation. When too much load is applied (overload) to a crane, the overload detection signal (TU2) output transmits the information to the superordinate controller.

Pr.	Setting range	Description
864	0 to 400%	Set the torque value where the TU2 signal turns ON.
1405	0 to 10 s	Set the time from when the motor torque reaches or exceeds the Pr.864 setting until the overload detection signal (TU2) is output.

◆ Constant speed signal (Y223 signal)

- When the range of the command frequency fluctuations is 2 Hz/s or less while the inverter is running, the constant speed signal (Y223) is turned ON. When the inverter stops, or when the range of the command frequency fluctuations is more than 2 Hz/s, the constant speed signal (Y223) is turned OFF.
- For the Y223 signal, set "223 (positive logic) or 323 (negative logic)" in one of **Pr.190 to Pr.196 (output terminal function selection)** to assign the function to the output terminal.

Anti-sway control


Pr.	GROUP	Name	Pr.	GROUP	Name
1072	A310	DC brake judgment time for anti-sway control operation	1073	A311	Anti-sway control operation selection
1074	A312	Anti-sway control frequency	1075	A313	Anti-sway control depth
1076	A314	Anti-sway control width	1077	A315	Rope length
1078	A316	Trolley weight	1079	A317	Load weight

- When an object is moved by a crane, swinging is suppressed on the crane's traveling axis.
- Anti-sway control can be disabled with the anti-sway control disabled signal (X54).

Pr.	Setting range	Description
1072	0 to 10 s	Set the time from when the output frequency becomes the Pr.10 DC injection brake operation frequency or less to when the DC injection brake (zero speed control or the servo lock) operation starts.
1073	0 (Initial value) 1	Anti-sway control disabled Anti-sway control enabled
1074	0.05 to 3 Hz 9999	Set a swinging frequency of the object. Anti-sway control is performed using a swinging frequency estimated by the inverter according to the settings of Pr.1077 to Pr.1079 .
1075	0 to 3	0 (Deep) → 3 (Shallow)
1076	0 to 3	0 (Narrow) → 3 (Wide)
1077	0.1 to 50 m	Set the crane rope length.
1078	1 to 50000 kg	Set the trolley weight.
1079	1 to 50000 kg	Set the weight of the object.

◆ Anti-sway control disabled signal (X54 signal)

- When anti-sway control is enabled, the travel distance between the positions where the crane starts deceleration and where the crane stops becomes longer. For an emergency stop by a system using a position confirmation sensor, disable anti-sway control to shorten the stopping distance.
- When anti-sway control is enabled (Pr.1073 Anti-sway control operation selection="1"), turning ON the anti-sway control disabled signal (X54) disables anti-sway control.
- For the X54 signal, set "54" in any of Pr.178 to Pr.189 (input terminal function selection) to assign the function to the input terminal.

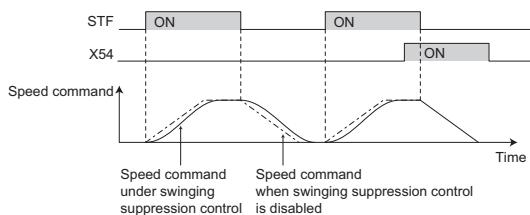


Falling detection V/F Magnetic flux Vector

Pr.	GROUP	Name
870	M400	Speed detection hysteresis

- When the commanded direction differs from the actual motor rotation direction, the falling detection signal (Y222) can be output.
- Slippage during the start of a lift can be checked. (A speed detector such as an encoder is required.)

Pr.	Setting range	Description
870	0 to 5 Hz	Set the hysteresis width for the detected frequency.

- When the commanded direction differs from the actual motor rotation direction, and the actual motor speed is higher than the value set in Pr.870 Speed detection hysteresis, the falling detection signal (Y222) is turned ON.
- For the Y222 signal, set "222 (positive logic) or 322 (negative logic)" in any of Pr.190 to Pr.196 (output terminal function selection) to assign the function to the output terminal.

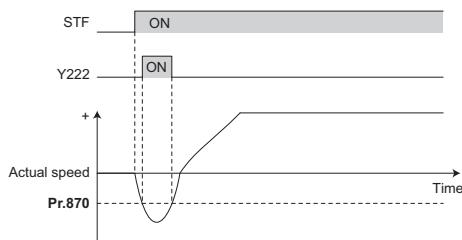

Brake opening current level setting for reverse rotation (Brake sequence function)

Pr.	GROUP	Name	Pr.	GROUP	Name
278	A100	Brake opening frequency	279	A101	Brake opening current
280	A102	Brake opening current detection time	281	A103	Brake operation time at start
282	A104	Brake operation frequency	283	A105	Brake operation time at stop
284	A106	Deceleration detection function selection	285	A107	Overspeed detection frequency
292	F500	Automatic acceleration/ deceleration	639	A108	Brake opening current selection
640	A109	Brake operation frequency selection	641	A130	Second brake sequence operation selection
642	A120	Second brake opening frequency	643	A121	Second brake opening current
644	A122	Second brake opening current detection time	645	A123	Second brake operation time at start
646	A124	Second brake operation frequency	647	A125	Second brake operation time at stop
648	A128	Second deceleration detection function selection	650	A128	Second brake opening current selection
651	A129	Second brake operation frequency selection	1408	A168	Brake opening current for reverse rotation
1409	A169	Second brake opening current for reverse rotation			


- The brake sequence function enables setting of the brake opening level individually for forward rotation and reverse rotation.

Pr.	Setting range	Description
1408	0 to 400%	Set the brake opening current during reverse rotation. Set between 50 and 90% because load slippage is more likely to occur at a start setting is too low.
	9999 (Initial value)	During reverse rotation, the Pr.279 setting is applied.
1409	0 to 400%	Set the brake opening current during reverse rotation in the second brake sequence function.
	9999 (Initial value)	During reverse rotation, the Pr.643 setting is applied.

- When the start signal is input to the inverter, the inverter starts running, and when the output frequency reaches the frequency set in Pr.278 Brake opening frequency and the output current is equal to or greater than the Brake opening current setting, the brake opening request signal (BOF) is output after the time set in Pr.280 Brake opening current detection time.

Crane function parameters

- The output current level or the motor torque level to output the BOF signal can be set individually for forward rotation and reverse rotation. Set the output current or the motor torque during reverse rotation in **Pr.1408 Brake opening current for reverse rotation**. (When **Pr.1408** = "9999", the Pr.279 setting is applied also during reverse rotation.)

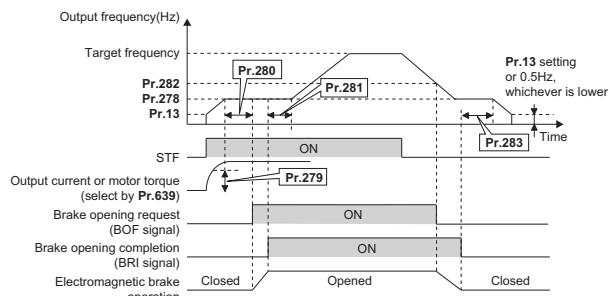


Start count monitor

Pr. GROUP	Name	Pr. GROUP	Name
1410 A170	Starting times lower 4 digits	1411 A171	Starting times upper 4 digits

- The inverter starting times can be counted.
- Confirming the starting times can be used to determinate the timing of the maintenance, or can be used as a reference for system inspection or parts replacement.

Pr.	Setting range	Description
1410	0 to 9999	Displays the lower four digits of the number of the inverter starting times.
1411	0 to 9999	Displays the upper four digits of the number of the inverter starting times.

- Every start signal input (the RUN signal ON) while the inverter output is stopped is counted as the inverter starting time. (Starting during pre-excitation is also counted.)

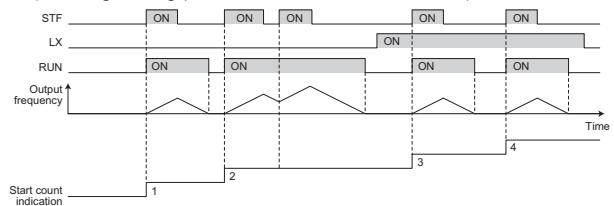

● Major differences between the FR-A800-CRN (RS-485 communication model) and the FR-A800-E-CRN (Ethernet communication model)

Item	FR-A800-CRN (RS-485 communication model)	FR-A800-E-CRN (Ethernet communication model)
Standard equipment	RS-485 terminals	Ethernet connector
Communication	Mitsubishi inverter protocol MODBUS RTU protocol	MODBUS/TCP MELSOFT / FA product connection SLMP iQSS CC-Link IE Field Network Basic
Number of connectable plug-in options	3	2 (initial status)
Optional screw-type terminal block (FR-A8TR)	Can be used.	Cannot be used.

Warranty

When using this product, make sure to understand the warranty described below.

1. Warranty period and coverage

We will repair any failure or defect (hereinafter referred to as "failure") in our FA equipment (hereinafter referred to as the "Product") arisen during warranty period at no charge due to causes for which we are responsible through the distributor from which you purchased the Product or our service provider. However, we will charge the actual cost of dispatching our engineer for an on-site repair work on request by customer in Japan or overseas countries. We are not responsible for any on-site readjustment and/or trial run that may be required after a defective unit are repaired or replaced.

[Term]

The term of warranty for Product is twelve months after your purchase or delivery of the Product to a place designated by you or eighteen months from the date of manufacture whichever comes first ("Warranty Period"). Warranty period for repaired Product cannot exceed beyond the original warranty period before any repair work.

[Limitations]

- (1) You are requested to conduct an initial failure diagnosis by yourself, as a general rule. It can also be carried out by us or our service company upon your request and the actual cost will be charged.
However, it will not be charged if we are responsible for the cause of the failure.
- (2) This limited warranty applies only when the condition, method, environment, etc. of use are in compliance with the terms and conditions and instructions that are set forth in the instruction manual and user manual for the Product and the caution label affixed to the Product.
- (3) Even during the term of warranty, the repair cost will be charged on you in the following cases:
 - 1) a failure caused by your improper storing or handling, carelessness or negligence, etc., and a failure caused by your hardware or software problem
 - 2) a failure caused by any alteration, etc. to the Product made on your side without our approval
 - 3) a failure which may be regarded as avoidable, if your equipment in which the Product is incorporated is equipped with a safety device required by applicable laws and has any function or structure considered to be indispensable according to a common sense in the industry
 - 4) a failure which may be regarded as avoidable if consumable parts designated in the instruction manual, etc. are duly maintained and replaced
 - 5) any replacement of consumable parts (condenser, cooling fan, etc.)
 - 6) a failure caused by external factors such as inevitable accidents, including without limitation fire and abnormal fluctuation of voltage, and acts of God, including without limitation earthquake, lightning and natural disasters
 - 7) a failure generated by an unforeseeable cause with a scientific technology that was not available at the time of the shipment of the Product from our company
 - 8) any other failures which we are not responsible for or which you acknowledge we are not responsible for

2. Term of warranty after the stop of production

- (1) We may accept the repair at charge for another seven (7) years after the production of the product is discontinued. The announcement of the stop of production for each model can be seen in our Sales and Service, etc.
- (2) Please note that the Product (including its spare parts) cannot be ordered after its stop of production.

3. Service in overseas

Our regional FA Center in overseas countries will accept the repair work of the Product; however, the terms and conditions of the repair work may differ depending on each FA Center. Please ask your local FA center for details.

4. Exclusion of responsibility for compensation against loss of opportunity, secondary loss, etc.

Regardless of the gratis warranty term, Mitsubishi Electric shall not be liable for compensation to:

- (1) Damages caused by any cause found not to be the responsibility of Mitsubishi Electric.
- (2) Loss in opportunity, lost profits incurred to the user by Failures of Mitsubishi Electric products.
- (3) Special damages and secondary damages whether foreseeable or not, compensation for accidents, and compensation for damages to products other than Mitsubishi Electric products.
- (4) Replacement by the user, maintenance of on-site equipment, start-up test run and other tasks.

5. Change of Product specifications

Specifications listed in our catalogs, manuals or technical documents may be changed without notice.

6. Application and use of the Product

- (1) For the use of our product, its applications should be those that may not result in a serious damage even if any failure or malfunction occurs in product, and a backup or fail-safe function should operate on an external system to product when any failure or malfunction occurs.

- (2) Our product is designed and manufactured as a general purpose product for use at general industries.


Therefore, applications substantially influential on the public interest for such as atomic power plants and other power plants of electric power companies, and also which require a special quality assurance system, including applications for railway companies and government or public offices are not recommended, and we assume no responsibility for any failure caused by these applications when used.

In addition, applications which may be substantially influential to human lives or properties for such as airlines, medical treatments, railway service, incineration and fuel systems, man-operated material handling equipment, entertainment machines, safety machines, etc. are not recommended, and we assume no responsibility for any failure caused by these applications when used.

We will review the acceptability of the abovementioned applications, if you agree not to require a specific quality for a specific application. Please contact us for consultation.

Support

● Global FA Center

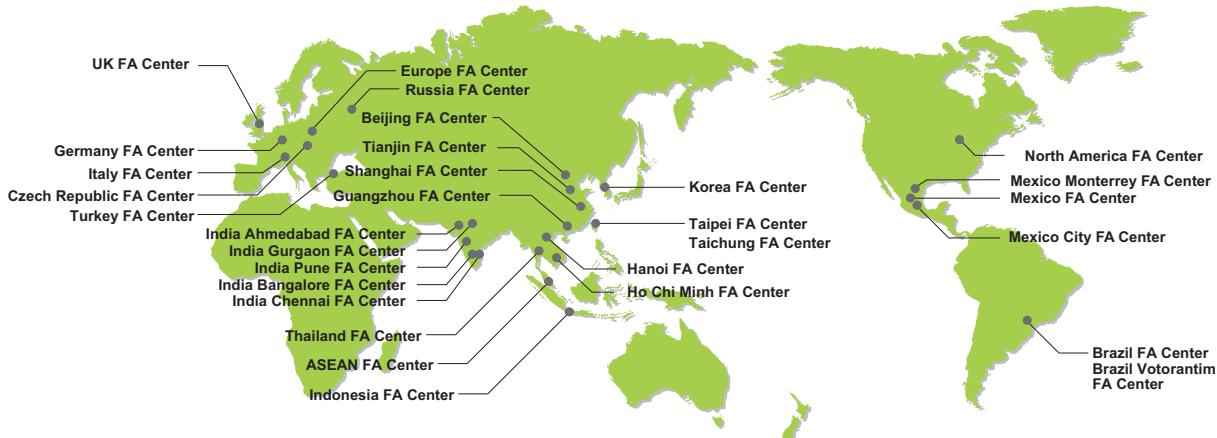

● Shanghai FA Center

MITSUBISHI ELECTRIC AUTOMATION (CHINA) LTD. Shanghai FA Center
Mitsubishi Electric Automation Center, No.1386 Hongqiao Road, Shanghai, China
TEL. 86-21-2322-3030 FAX. 86-21-2322-3000 (9611#)

● Beijing FA Center

MITSUBISHI ELECTRIC AUTOMATION (CHINA) LTD. Beijing FA Center
5/F, ONE INDIGO, 20 Jiuxianqiao Road Chaoyang District, Beijing, China
TEL. 86-10-6518-8830 FAX. 86-10-6518-2938

● Tianjin FA Center

MITSUBISHI ELECTRIC AUTOMATION (CHINA) LTD. Tianjin FA Center
Room 2003 City Tower, No.35, Youyi Road, Hexi District, Tianjin, China
TEL. 86-22-2813-1015 FAX. 86-22-2813-1017

● Guangzhou FA Center

MITSUBISHI ELECTRIC AUTOMATION (CHINA) LTD. Guangzhou FA Center
Room 1609, North Tower, The Hub Center, No.1068, Xingang East Road, Haizhu District, Guangzhou, China
TEL. 86-20-8923-6730 FAX. 86-20-8923-6715

● Korea FA Center

MITSUBISHI ELECTRIC AUTOMATION KOREA CO., LTD.
8F, Gangseo Hangang Xi-tower A, 401, Yangcheon-ro , Gangseo-Gu, Seoul 07528, Korea
TEL. 82-2-3660-9630 FAX. 82-2-3664-0475

● Taipei FA Center

SETSUJO ENTERPRISE CO., LTD.
3F, No.105, Wugong 3rd Road, Wugu District, New Taipei City 24889, Taiwan
TEL. 886-2-2299-9917 FAX. 886-2-2299-9963

● Taichung FA Center

MITSUBISHI ELECTRIC TAIWAN CO., LTD.
No.8-1, Industrial 16th Road, Taichung Industrial Park, Taichung City 40768 Taiwan
TEL. 886-4-2359-0688 FAX. 886-4-2359-0689

● Thailand FA Center

MITSUBISHI ELECTRIC FACTORY AUTOMATION (THAILAND) CO., LTD.
12th Floor, SV.City Building, Office Tower 1, No. 896/19 and 20 Rama 3 Road, Kwaeng Bangpongpong, Khet Yannawa, Bangkok 10120, Thailand
TEL. 66-2682-6522 to 31 FAX. 66-2682-6020

● ASEAN FA Center

MITSUBISHI ELECTRIC ASIA PTE. LTD.
307, Alexandra Road, Mitsubishi Electric Building, Singapore 159943
TEL. 65-6470-2480 FAX. 65-6476-7439

● Indonesia FA Center

PT. MITSUBISHI ELECTRIC INDONESIA Cikarang Office
Jl. Kenari Raya Blok G2-07A Delta Silicon 5, Lippo Cikarang - Bekasi 17550, Indonesia
TEL. 62-21-2961-7797 FAX. 62-21-2961-7794

● Hanoi FA Center

MITSUBISHI ELECTRIC VIETNAM COMPANY LIMITED Hanoi Branch Office
6th Floor, Detech Tower, 8 Ton That Thuyet Street, My Dinh 2 Ward, Nam Tu Liem District, Hanoi, Vietnam
TEL. 84-4-3937-8075 FAX. 84-4-3937-8076

● Ho Chi Minh FA Center

MITSUBISHI ELECTRIC VIETNAM COMPANY LIMITED
Unit 01-04, 10th Floor, Vincom Center, 72 Le Thanh Ton Street, District 1, Ho Chi Minh City, Vietnam
TEL. 84-8-3910-5945 FAX. 84-8-3910-5947

● India Pune FA Center

MITSUBISHI ELECTRIC INDIA PVT. LTD. Pune Branch
Emerald House, EL -3, J Block, M.I.D.C Bhosari, Pune - 411026, Maharashtra, India
TEL. 91-20-2710-2000 FAX. 91-20-2710-2100

● India Gurgaon FA Center

MITSUBISHI ELECTRIC INDIA PVT. LTD. Gurgaon Head Office
2nd Floor, Tower A & B, Cyber Greens, DLF Cyber City, DLF Phase - III, Gurgaon - 122002 Haryana, India
TEL. 91-124-463-0300 FAX. 91-124-463-0399

● India Bangalore FA Center

MITSUBISHI ELECTRIC INDIA PVT. LTD. Bangalore Branch
Prestige Emerald, 6th Floor, Municipal No. 2, Madras Bank Road, Bangalore - 560001, Karnataka, India
TEL. 91-80-4020-1600 FAX. 91-80-4020-1699

● India Chennai FA Center

MITSUBISHI ELECTRIC INDIA PVT. LTD. Chennai Branch
Citilights Corporate Centre No.1, Vivekananda Road, Srinivasa Nagar, Chetpet, Chennai - 600031, Tamil Nadu, India
TEL. 91-44-45548772 FAX. 91-44-45548773

● India Ahmedabad FA Center

MITSUBISHI ELECTRIC INDIA PVT. LTD. Ahmedabad Branch
B/4, 3rd Floor, SAFAL Profitaire, Corporate Road, Prahaladnagar, Satellite, Ahmedabad - 380015, Gujarat, India
TEL. 91-7965120063

● North America FA Center

MITSUBISHI ELECTRIC AUTOMATION, INC.
500 Corporate Woods Parkway, Vernon Hills, IL 60061, U.S.A.
TEL. 1-847-478-2334 FAX. 1-847-478-2253

● Mexico FA Center

MITSUBISHI ELECTRIC AUTOMATION, INC. Queretaro Office
Parque Tecnológico Innovación Queretaro Lateral Carretera Estatal 431, Km 2 200, Lote 91 Módulos 1 y 2 Hacienda la Machorra, CP 76246, El Marques, Queretaro, Mexico
TEL. 52-442-153-6014

● Mexico Monterrey FA Center

MITSUBISHI ELECTRIC AUTOMATION, INC. Monterrey Office
Plaza Mirage, Av. Gonzalez 460 Sur, Local 28, Col. San Jeronimo, Monterrey, Nuevo Leon, C.P. 64640, Mexico
TEL. 52-55-3067-7521

● Mexico City FA Center

MITSUBISHI ELECTRIC AUTOMATION, INC. Mexico Branch
Mariachi Escobedo #69, Col.Zona Industrial, Tlalnepantla Edo. Mexico, C.P.54030
TEL. 52-55-3067-7511

● Brazil FA Center

MITSUBISHI ELECTRIC DO BRASIL COMERCIO E SERVICOS LTDA.
Avenida Adelino Cardana, 293, 21 andar, Bethaville, Barueri SP, Brazil
TEL. 55-11-4689-3000 FAX. 55-11-4689-3016

● Brazil Votorantim FA Center

MELCO CNC DO BRASIL COMERCIO E SERVICOS S.A.
Avenida Gisele Constantino,1578, Parque Bela Vista - Votorantim-SP, Brazil
TEL. 55-15-3023-9000 FAX. 55-15-3363-9911

● Europe FA Center

MITSUBISHI ELECTRIC EUROPE B.V. Polish Branch
ul. Krakowska 50, 32-083 Balice, Poland
TEL. 48-12-347-65-81

● Germany FA Center

MITSUBISHI ELECTRIC EUROPE B.V. German Branch
Mitsubishi-Electric-Platz 1, 40882 Ratingen, Germany
TEL. 49-2102-486-0 FAX. 49-2102-486-1120

● UK FA Center

MITSUBISHI ELECTRIC EUROPE B.V. UK Branch
Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, UK.
TEL. 44-1707-28-8780 FAX. 44-1707-27-8695

● Czech Republic FA Center

MITSUBISHI ELECTRIC EUROPE B.V. Czech Branch
Pekarska 621/7, 155 00 Praha 5, Czech Republic
TEL. 420-255 719 200

● Italy FA Center

MITSUBISHI ELECTRIC EUROPE B.V. Italian Branch
Centro Direzionale Colleoni - Palazzo Sironi, Viale Colleoni 7, 20164 Agrate Brianza (MB), Italy
TEL. 39-039-60531 FAX. 39-039-6053-312

● Russia FA Center


MITSUBISHI ELECTRIC (Russia) LLC St. Petersburg Branch
Piskarevsky pr. 2, bld 2, lit "Sch", BC "Benua", office 720, 195027, St. Petersburg, Russia

TEL. 7-812-633-3497 FAX. 7-812-633-3499

● Turkey FA Center

MITSUBISHI ELECTRIC TURKEY A.S. Umraniye Branch
Serifali Mahallesi Nutuk Sokak No:5, TR-34775 Umraniye / Istanbul, Turkey
TEL. 90-216-526-3990 FAX. 90-216-526-3995

YOUR SOLUTION PARTNER

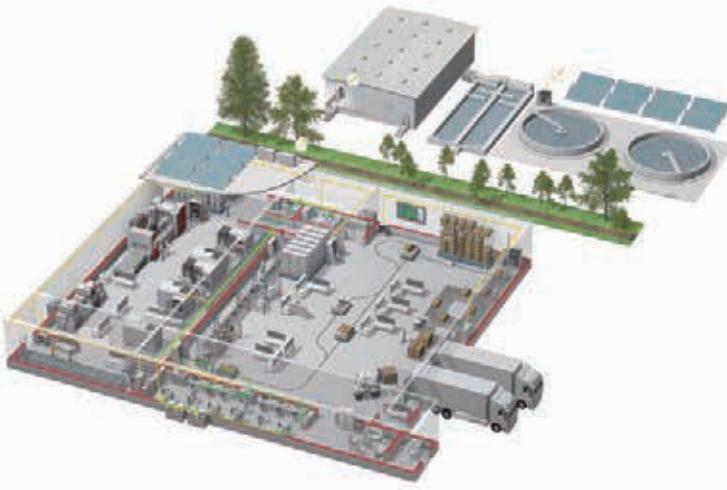

Mitsubishi Electric offers a wide range of automation equipment from PLCs and HMIs to CNC and EDM machines.

A NAME TO TRUST

Since its beginnings in 1870, some 45 companies use the Mitsubishi name, covering a spectrum of finance, commerce and industry.

The Mitsubishi brand name is recognized around the world as a symbol of premium quality.

Mitsubishi Electric Corporation is active in space development, transportation, semi-conductors, energy systems, communications and information processing, audio visual equipment and home electronics, building and energy management and automation systems, and has 237 factories and laboratories worldwide in over 121 countries.

This is why you can rely on Mitsubishi Electric automation solution - because we know first hand about the need for reliable, efficient, easy-to-use automation and control in our own factories.

As one of the world's leading companies with a global turnover of over 4 trillion Yen (over \$40 billion), employing over 100,000 people, Mitsubishi Electric has the resource and the commitment to deliver the ultimate in service and support as well as the best products.

* Not all products are available in all countries.

•Trademarks

DeviceNet is a trademark of the ODVA, PROFIBUS is a trademark of the PROFIBUS User Organization, and MODBUS is a registered trademark of SCHNEIDER ELECTRIC USA, INC.
Ethernet is a registered trademark of Fuji Xerox Corporation in Japan.
Other company and product names herein are the trademarks and registered trademarks of their respective owners.



Low voltage: MCCB, MCB, ACB



Medium voltage: VCB, VCC



Power monitoring, energy management



Compact and Modular Controllers



Inverters, Servos and Motors



Visualisation: HMIs



Numerical Control (NC)



Robots: SCARA, Articulated arm



Processing machines: EDM, Lasers, IDS



Transformers, Air conditioning, Photovoltaic systems

mitsubishi electric corporation
HEAD OFFICE: TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN