

Process Meter

K3MA-J

Highly Visible LCD Display with 2-color (Red and Green) LEDs

- Multi-range DC voltage/current input.
- Front-panel key operation for easy setting.
- Average processing function suppresses flicker.
- Scaling, front-panel forced-zero, zero-limit functions.
- Easy confirmation of max/min display.
- Short 80-mm depth (measured from edge of face plate).
- Finger protective cover (standard equipment) guards against electric shock.
- Water- and dust-proof NEMA4X (IP66 equivalent) front panel.
- Recognized to U.S. and Canadian requirements under the Component Recognition Program of UL.
- CE marking.



UL [®] CE

Model Number Structure

■ Model Number Legend

K3MA-J- 1 2 3

1. Input Type

J: DC voltage/current

2. Output Type

None: No output

A2: 2 relay contact outputs (SPST-NO)

3. Supply Voltage

100-240VAC: 100 to 240 VAC

24VAC/VDC: 24 VAC/VDC

Ordering Information

■ List of Models

| Input type | Supply voltage | Output | Model |
|--------------------|----------------|-----------------------------------|----------------------|
| DC voltage/current | 100 to 240 VAC | None | K3MA-J 100-240VAC |
| | | 2 relay contact outputs (SPST-NO) | K3MA-J-A2 100-240VAC |
| | 24 VAC/VDC | None | K3MA-J 24VAC/VDC |
| | | 2 relay contact outputs (SPST-NO) | K3MA-J-A2 24VAC/VDC |

■ Accessories (Order Separately)

| Name | Shape | Model |
|-------------------------|-------|----------|
| Splash-proof Soft Cover | | K32-49SC |
| Hard Cover | | K32-49HC |

Specifications

■ Ratings

| Model | K3MA-J 100-240VAC, K3MA-J-A2 100-240VAC | K3MA-J 24VAC/VDC, K3MA-J-A2 24VAC/VDC |
|---|--|---|
| Supply voltage | 100 to 240 VAC | 24 VAC/VDC |
| Operating voltage range | 85% to 110% of the rated supply voltage | |
| Power consumption (under maximum load) | 6 VA max. | 4.5 VA max. (24 VAC) 4.5 W max. (24 VDC) |
| Insulation resistance | 20 MΩ min. (at 500 VDC) between external terminal and case. Insulation provided between inputs, outputs, and power supply. | |
| Dielectric strength | 2,000 VAC for 1 min between external terminal and case. Insulation provided between inputs, outputs, and power supply. | |
| Noise immunity | ±1,500 V on power supply terminals in normal or common mode. ±1 ∞s, or 100 ns for square-wave noise with 1 ns. | ±480 V on power supply terminals in normal mode. ±1,500 V in common mode. ±1 ∞s, or 100 ns for square-wave noise with 1 ns. |
| Vibration resistance | Vibration: 10 to 55 Hz, Acceleration: 50 m/s ² 5 min each in X, Y, and Z directions for 10 sweeps. | |
| Shock resistance | 150 m/s ² (100 m/s ² for relay contact outputs) 3 times each on 3 axes, 6 directions. | |
| Ambient temperature | Operating: -10°C to 55°C (with no condensation or icing) Storage: -25°C to 65°C (with no condensation or icing) | |
| Ambient humidity | Operating: 25% to 85% (with no condensation) | |
| Approved safety standards | UL3121-1, conforms to EN61010-1 (Pollution degree 2/overvoltage category II) Conforms to VDE0106/P100 (finger protection) | |
| EMC | (EMI) Emission Enclosure: Emission AC Mains: (EMS) Immunity ESD: Immunity RF-interference: Electrical Fast Transient Noise: Immunity Burst Noise: Immunity Surge: Immunity Conducted Disturbance: Immunity Voltage Dip/Interrupting: | EN61326+A1 Industry CISPR 11 Group 1 class A: CISRP16-1/-2 CISPR 11 Group 1 class A: CISRP16-1/-2 EN61326+A1 Industry EN61000-4-2: 4 kV contact discharge 8 kV air discharge EN61000-4-3: 10 V/m (amplitude-modulated, 80 MHz to 1 GHz) EN61000-4-4: 2 kV (power line) 1 kV line to line (I/O signal line) EN61000-4-5: 1 kV (power line) 2 kV line to ground (power line) EN61000-4-6: 3 V (0.15 to 80 MHz) EN61000-4-11: 0.5 cycle, 0, 180°, 100% (rated voltage) |
| Weight | Approx. 200 g | |

■ Characteristics

| | |
|-------------------------------------|---|
| Input signal | DC voltage/current (0 to 20 mA, 4 to 20 mA, 0 to 5 V, 1 to 5 V, ± 5 V, ± 10 V) |
| A/D conversion | Double integral method |
| Sampling period | 250 ms |
| Display refresh period | Sampling period (sampling times multiplied by number of measurements for averaging if average processing is selected.) |
| Max. displayed digits | 5 digits (-19999 to 99999) |
| Display | 7-segment digital display, Character height: 14.2 mm |
| Polarity display | "-" is displayed automatically with a negative input signal. |
| Zero display | Leading zeros are not displayed. |
| Scaling function | Programmable with front-panel key inputs (range of display: -19999 to 99999). The decimal point position can be set as desired. |
| Hold function | Max. hold (maximum value), Min. hold (minimum value) |
| Hysteresis setting | Programmable with front-panel key inputs (0001 to 9999). |
| Other functions | Forced-zero (with front-panel key) Zero-limit Scaling teach function Display color change (green (red), green, red (green), red) OUT type change (upper limit, lower limit, upper/lower limit) Average processing (simple average) |
| Output | Relays: 2 SPST-NO |
| Delay in comparative outputs | 750 ms max. |
| Degree of protection | Front panel: NEMA4X for indoor use (equivalent to IP66) Rear case: IEC standard IP20 Terminals: IEC standard IP00 + finger protection (VDE0106/100) |
| Memory protection | Non-volatile memory (EEPROM) (possible to rewrite 100,000 times) |

■ Measuring Ranges

Process Voltage/Current Inputs

| Input | Measuring range | Measuring accuracy | Input impedance | Displayable range |
|------------|---------------------------------------|--|-------------------|--|
| DC voltage | 1.000 to 5.000 V | $\pm 0.1\%$ FS ± 1 digit max. (at $23\pm 3^\circ\text{C}$) | 1 M Ω min. | -19999 to 99999 (with scaling function) |
| | 0.000 to 5.000 V | | | |
| | -5.000 to 5.000 V | $\pm 0.1\%$ FS ± 1 digit max. (at $23\pm 5^\circ\text{C}$) | | |
| | -10.00 to 10.00 V | | | |
| DC current | 4.00 to 20.00 mA/ 0.00 to 20.00 mA | $\pm 0.1\%$ FS ± 1 digit max. (at $23\pm 3^\circ\text{C}$) | 45 Ω | |



■ Input/Output Ratings

Relay Contact Output

| Item | Resistive load ($\cos\phi = 1$) | Inductive load ($\cos\phi = 0.4$, $L/R=7$ ms) |
|---|--|---|
| Rated load (UL ratings) | 5 A at 250 VAC, 5 A at 30 VDC | 1.5 A at 250 VAC, 1.5 A at 30 VDC |
| Rated carry current | 5 A max. (at COM terminal) | |
| Max. contact voltage | 250 VAC, 150 VDC | |
| Max. contact current | 5 A (at COM terminal) | |
| Max. switching capacity | 1,250 VA, 150 W | 250 VA, 30 W |
| Min. permissible load (P level, reference value) | 10 mA at 5 VDC | |
| Mechanical life | 5,000,000 times min. (at a switching frequency of 1,200 times/min) | |
| Electrical life (at an ambient temperature of 20°C) | 100,000 times min. (at a rated load switching frequency of 10 times/min) | |


Connections

■ Terminal Arrangement

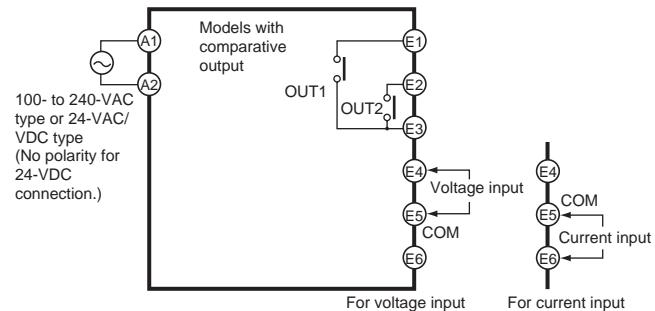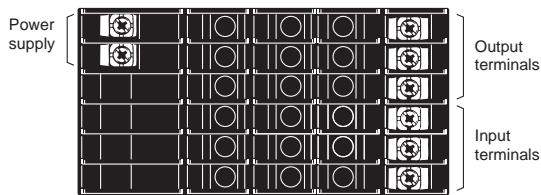

| Terminal No. | Name | Description |
|--------------------|-----------------|---|
| (A1) - (A2) | Operation power | Connects the operation power supply. |
| (E4) , (E6) - (E5) | Analog input | Connects the voltage or current analog input. |
| (E1) , (E2) - (E3) | Outputs | Outputs the relay outputs. |



■ Block Diagram

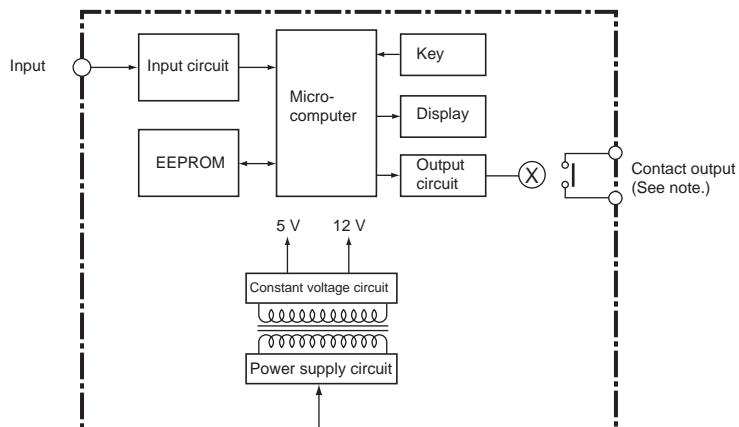

Note: Relay output models only.

■ Input Circuits

Analog Input (DC Voltage/Current)

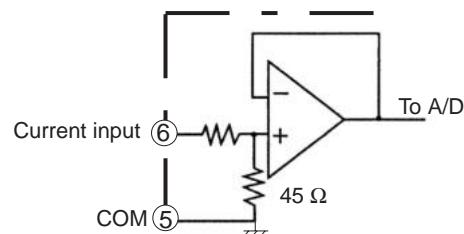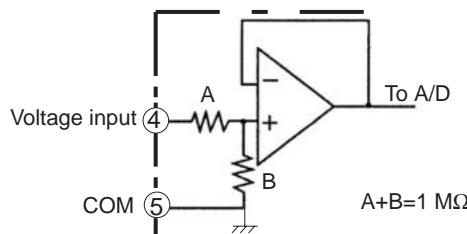

Operation

■ Main Functions

Input Types and Ranges

| Input type (setting parameter) | Function | Input range (setting parameters) | Setting range |
|--------------------------------|---|----------------------------------|---|
| Input range (InP-1) | Selects DC voltage/current signal input | 0 to 20 mA ($0\text{-}20$) | Displayable from -19999 to 99999 with scaling function. The position of the decimal point can be set as desired. |
| | | 4 to 20 mA ($4\text{-}20$) | |
| | | 0 to 5 V ($0\text{-}5$) | |
| | | 1 to 5 V ($1\text{-}5$) | |
| | | ± 5 V (5) | |
| | | ± 10 V (10) | |

Note: The initial value for the input range is "4 to 20 mA ($4\text{-}20$)."

Scaling

- Analog (Process) Inputs

The K3MA-J converts input signals into desired physical values.

INPUT2: Any input value

DISPLAY2: Displayed value corresponding to INPUT2


INPUT1: Any input value

DISPLAY1: Displayed value corresponding to INPUT1

When DISPLAY1 is set for INPUT1, and DISPLAY2 is set for INPUT2, a line will be displayed joining the two points. (Raise shift, reverse scaling, plus/minus display, etc., can be adjusted as desired.)

| Parameter | Setting value | Meaning |
|----------------|-----------------|----------------------------------|
| InP.1 | -19999 to 99999 | Input value for $dSP.1$ |
| $dSP.1$ | -19999 to 99999 | Display value for InP.1 |
| InP.2 | -19999 to 99999 | Input value for $dSP.2$ |
| $dSP.2$ | -19999 to 99999 | Display value for InP.2 |

| Parameter | Setting value | Meaning |
|-----------|---------------|--|
| dp | 0.0000 | Display four digits after decimal point |
| | 00.000 | Display three digits after decimal point |
| | 000.00 | Display two digits after decimal point |
| | 0000.0 | Display one digit after decimal point |
| | 00000 | No decimal point |

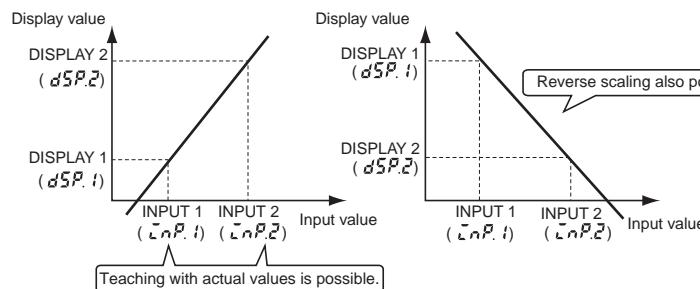

The decimal point can be optionally displayed. When displaying the decimal point, consider the number of digits to follow the decimal point prior to setting the scaling display value.


Reverse scaling, where the display value decreases as the input value increases, is also possible.

Instead of setting by inputting with the Up Key and Shift Key, current values can be input as scaling input values for teaching. This is useful for making settings while checking the operation status of the K3MA-J.

Convenient Functions

Scaling Teach

The parameters (LnP.1 , LnP.2) for the K3MA-J's initial setting level can be set using actual input values with the teaching function. After displaying the parameters, the actual input settings can be made with the following operation.

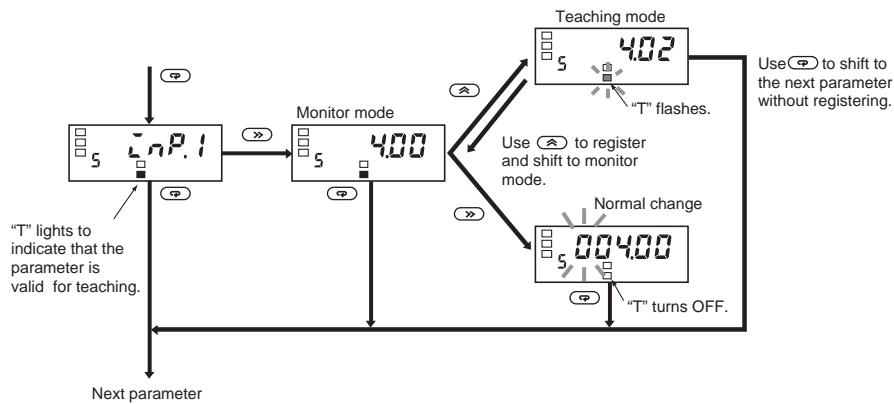


OUT Types (Comparative Output Models Only)


OUT 1 and OUT 2 can be set to operate in one of the three following modes in accordance with the compared values:

- Upper limit (High Acting):
The output is turned ON when the measurement value is greater than its set value.
- Lower limit (Low Acting):
The output is turned ON when the measurement value is less than its set value.
- Upper and lower limits (Outside Band Acting):
An upper limit (H set value) and lower limit (L set value) can be set independently.
The output is turned ON when the measurement value is greater than upper-limit set value or less than the lower-limit set value.


Upper Limit (High Acting)

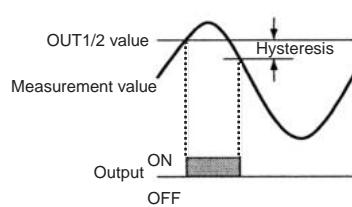

Lower Limit (Low Acting)

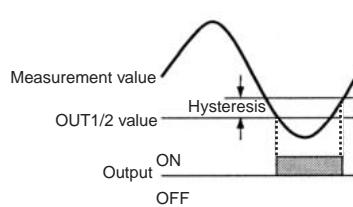


Upper and Lower Limits (Outside Band Acting)

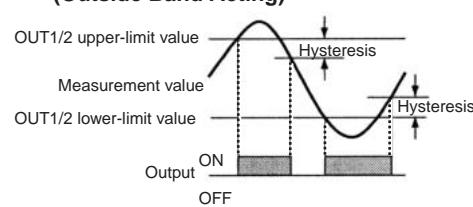


The three types of output operations shown above can be combined as desired. The following are examples of possible combinations.


Upper Limit 2-stage Output

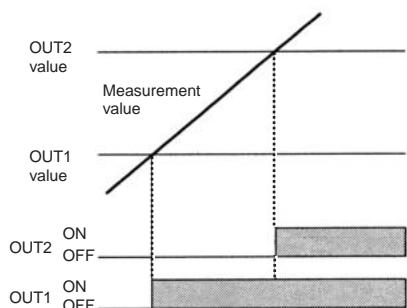

Threshold Output

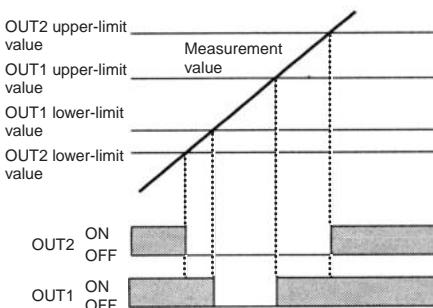

Combination of Upper Limit and Upper/Lower Limits

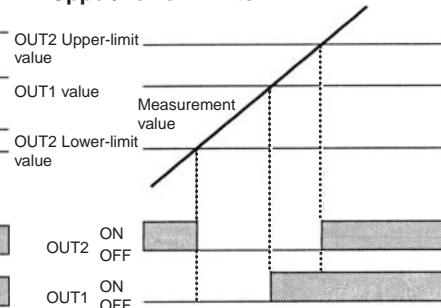

Parameter Initialization


This function returns all of the parameters to their initial values.

| Parameter | Setting value | Meaning |
|-------------|---------------|-----------------------------|
| <i>Init</i> | <i>OFF</i> | --- |
| <i>Init</i> | <i>On</i> | Initializes all parameters. |

Use this to reset the K3MA-J after returning it to its factory-set condition.

Average Processing


Average processing stabilizes displayed values to minimize flicker by averaging the fluctuating input signals. Average processing can be performed for the measurement values in either of four steps (OFF, 2 times, 4 times, or 8 times).

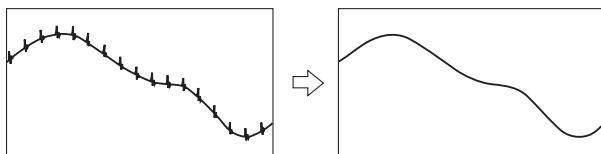

This is useful for ignoring rapid fluctuations, e.g., eliminating spike noise.

Hysteresis (Comparative Output Models Only)


The hysteresis of comparative outputs can be set to prevent chattering in the output when the measurement value fluctuates finely near the OUT value.

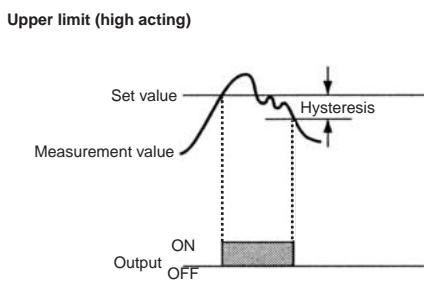

Zero-limit Function


The zero-limit function changes any value below the set value to zero. This is useful when you want to change negative values to zero rather than display them, or when you want to make the display in the smallest part of the input range zero.

| Parameter | Setting value | Meaning |
|---------------|---------------|---------------------------|
| <i>Zero</i> | <i>OFF</i> | OFF: No zero-limit |
| <i>Zero</i> | <i>On</i> | ON: Zero-limit |
| <i>Zero-P</i> | 0 to 99 | 0 to 99: Zero-limit value |

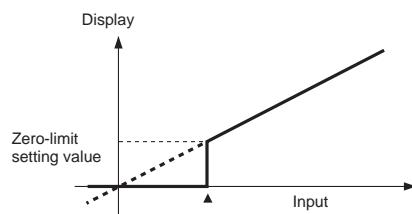

Changing the Display Color

The color of the value displayed can be set to either red or green. For comparative output models, the display color can be set to change from green to red, or from red to green, according to the status of the comparison criterion.

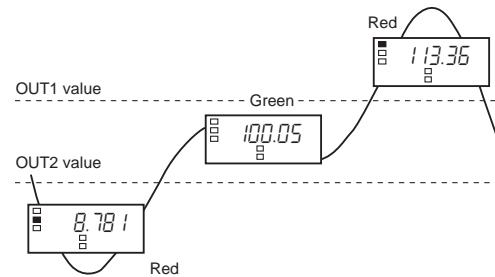

Display Auto-return Time

This function automatically returns the display to the operation level's current value if no keys are pressed for a preset time (called the display auto-return time).

Move-to-Protect-Level Time

The time required to shift to the protect level can be set as desired.

Forced-zero Function


It is possible to shift from a value to the zero point with one touch of the Up Key on the front panel (for example, when adjusting reference values).




Note: Used only for releasing the forced-zero with the Protect menu.

MAX/MIN Display

The maximum and minimum measurement (display) values from the time the power is turned ON until the current time can be stored and displayed. This is useful, for example, when measuring the maximum value.

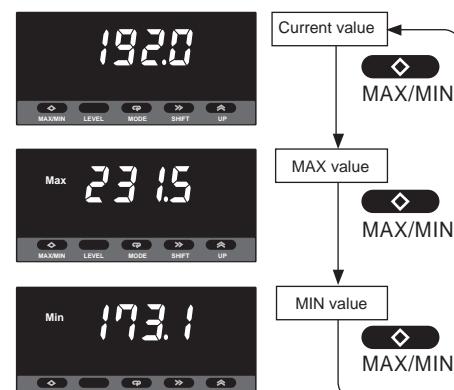


Nomenclature

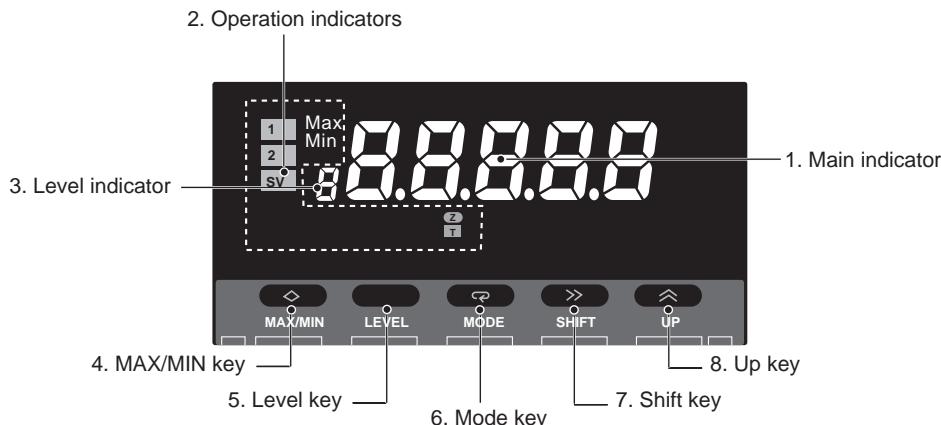


| Name | | Functions |
|-------------------------|----------------|--|
| 1. Main indicator | | Displays current values, parameters, and set values. |
| 2. Operation indicators | 1 | Lit when output 1 is ON. |
| | 2 | Lit when output 2 is ON. |
| | SV | Lit when a set value is being displayed or changed. |
| | Max | Lit when the main indicator is showing the MAX value. |
| | Min | Lit when the main indicator is showing the MIN value. |
| | Z | Lit during the forced-zero operation. |
| 3. Level indicator | T | Lit when the teaching function is operable. Blinks while the teaching function is operating. |
| | | Displays the current level that the K3MA-J is in. (See below for details.) |
| | 4. MAX/MIN Key | Used to display the MAX and MIN values when a measurement value is being displayed. |
| | 5. Level Key | Used to change the level. |
| | 6. Mode Key | Used to allow the main indicator to indicate parameters sequentially. |
| | 7. Shift Key | Used to enable a set value to be changed. When changing a set value, this key is used to move along the digits. |
| 8. Up Key | | Used to change a set value. Used to set or clear a forced-zero function when a measurement value is being displayed. |

| Level indicator | Level |
|-----------------|---------------------------|
| P | Protect |
| Not lit | Operation |
| S | Initial setting |
| F | Advanced-function setting |


Dimensions

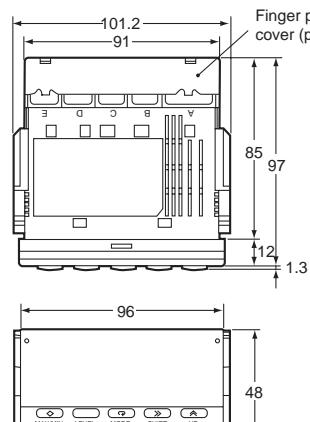

Main indicator character size




Panel cut-out

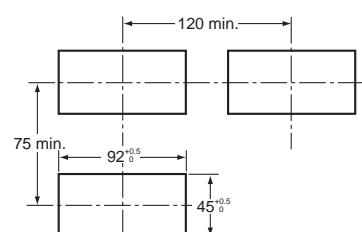

The K3MA-J uses M3 terminals.


Application Examples

Monitoring interior tank pressure

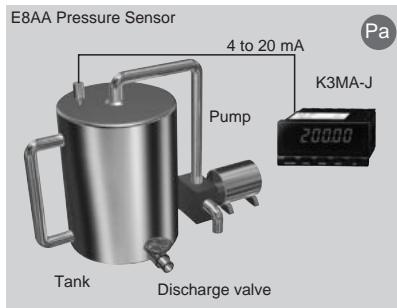


- Monitoring gas pressure
- Inspection instruments in food or pharmaceutical plants

Displaying/outputting liquid level

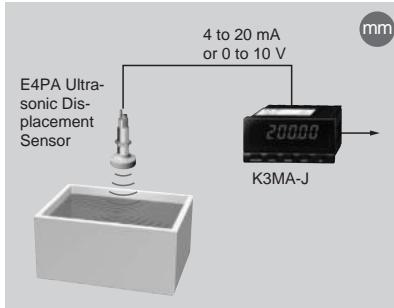

- Monitoring liquid level in cleaning tanks
- Water tanks, devices using chemicals, etc.


Flowrate sensor

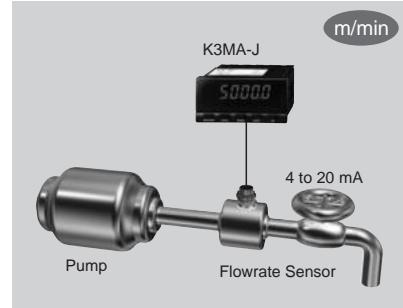


- Monitoring sendout flowrate
- Water processing devices, etc.

Installation

1. Insert the K3MA-J into the panel cut-out hole.
2. For a waterproof installation, insert the rubber gasket onto the body of the K3MA-J.

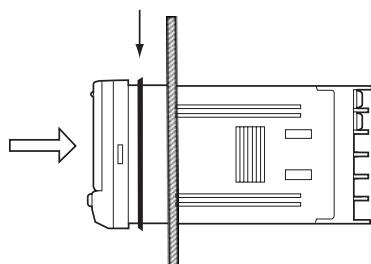

3. Fit the adaptor into the grooves on the left and right sides of the rear case, then push it until it contacts the panel to secure the K3MA-J.



■ Wiring Precautions

- Use crimp terminals.
- Tighten the terminal screws to a torque of approximately 0.5 N·m.
- To avoid the influence of noise, route signal lines and power lines separately.

■ Wiring

- Use the following M3 crimp terminals.



■ Unit Labels (Provided)

- The unit labels are not attached to the K3MA-J. Select the desired labels from the provided sheet.

| | | | | | | | |
|-------|-----|-------|-----|----|----|----------------|---|
| V | A | V | A | % | J | Pa | Ω |
| s | / | N | m | W | °C | m ³ | k |
| °F | g | min | | mm | | rpm | |
| VA | mV | | mA | | Hz | | |
| m/min | OUT | OMRON | OUT | | | | |
| OUT | OUT | | | | | | |

Note: For scales and gauges, use the unit labels that are specified by the relevant laws or regulations.

Precautions

WARNING

Do not touch any of the terminals while the power is being supplied. Doing so may result in electric shock.

Caution

Do not disassemble the product or touch the internal components of the product while the power is being supplied. Doing so may result in electric shock.

Caution

Do not allow metal objects or wire cuttings to enter the product. Doing so may result in electric shock, fire, or malfunction.

Caution

Perform correct settings for the product according to the control application. Failure to do so may cause unexpected operation, resulting in damage to the product or injury.

Caution

Take safety measures, such as installing a separate monitoring system, to ensure safety even if the product fails. Product failure may prevent comparative outputs from being generated, resulting in serious accidents.

Observe the following precautions to ensure safety.

1. Maintain the power supply voltage within the range specified in the specifications.
2. Maintain the load within the ratings specified in the specifications.
3. Check each terminal for correct number and polarity before connecting it. Incorrect or reverse connections may damage or burn out internal components in the product.
4. Tighten the terminal screws securely. The recommended tightening torque is 0.43 to 0.58 N·m. Loose screws may cause fire or malfunction.
5. Do not connect anything to unused terminals.
6. Provide a switch or circuit breaker so that operators can easily turn OFF the power supply when necessary. Also provide appropriate indications of such devices.
7. Do not attempt to disassemble, repair, or modify the product.
8. Do not use the product where flammable or combustible gases are present.

Application

General Precautions

1. Do not use the product in the following locations:
 - Locations subject to direct radiant heat from heating equipment.
 - Locations subject to exposure to water, oil, or chemicals.
 - Locations subject to direct sunlight.
 - Locations subject to dust or corrosive gases (particularly sulfuric gas or ammonia gas).
 - Locations subject to severe changes in temperature.
 - Locations subject to icing or condensation.
 - Locations subject to shock or vibration.
2. Do not block heat dissipation around the product, i.e., provide sufficient space for heat dissipation.
3. Ensure that the rated voltage is reached within two seconds after the power is turned ON.
4. Conduct aging for 15 minutes min. after power is turned ON for correct measurement.


5. Do not touch the slit sections or terminals while the power is being supplied to prevent the product from being affected by static electricity.
6. Do not lay heavy objects on the product during use or storage. Doing so may deform or deteriorate the product.
7. Do not use paint thinner for cleaning. Use commercially available alcohol.

Mounting

- Mount the product to a panel that is 1 to 8 mm thick.
- Install the product in a horizontal position.
- Use crimp terminals that match screw sizes.

Noise Prevention


- Install the product as far as possible from devices that generate strong, high-frequency fields (such as high-frequency welders or sewing machines) or surges.
- Install surge absorbers or noise filters on nearby devices that generate noise (particularly, motors, transformers, solenoids, magnet coils, and other devices that have a high inductance component).

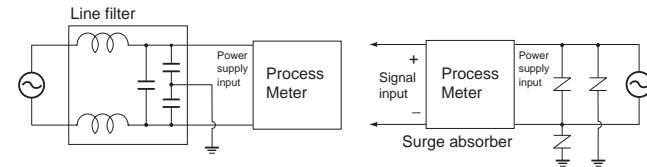

- To prevent inductive noise, separate the terminal block wiring for the product from high-voltage or high-current power lines. Do not route the wiring for the product in parallel with or tie it in a bundle with power lines.

Take the following countermeasures against inductive noise in input lines.

Analog Signal Inputs

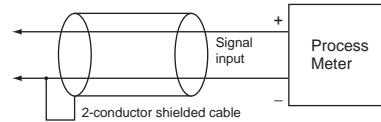

- When using a noise filter for the power supply, check for the voltage and current and install it as close as possible to the Process Meter.
- Do not install the product near radios, television sets, or wireless devices. Doing so may cause reception interference.

Increasing Service Life


- Do not use the product in locations where the temperature or humidity exceeds the ratings or where condensation may occur. When installing the product in a panel, be sure that the temperature around the product (not the temperature around the panel) does not exceed the ratings. The product service life depends on the ambient temperature. The higher the ambient temperature, the shorter the service life. To extend the product service life, lower the temperature inside the Process Meter.
- Use and store the product within the temperature and humidity ranges given in the specifications. When gang-mounting Process Meters or arranging them vertically, heat generated by the Process Meters will cause the internal temperature to rise, reducing the service life. In such cases, consider forced cooling methods, such as using a fan to circulate air around the Process Meters. Do not, however, allow only the terminals to be cooled. Doing so will increase measurement error.
- The life of the output relays is greatly affected by the switching capacity and switching conditions. Use these relays within their rated load and electrical life. The contacts may fuse or burn if they are used past their electrical life.

Operating Procedures

■ Levels

“Level” refers to a grouping of parameters. The following table lists the operations that are possible in each of the levels, and the diagram tells how to move between levels. There are some parameters that are not displayed for certain models.

| Level name | Function | Measurement |
|---------------------------|--|-------------|
| Protect | Setting lockouts. | Continue |
| Operation | Displaying current values, setting/clearing forced-zero function, and setting OUT 1/2 values. | Continue |
| Initial setting | Making initial settings of input type, scaling, output operating action, and other parameters. | Stopped |
| Advanced-function setting | Setting average processing, display color settings, and other advanced-function parameters. | Stopped |

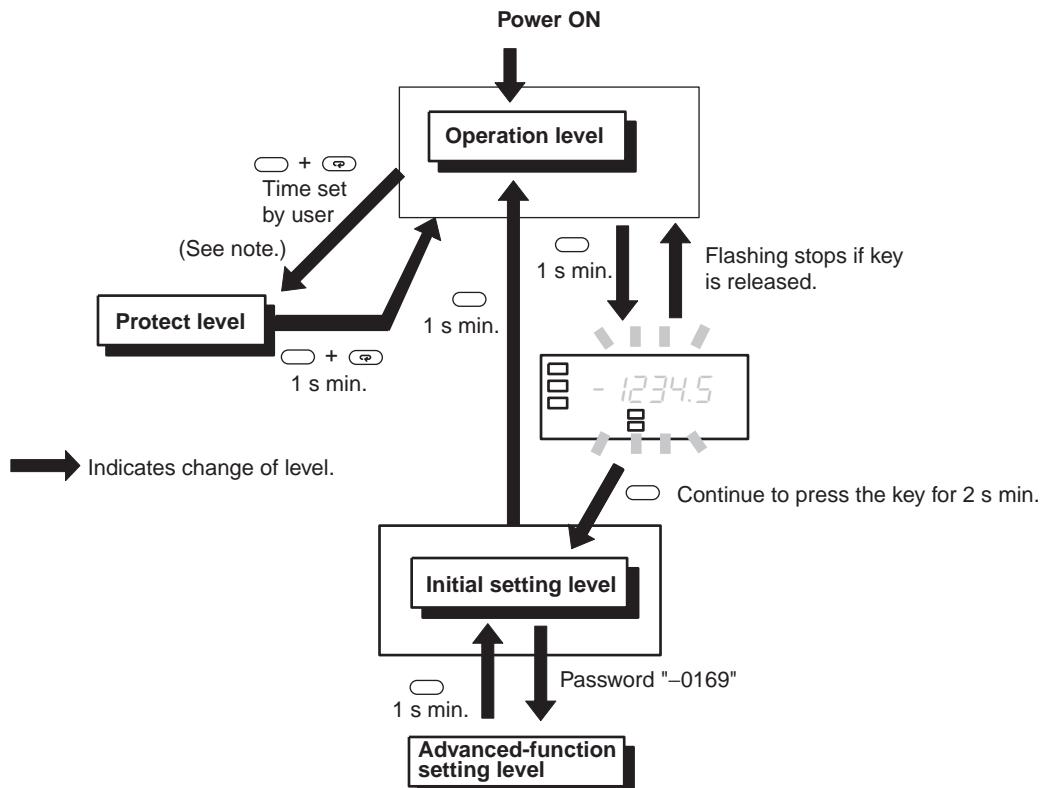



Note: The move-to-protect-level time can be set in the advanced-function setting level.


■ Parameters

Note:

1. Some parameters are not displayed for certain models.
2. The K3MA-J will stop measurement if the level is changed to the initial setting level or the advanced-function setting level.
3. If the input range is changed, some parameters are set to default values. Therefore, set the input range first.
4. Settings displayed in reversed colors are defaults.

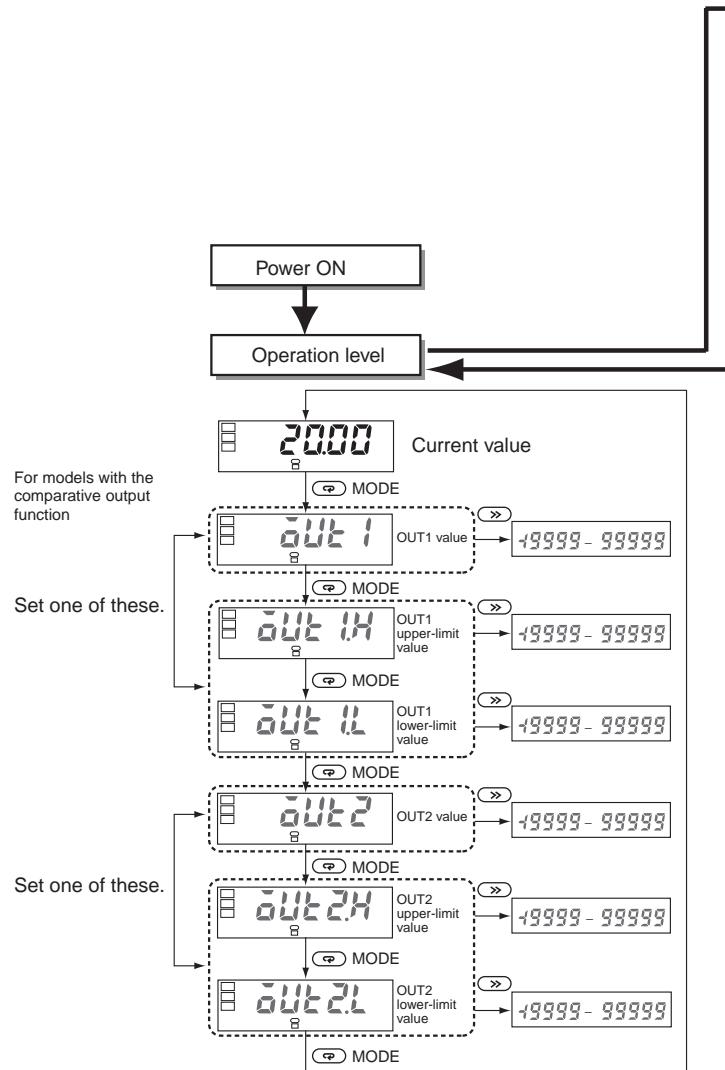

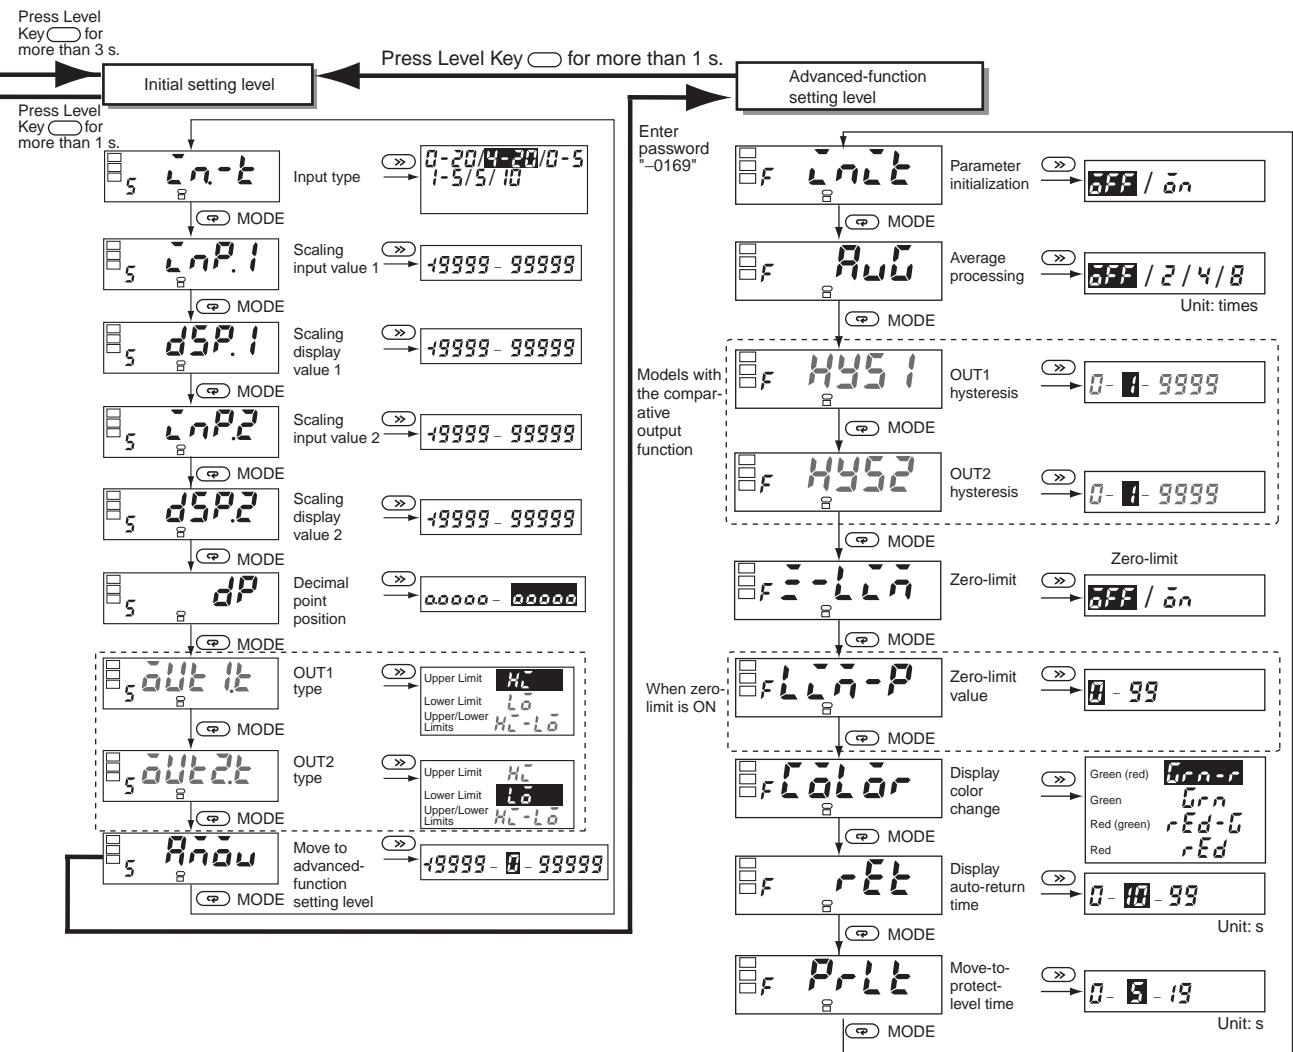

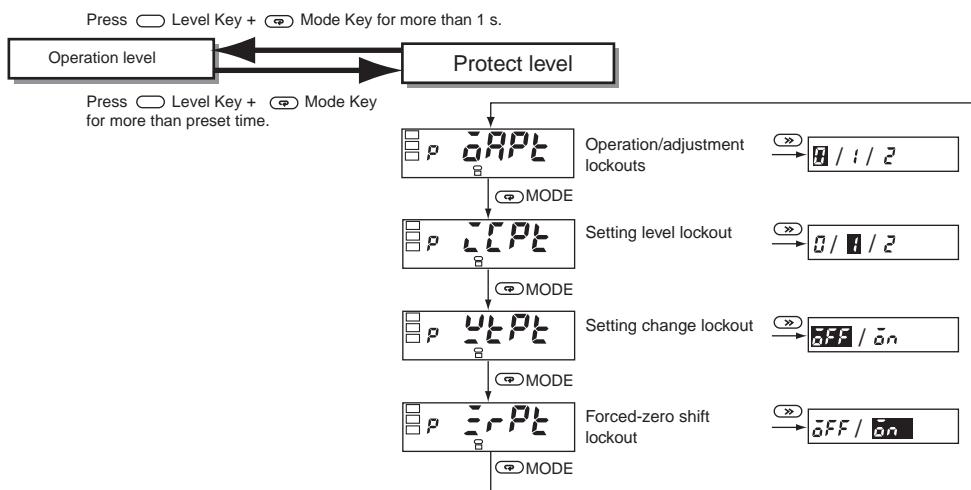

Operation/Adjustment Lockouts

Restricts key operations for operation level and adjustment level.

| Parameter | Setting | Operation level | |
|-------------|----------|-----------------------|-------------------|
| | | Current value display | Set value display |
| <i>oRPL</i> | <i>0</i> | Allowed | Allowed |
| | <i>1</i> | Allowed | Allowed |
| | <i>2</i> | Allowed | Prohibited |

- Initial setting is 0.
- This cannot be displayed on models not equipped with the comparative output function.

Setting Level Lockout

Restricts shifting to initial setting level or advanced-function setting level.

| Parameter | Setting | Shift to initial setting level | Shift to advanced-function setting level |
|-------------|----------|--------------------------------|--|
| <i>oCPL</i> | <i>0</i> | Allowed | Allowed |
| | <i>1</i> | Allowed | Prohibited |
| | <i>2</i> | Prohibited | Prohibited |

Setting Change Lockout

Restricts setting changes by key operation. When this lockout is set, it is no longer possible to shift to a setting change mode.

| Parameter | Setting | Setting change by key operation |
|-------------|------------|---------------------------------|
| <i>oCPL</i> | <i>OFF</i> | Allowed |
| | <i>ON</i> | Prohibited |


However, all protect level parameters can still be changed.

Forced-zero Lockout

Restricts the setting or release of a forced-zero by front-panel key operation.

| Parameter | Setting | Setting/release of forced-zero by key operation |
|-------------|------------|---|
| <i>oFPL</i> | <i>OFF</i> | Allowed |
| | <i>ON</i> | Prohibited |

Initial Settings

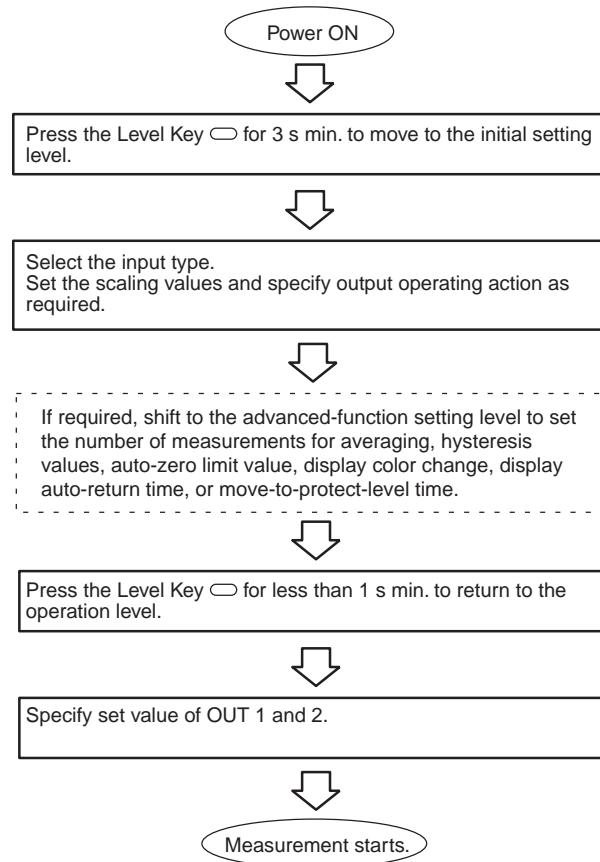


■ Setting Example

Initial Settings


The settings for the following example are shown here.

Example: Tank pressure display

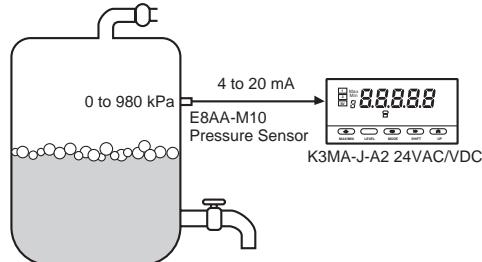

Here, the pressure inside the tank is to be displayed in units of 0.1 kPa.

- Pressure Sensor: E8AA-M10
Measuring range: 0 to 980 kPa, output 4 to 20 mA

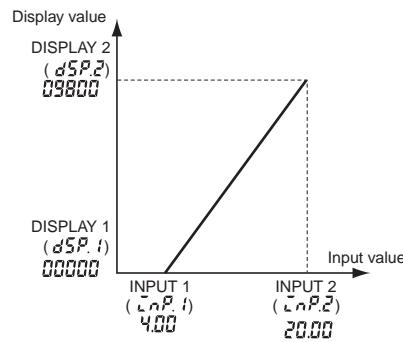

1. Set the K3MA-J input type to the 4 to 20 mA input range.
Parameter: InP.1 (input type), Setting value: 4-20
2. Set the display values for the corresponding input values.
Set the scaling as shown below for the following correspondence:
input 4 mA-->display 0.0, input 20 mA-->display 980.0

| Parameter | Setting value |
|--|---------------|
| InP.1 (scaling input value 1) | 4.00 |
| dSP.1 (scaling display value 1) | 00000 |
| InP.2 (scaling input value 2) | 20.00 |
| dSP.2 (scaling display value 2) | 09800 |
| dP (decimal point position) | 0000.0 |

Note: The decimal point position here refers to the position in the number after scaling. When setting the scaling display value, it is necessary to consider the number of digits to be displayed past the decimal point.

■ Troubleshooting

When an error occurs, error details will be displayed on the main indicator. Confirm the error from the main indicator and take the appropriate countermeasures.

| Level display | Main indicator | Error contents | Countermeasures |
|---------------|-----------------------|---|--|
| Not lit | <i>E</i> <i>III</i> | RAM memory error | Repair is necessary. Consult your OMRON sales representative. |
| 5 | <i>E</i> <i>III</i> | EEPROM memory error | When this error is displayed, press the Level Key for 3 seconds, and the settings will be restored to the factory settings. If the error cannot be recovered, repair is necessary. Consult your OMRON sales representative. |
| Not lit | Flashes <i>5 Err</i> | You will see this indication when turning ON the product the first time after purchase. This is because the input signal value is 0 mA at that time even though the range is factory set to 4 to 20 mA. | At the initial setting level, set the input type and other parameters according to your application. |
| | | Input error | Promptly change the input voltage/current to a value that falls within the measurement range. If the error cannot be recovered, repair is necessary. Consult your OMRON sales representative. |
| Not lit | Flashes <i>99999</i> | The scaling display value exceeds 99999. | Promptly change the input to a value that falls within the specified range. The scaling value may be inappropriate. Review the scaling value at the initial setting level. |
| | | The scaling display value is lower than -19999. | Promptly change the input to a value that falls within the specified range. The scaling value may be inappropriate. Review the scaling value at the initial setting level. |
| Not lit | Flashes <i>-19999</i> | | |

Warranty and Limitations of Liability

■ WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

■ LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS, OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall the responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted.

IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

Application Considerations

■ SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of products in the customer's application or use of the products.

At the customer's request, OMRON will provide applicable third party certification documents identifying ratings and limitations of use that apply to the products. This information by itself is not sufficient for a complete determination of the suitability of the products in combination with the end product, machine, system, or other application or use.

The following are some examples of applications for which particular attention must be given. This is not intended to be an exhaustive list of all possible uses of the products, nor is it intended to imply that the uses listed may be suitable for the products.

- Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this catalog.
- Nuclear energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations.
- Systems, machines, and equipment that could present a risk to life or property.

Please know and observe all prohibitions of use applicable to the products.

NEVER USE THE PRODUCTS FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCTS ARE PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

ALL DIMENSIONS SHOWN ARE IN MILLIMETERS.

To convert millimeters into inches, multiply by 0.03937. To convert grams into ounces, multiply by 0.03527.

Cat. No. N108-E1-04A In the interest of product improvement, specifications are subject to change without notice.

OMRON Corporation

Industrial Automation Company

Industrial Devices and Components Division H.Q.
Measuring Components Department
Shiokoji Horikawa, Shimogyo-ku,
Kyoto, 600-8530 Japan
Tel: (81)75-344-7080/Fax: (81)75-344-7189

Printed in Japan
0903-0.4M (1001) (B)