


# Termination Board

## SC-GPCD-DI32-PF



- System board for Honeywell Experion PKS, Series C
- For 32-channel DI card CC-TDIL01/11
- For 16 modules
- Recommended module: HiC2822 (DI)
- Recommended system cable: CAB-HON-\*\*-S37C32-MX-01000
- 24 V DC supply
- Hazardous area: pluggable screw terminals, blue
- Non-hazardous area: Sub-D connector (male), 37-pin

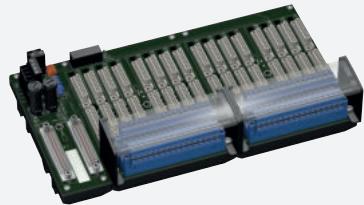

### Function


The function of the termination board and the connector pin assignment are exactly fitted to the requirements of the Honeywell system. The signal is output to the process control system via the system connector. Information about a missing supply voltage of the isolated barriers is available for the system as a volt-free contact. Wiring faults from the field side will be reported via the same relay contact, if this function is supported by the isolators. The termination board has a robust plastic housing. The termination board is mounted in the switch cabinet on a 35 mm DIN mounting rail according to EN 60175.

### Application

Honeywell card CC-TDIL01/11:

- Cable 1: channel 1 ... 16
- Cable 2: channel 17 ... 32

### Connection

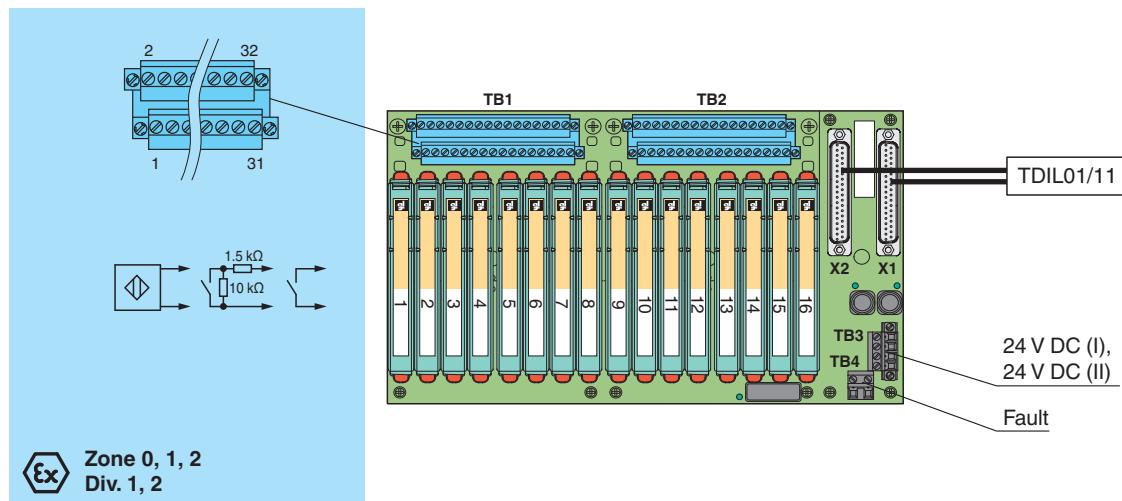

Release date: 2023-02-20 Date of issue: 2023-02-20 Filename: 209350\_eng.pdf

### Technical Data

#### Supply

Connection	TB3: terminals 2, 4(+); 1, 3(-)
Nominal voltage	24 V DC, in consideration of rated voltage of used isolators
Voltage drop	0.9 V, voltage drop across the series diode on the termination board must be considered
Ripple	≤ 10 %
Fusing	4 A, in each case for 16 modules

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group  
www.pepperl-fuchs.com

USA: +1 330 486 0002  
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222  
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091  
pa-info@sg.pepperl-fuchs.com

 PEPPERL+FUCHS

## Technical Data

Power dissipation	≤ 500 mW , without modules
Reverse polarity protection	yes
<b>Redundancy</b>	
Supply	
Redundancy available. The supply for the isolators is decoupled, monitored and fused.	
<b>Fault indication output</b>	
Connection	TB4: terminals 1, 2
Output type	volt-free contact
Switch behaviour	no fault: relay contact closed power supply fault: relay contact open module fault: relay contact open
Contact loading	30 V DC , 1 A
<b>Indicators/settings</b>	
Display elements	LED Supply1 (power supply termination board), green LED LED Supply2 (power supply termination board), green LED LED Fault Status (fault indication), green LED - LED lits: no module fault/no power supply fault
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013 (industrial locations)
<b>Conformity</b>	
Electromagnetic compatibility	NE 21:2017 For further information see system description.
Degree of protection	IEC 60529:2001
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
Storage temperature	-40 ... 70 °C (-40 ... 158 °F)
<b>Mechanical specifications</b>	
Degree of protection	IP20
Connection	
Field side	explosion hazardous area: pluggable screw terminals , blue
Control side	non-explosion hazardous area: 37-pin Sub-D connector
Supply	pluggable screw terminals , black
Fault output	pluggable screw terminals , black
Core cross section	screw terminals: 0.25 ... 2.5 mm <sup>2</sup> (24 ... 12 AWG)
Material	housing: polycarbonate
Mass	approx. 845 g
Dimensions	273 x 155 x 153 mm (10.7 x 6.1 x 6.0 inch) (W x H x D) , depth including module assembly
Mounting	on 35 mm DIN mounting rail acc. to EN 60715:2001
<b>Data for application in connection with hazardous areas</b>	
EU-type examination certificate	CESI 06 ATEX 022
Marking	Ex II (1)G [Ex ia Ga] IIC Ex II (1)D [Ex ia Da] IIIC Ex I (M1) [Ex ia Ma] I
Non-hazardous area	
Maximum safe voltage	250 V (Attention! U <sub>m</sub> is no rated voltage.)
Galvanic isolation	
Field circuit/control circuit	safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Directive conformity	
Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 , EN 60079-11:2012 , EN 50303:2000
<b>International approvals</b>	
UL approval	E106378
Control drawing	116-0327
IECEx approval	
IECEx certificate	IECEx CES 06.0003

## Technical Data


IECEx marking	[Ex ia Ga] IIC [Ex ia Da] IIIC [Ex ia Ma] I
<b>General information</b>	
Supplementary information	Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see <a href="http://www.pepperl-fuchs.com">www.pepperl-fuchs.com</a> .

## Accessories

	<b>CAB-HON-**-S37C32-MX-01000</b>	Cordset, 37-pin Sub-D socket to 37-pin Honeywell system socket, PVC cable
	<b>HiALC-HiCTF-SET-114</b>	Label carrier for HiC termination boards

## Application

## Typical circuit

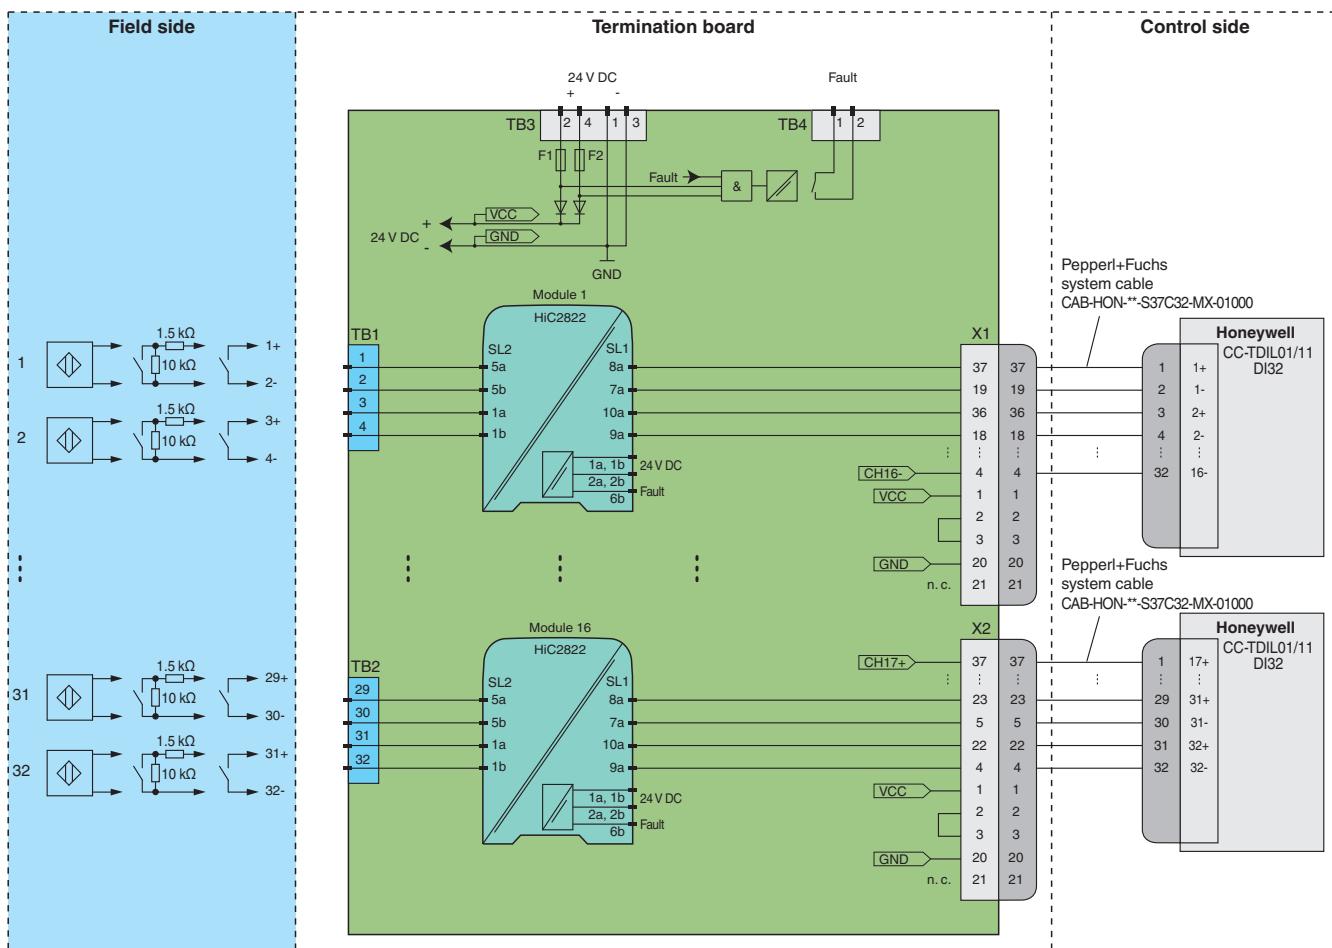

## Module switch settings

Type (DI)	DIP switch	Position
HIC2822	S1	II
• Mode of operation: close - energized open - de-energized	S2	I
• Input line fault detection: enabled	S3	II
	S4	I

*For exact pin assignment for connection to field side and control side, see the documentation of the isolated barrier.*



*The pin-out configuration has to be observed. For information see corresponding pin-out table on [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).*

