

# Termination Board

## HiCTB16-TRI-DIISD-EL-PL



- System board for Schneider Electric, Tricon series by Triconex
- TAN48 approval
- For 64-channel (32+32) DI card 3564
- For 16 modules
- Recommended module: HiC2822 (DI)
- 24 V DC supply
- Hazardous area: pluggable screw terminals, blue
- Non-hazardous area: ELCO socket, 56-pin



### Function


The function of the termination board and the connector pinout is exactly fitted to the requirements of Triconex system. The termination board has a fault bus (Fault) that is available at the redundant terminals. Power supply faults and module faults are indicated via this fault bus. The fault signals of several termination boards can be connected together and can be monitored by an optional fault indication board. The fault signals are then available to the control system as a volt-free contact. The termination board is supplied with a robust plastic housing. This design permits the fast and reliable installation on 35 mm DIN mounting rail according to EN 60715 in the switch cabinet.

### Application

Triconex card Tricon:

- Termination board 1 and cable 1: channel 1 to 32
- Termination board 2 and cable 2: channel 33 to 64

### Connection

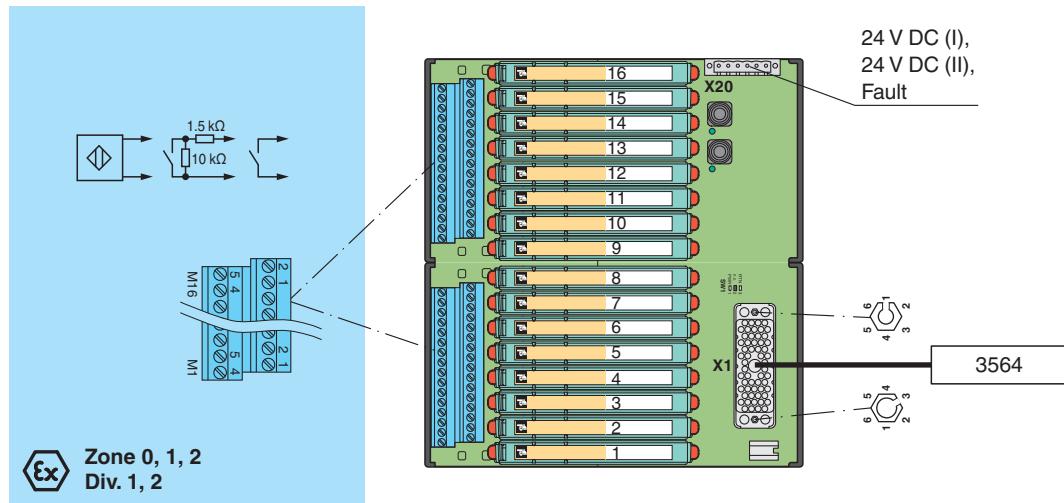

### Technical Data

#### Supply

Connection	X20: terminals 3, 5(+); 4, 6(-)
Nominal voltage	24 V DC, in consideration of rated voltage of used isolators
Voltage drop	0.9 V, voltage drop across the series diode on the termination board must be considered
Ripple	≤ 10 %
Fusing	4 A, in each case for 16 modules

## Technical Data

Power dissipation	≤ 500 mW , without modules
Reverse polarity protection	yes
<b>Redundancy</b>	
Supply	
Redundancy available. The supply for the isolators is decoupled, monitored and fused.	
<b>Fault indication output</b>	
Connection	fault bus (Fault) : X20: terminals 1, 2
Output type	volt-free contact
Switch behaviour	<p>fault bus (Fault)</p> <ul style="list-style-type: none"> <li>- no fault: relay contact of the fault indication board closed</li> <li>- power supply fault: relay contact of the fault indication board open</li> <li>- module fault: relay contact of the fault indication board open</li> </ul>
Contact loading	fault bus (Fault) : 30 V DC , 1 A , see fault indication board
<b>Indicators/settings</b>	
Display elements	LED PWR1 (termination board power supply), green LED LED PWR2 (termination board power supply), green LED
Configuration	<p>jumper SW1: card selection</p> <ul style="list-style-type: none"> <li>- position 1: DI card 3564</li> <li>- position 2: n.c. (factory setting)</li> <li>- position 3: DI card 3504E</li> </ul>
<b>Directive conformity</b>	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013 (industrial locations)
<b>Conformity</b>	
Electromagnetic compatibility	NE 21:2017 For further information see system description.
Degree of protection	IEC 60529:2001
<b>Ambient conditions</b>	
Ambient temperature	-20 ... 60 °C (-4 ... 140 °F)
Storage temperature	-40 ... 70 °C (-40 ... 158 °F)
<b>Mechanical specifications</b>	
Degree of protection	IP20
Connection	
Field side	explosion hazardous area: pluggable screw terminals , blue
Control side	non-explosion hazardous area: ELCO socket, 56-pin
Supply	pluggable screw terminals , black
Fault output	pluggable screw terminals , black
Core cross section	screw terminals: 0.2 ... 2.5 mm <sup>2</sup> (24 ... 12 AWG)
Material	housing: polycarbonate, 10 % glass fiber reinforced
Mass	approx. 780 g
Dimensions	216 x 200 x 163 mm (8.5 x 7.9 x 6.42 inch) (W x H x D) , depth including module assembly
Mounting	on 35 mm DIN mounting rail acc. to EN 60715:2001
<b>Data for application in connection with hazardous areas</b>	
EU-type examination certificate	CESI 06 ATEX 022
Marking	  
Non-hazardous area	
Maximum safe voltage	250 V (Attention! U <sub>m</sub> is no rated voltage.)
Galvanic isolation	
Field circuit/control circuit	safe electrical isolation acc. to IEC/EN 60079-11, voltage peak value 375 V
Directive conformity	
Directive 2014/34/EU	EN IEC 60079-0:2018+AC:2020 , EN 60079-11:2012 , EN 50303:2000
<b>International approvals</b>	
UL approval	E106378
Control drawing	116-0327

## Technical Data

**IECEx approval**

IECEx certificate

IECEx CES 06.0003

IECEx marking

[Ex ia Ga] IIC  
[Ex ia Da] IIIC  
[Ex ia Ma] I**General information**

Supplementary information

Observe the certificates, declarations of conformity, instruction manuals, and manuals where applicable. For information see [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).


## Accessories

**HIALC-HICTB-SET-108**

Label carrier for HiC termination boards

## Application

## Typical circuit

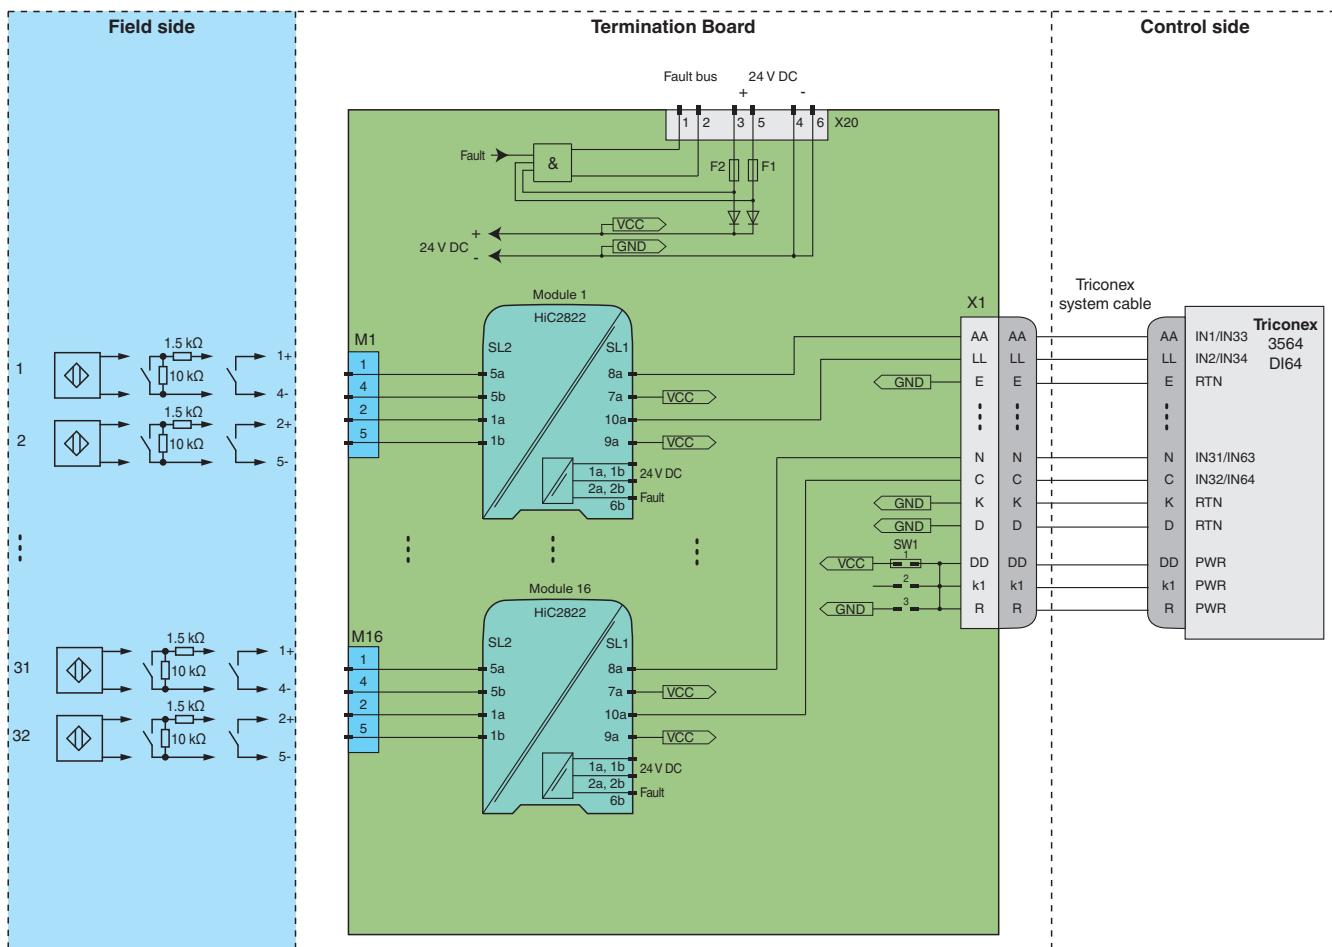

## Termination Board configuration

Jumper SW1	Position	Card selection
	1	DI card 3564
	2	n.c. (factory setting)
	3	DI card 3504E

## Module switch settings

Type (DI)	DIP switch	Position
HiC2822	S1	II
• Mode of operation: close – energized open – de-energized	S2	I
• Input line fault detection: enabled	S3	II
	S4	I

**For exact pin assignment for connection to field side and control side, see the documentation of the isolated barrier.**



**The pin-out configuration has to be observed. For information see corresponding pin-out table on [www.pepperl-fuchs.com](http://www.pepperl-fuchs.com).**