



Digital Input LB1101A



- 2 channels
- Inputs Ex ia
- Mounting in Zone 2, Class I/Div.2 or in the safe area
- Dry contact or NAMUR inputs
- Galvanic isolation between channels and the bus
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring
- Module can be exchanged under voltage



Function

The device accepts digital input signals of NAMUR sensors or mechanical contacts from the hazardous area. Open or short circuit line fault alarms are detected. The intrinsically safe inputs are galvanically isolated from the bus and the power supply (EN 60079-11).

Connection

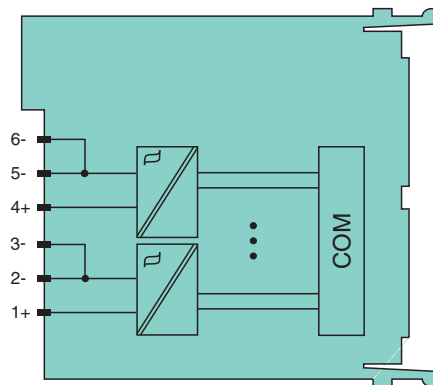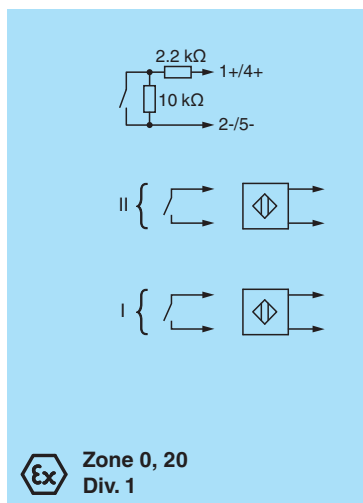

**Zone 2
Div. 2**

Technical Data

Slots

Occupied slots	1
----------------	---

Supply

Connection	backplane bus
Rated voltage	U_r 12 V DC , only in connection with the power supplies LB9***
Power dissipation	0.65 W
Power consumption	0.65 W

Electrical specifications

Galvanic isolation	Galvanic isolation between channels
--------------------	-------------------------------------

Internal bus

Connection	backplane bus
Interface	manufacturer-specific bus to standard com unit

Technical Data

Digital input

Number of channels		2
Sensor interface		
Connection		NAMUR sensor
Connection [2]		volt-free contact
Connection [3]		active binary signal 24 V DC
Connection		channel I: 1+, 2/3-; channel II: 4+, 5/6-
Rated values		acc. to EN 60947-5-6 (NAMUR)
Switching point/switching hysteresis		1.2 ... 2.1 mA / $\pm$ 0.2 mA
Voltage		8.2 V
Internal resistor	R _i	1 k Ω
Line fault detection		can be switched on/off for each channel via configuration tool
Connection		mechanical switch with additional resistors (see connection diagram) proximity switches without additional wiring
Short-circuit		< 360 Ω
Open-circuit		< 0.35 mA
Minimum pulse duration		20 ms

Indicators/settings

LED indication		Power LED (P) green: supply Status LED (1, 3) red: line fault (per channel) Status LED (2, 4) yellow: signal (per channel)
Coding		optional mechanical coding via front socket

Directive conformity

Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013

Conformity

Electromagnetic compatibility		NE 21
Degree of protection		IEC 60529
Environmental test		EN 60068-2-14
Shock resistance		EN 60068-2-27
Vibration resistance		EN 60068-2-6
Damaging gas		EN 60068-2-42
Relative humidity		EN 60068-2-78

Ambient conditions

Ambient temperature		-40 ... 60 °C (-40 ... 140 °F)
Storage temperature		-40 ... 85 °C (-40 ... 185 °F)
Relative humidity		95 % non-condensing
Altitude		max. 2000 m
Shock resistance		shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance		frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration $\pm$ 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration $\pm$ 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas		designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3

Mechanical specifications

Degree of protection		IP20 when mounted on backplane
Connection		removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm ²) or screw terminals (0.08 ... 1.5 mm ²)
Mass		approx. 110 g
Dimensions		16 x 100 x 102 mm (0.63 x 3.9 x 4 inch)

Data for application in connection with hazardous areas

EU-type examination certificate		PTB 03 ATEX 2042 X
Marking		Ⓔ II (1)G [Ex ia Ga] IIC Ⓔ II (1)D [Ex ia Da] IIIC Ⓔ I (M1) [Ex ia Ma] I


Release date: 2023-10-19 Date of issue: 2023-10-19 Filename: 254620_eng.pdf

Technical Data

Input		
Voltage	U _o	12.6 V
Current	I _o	12.8 mA
Power	P _o	40.1 mW (linear characteristic)
Certificate		PF 08 CERT 1234 X
Marking		Ⓔ II 3 G Ex nA IIC T4 Gc
Galvanic isolation		
Input/power supply, internal bus		safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V
Directive conformity		
Directive 2014/34/EU		EN IEC 60079-0:2018+AC:2020 EN 60079-11:2012 EN 60079-15:2010
International approvals		
ATEX approval		PTB 03 ATEX 2042 X
UL approval		E106378
IECEX approval		
IECEX certificate		IECEX BVS 09.0037X
IECEX marking		Ex nA [ia Ga] IIC T4 Gc [Ex ia Da] IIC [Ex ia Ma] I
General information		
System information		The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2, Zone 22 or Div. 2) the module must be installed in an appropriate enclosure.
Supplementary information		EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Assembly

Front view

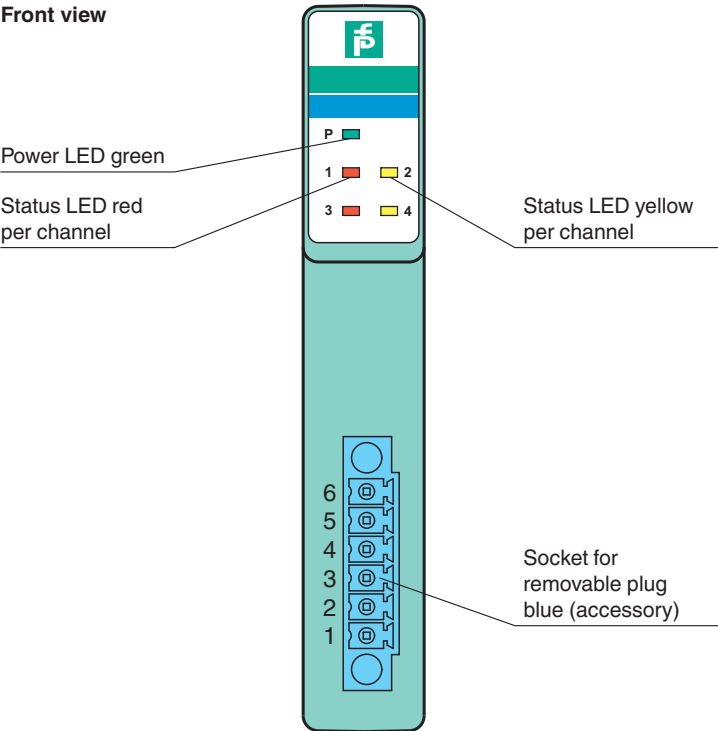

Release date: 2023-10-19 Date of issue: 2023-10-19 Filename: 254620_eng.pdf