



Frequency / Counter Input

LB1103C



- 1-channel
- Input Ex ia
- Mounting in Zone 2, Class I/Div.2 or in the safe area
- Input for frequency, counter, direction of rotation
- Digital input max. 400 Hz
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Line fault detection (LFD)
- Permanently self-monitoring
- Module can be exchanged under voltage



Function

The device accepts digital input signals of NAMUR sensors or mechanical contacts from the hazardous area. Open and short-circuit line faults are detected. The intrinsically safe input is galvanically isolated from the bus and the power supply.

Connection

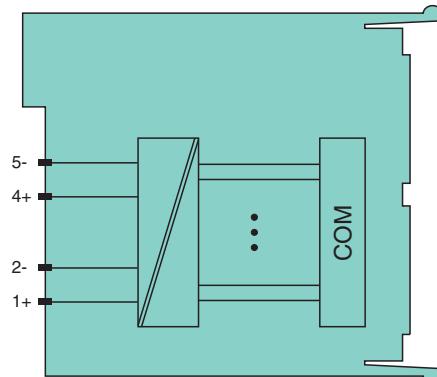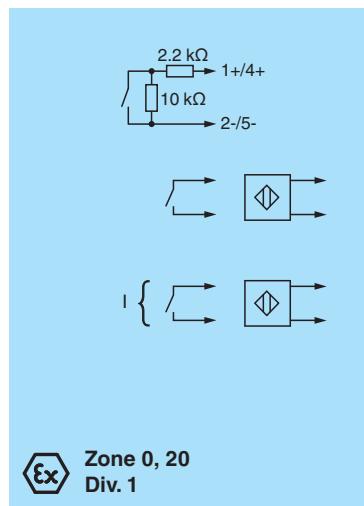

Zone 2
Div. 2

Technical Data

Release date: 2023-10-19 Date of issue: 2023-10-19 Filename: 254623_eng.pdf

Slots		
Occupied slots		1
Supply		
Connection		backplane bus
Rated voltage	U_r	12 V DC, only in connection with the power supplies LB9***
Power dissipation		0.65 W
Power consumption		0.65 W
Internal bus		
Connection		backplane bus
Interface		manufacturer-specific bus to standard com unit
Digital input		
Number of channels		1

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

 PEPPERL+FUCHS

Technical Data

Function	
Function	Counter
Function [2]	frequency
Function [3]	direction of rotation
Sensor interface	
Connection	NAMUR sensor
Connection [2]	volt-free contact
Connection	channel I: 1+, 2/3-; direction: 4+, 5/6-
Rated values	acc. to EN 60947-5-6 (NAMUR)
Switching point/switching hysteresis	1.2 ... 2.1 mA / ± 0.2 mA
Voltage	8.2 V
Internal resistor	R_i 1 kΩ
Line fault detection	can be switched on/off for each channel via configuration tool
Connection	mechanical switch with additional resistors (see connection diagram) proximity switches without additional wiring
Short-circuit	< 360 Ω
Open-circuit	< 0.35 mA
Minimum pulse duration	; in frequency + counter mode: 12.5 ms ; otherwise 20 µs
Operating frequency	0 ... 400 Hz ; in frequency + counter mode ... 40 Hz
Indicators/settings	
LED indication	Power LED (P) green: supply Status LED (1) red: line fault
Coding	optional mechanical coding via front socket
Directive conformity	
Electromagnetic compatibility	
Directive 2014/30/EU	EN 61326-1:2013
Conformity	
Electromagnetic compatibility	NE 21
Degree of protection	IEC 60529
Environmental test	EN 60068-2-14
Shock resistance	EN 60068-2-27
Vibration resistance	EN 60068-2-6
Damaging gas	EN 60068-2-42
Relative humidity	EN 60068-2-78
Ambient conditions	
Ambient temperature	-40 ... 60 °C (-40 ... 140 °F)
Storage temperature	-40 ... 85 °C (-40 ... 185 °F)
Relative humidity	95 % non-condensing
Altitude	max. 2000 m
Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration ± 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration ± 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas	designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications	
Degree of protection	IP20 when mounted on backplane
Connection	removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm²) or screw terminals (0.08 ... 1.5 mm²)
Mass	approx. 90 g
Dimensions	16 x 100 x 102 mm (0.63 x 3.9 x 4 inch)
Data for application in connection with hazardous areas	
EU-type examination certificate	PTB 03 ATEX 2042 X

Technical Data

Marking		
Ex II (1)G [Ex ia Ga] IIC Ex II (1)D [Ex ia Da] IIIC Ex I (M1) [Ex ia Ma] I		
Input		
Voltage	U_o	10.5 V
Current	I_o	23.3 mA
Power	P_o	61.2 mW (linear characteristic)
Certificate		PF 08 CERT 1234 X
Marking		Ex II 3 G Ex nA IIC T4 Gc
Galvanic isolation		safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V
Directive conformity		
Directive 2014/34/EU		EN IEC 60079-0:2018+AC:2020 EN 60079-11:2012 EN 60079-15:2010
International approvals		
ATEX approval		PTB 03 ATEX 2042 X
UL approval		E106378
IECEx approval		
IECEx certificate		IECEx BVS 09.0037X
IECEx marking		Ex nA [ia Ga] IIC T4 Gc [Ex ia Da] IIIC [Ex ia Ma] I
General information		
System information		The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2, Zone 22 or Div. 2) the module must be installed in an appropriate enclosure.
Supplementary information		EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Assembly

Front view

