



Digital Output with Shutdown Input FB6208C


- 8-channel
- Outputs Ex ib
- Installation in suitable enclosures in Zone 1
- Module can be exchanged under voltage (hot swap)
- Galvanic group isolation
- Line fault detection (LFD)
- Positive or negative logic selectable
- Simulation mode for service operations (forcing)
- Permanently self-monitoring
- Output with watchdog
- Output with bus-independent safety shutdown

CE  **SIL 2**

Function

The device features 8 independent channels.
The device can be used to drive low power solenoids, sounders, or LEDs.
Open and short-circuit line faults are detected.
The outputs are galvanically isolated from the bus and the power supply.
The outputs can be switched off via a contact. This can be used for bus-independent safety applications.

Connection

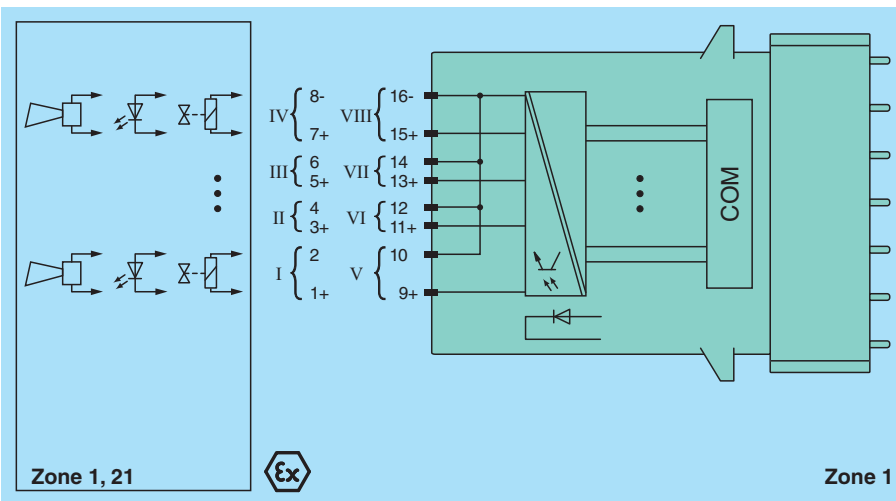

Technical Data

Slots

Occupied slots	2
----------------	---

Functional safety related parameters

Safety Integrity Level (SIL)	SIL 2
------------------------------	-------

Supply

Connection	backplane bus
Rated voltage	U _r 12 V DC , only in connection with the power supplies FB92**
Power dissipation	2.35 W
Power consumption	2.35 W

Internal bus

Technical Data

Connection		backplane bus
Interface		manufacturer-specific bus to standard com unit
Digital output		
Number of channels		8
Suitable field devices		
Field device		Solenoid Valve
Field device [2]		audible alarm
Field device [3]		visual alarm
Connection		channel I: 1+, 2-; channel II: 3+, 4-; channel III: 5+, 6-; channel IV: 7+, 8-; channel V: 9+, 10-; channel VI: 11+, 12-; channel VII: 13+, 14-; channel VIII: 15+, 16-
Current limit	$I_{\max}$	5.2 mA
Open loop voltage	U_s	21.6 V
Line fault detection		can be switched on/off for each channel via configuration tool
Test current		0.33 mA
Short-circuit		< 300 Ω
Open-circuit		> 50 k Ω
Response time		20 ms (depending on bus cycle time)
Watchdog		within 0.5 s the device goes in safe state, e.g. after loss of communication
Indicators/settings		
LED indication		LED green: supply LED red: line fault, communication error red flashing
Coding		optional mechanical coding via front socket
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU		EN 61326-1:2013
Conformity		
Electromagnetic compatibility		NE 21
Degree of protection		IEC 60529
Environmental test		EN 60068-2-14
Shock resistance		EN 60068-2-27
Vibration resistance		EN 60068-2-6
Damaging gas		EN 60068-2-42
Relative humidity		EN 60068-2-78
Ambient conditions		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Storage temperature		-25 ... 85 °C (-13 ... 185 °F)
Relative humidity		95 % non-condensing
Shock resistance		shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance		frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration ± 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration ± 1 mm/0.7 g; 90 minutes at each resonance
Damaging gas		designed for operation in environmental conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications		
Degree of protection		IP20 (module), a separate housing is required acc. to the system description
Connection		removable front connector with screw flange (accessory) wiring connection via spring terminals (0.14 ... 1.5 mm ²) or screw terminals (0.08 ... 1.5 mm ²)
Mass		approx. 750 g
Dimensions		57 x 107 x 132 mm (2.2 x 4.2 x 5.2 inch)
Data for application in connection with hazardous areas		
EU-type examination certificate		PTB 97 ATEX 1074 U
Marking		Ⓔ II 2 G Ex d [ib] IIC Gb Ⓔ II (2) D [Ex ib Db] IIIC
Output		


Release date: 2023-06-13 Date of issue: 2023-06-13 Filename: 542157_eng.pdf

Technical Data

Voltage	U _o	30 V
Current	I _o	13.5 mA
Power	P _o	404 mW (rectangular characteristic curve)
Galvanic isolation		
Output/power supply, internal bus		safe electrical isolation acc. to EN 60079-11, voltage peak value 375 V
Directive conformity		
Directive 2014/34/EU		EN IEC 60079-0:2018+AC:2020 EN 60079-1:2014 EN 60079-11:2012
International approvals		
ATEX approval		PTB 97 ATEX 1075 ; PTB 97 ATEX 1074 U
General information		
System information		The module has to be mounted in appropriate backplanes and housings (FB92**) in Zone 1, 2, 21, 22 or outside hazardous areas (gas or dust). Here, observe the corresponding EC-type examination certificate.
Supplementary information		EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .

Assembly

Front view

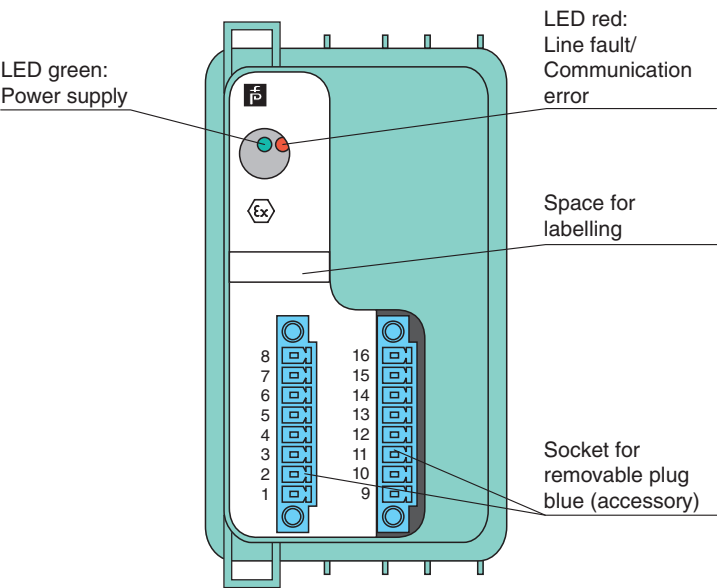

Accessories

FB9224*	Field Unit
FB9225*	Redundancy Field Unit
FB9248*	Field Unit