

XCSRZE

M12 plug for XCSRC Daisy Chain models,
Telemecanique Safety switches XCS,
Loopback device



Main

| | |
|------------------------------------|-----------------------------------|
| Range of product | Telemecanique Safety switches XCS |
| Accessory / separate part category | RFID accessory |
| Accessory / separate part type | Loopback device |

Complementary

| | |
|---------------------------------------|---------------------------------------|
| Product or component type | M12 plug for XCSRC Daisy-Chain models |
| Accessory / separate part destination | RFID safety switch |
| Product compatibility | XCSRC.2M12 |
| Net weight | 0.02 kg |


Packing Units

| | |
|------------------------------|-----------|
| Unit Type of Package 1 | PCE |
| Number of Units in Package 1 | 1 |
| Package 1 Height | 4.800 cm |
| Package 1 Width | 7.500 cm |
| Package 1 Length | 7.800 cm |
| Package 1 Weight | 16.000 g |
| Unit Type of Package 2 | S01 |
| Number of Units in Package 2 | 24 |
| Package 2 Height | 15 cm |
| Package 2 Width | 15 cm |
| Package 2 Length | 40 cm |
| Package 2 Weight | 544.000 g |

Offer Sustainability

| | |
|--|---|
| Sustainable offer status | Green Premium product |
| Circularity Profile | No need of specific recycling operations |
| California proposition 65 | WARNING: This product can expose you to chemicals including: Diisononyl phthalate (DINP), which is known to the State of California to cause cancer, and Di-isodecyl phthalate (DIDP), which is known to the State of California to cause birth defects or other reproductive harm. For more information go to www.P65Warnings.ca.gov |
| For all Reach Rohs enquiries contact us at | sustainability@tesensors.com |


Dimensions



Connections

Wiring Diagram: Series Connection

Cat. 4 / PL=e (EN/ISO 13849-1) / SIL3 (IEC 61508) / SILCL3 IEC 62061), if combined with an appropriate Preventa XPS Safety module
PL=e / SIL3

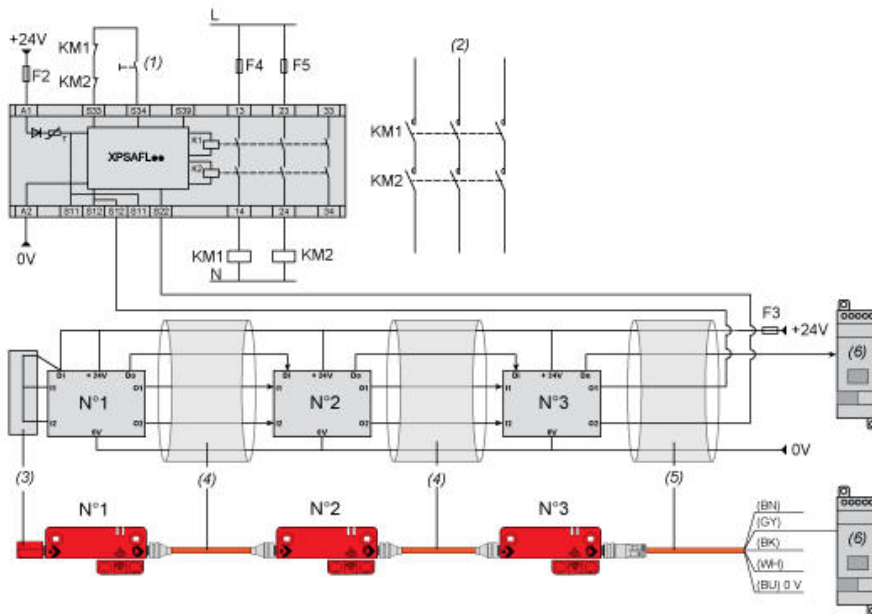

- (1) Start
- (2) Power circuit
- (3) Loopback device
- (4) M12/M12 female jumpers
- (5) Pre-wired female connectors
- (6) Diagnostic module (option)

NOTE: KM1 and KM2 contactors must have force-guided contacts.